

# GEMÜ R639 eSyStep

## Positioner (Code S0)

Motorized diaphragm valve

EN

### Operating instructions



All rights including copyrights or industrial property rights are expressly reserved.

Keep the document for future reference.

© GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG  
12.10.2023

---

## Contents

<b>1 General information .....</b>	<b>4</b>
1.1 Information .....	4
1.2 Symbols used .....	4
1.3 LED symbols .....	4
1.4 Definition of terms .....	4
1.5 Warning notes .....	4
<b>2 Safety information .....</b>	<b>5</b>
<b>3 Product description .....</b>	<b>5</b>
3.2 LED displays .....	6
<b>4 Correct use .....</b>	<b>6</b>
<b>5 Order data .....</b>	<b>7</b>
<b>6 Technical data .....</b>	<b>9</b>
<b>7 Electrical connection .....</b>	<b>15</b>
<b>8 Dimensions .....</b>	<b>20</b>
<b>9 Manufacturer's information .....</b>	<b>34</b>
9.1 Delivery .....	34
9.2 Packaging .....	34
9.3 Transport .....	34
9.4 Storage .....	34
<b>10 Installation in piping .....</b>	<b>34</b>
10.1 Preparing for installation .....	34
10.2 Installation position .....	35
10.3 Installation with butt weld spigots .....	35
10.4 Installation with threaded sockets .....	35
10.5 Installation with union ends .....	35
10.6 Installation with solvent cement sockets ....	36
10.7 Installation with flare connection .....	36
<b>11 Specific data IO-Link (pin 6) .....</b>	<b>37</b>
11.1 Operation on IO-Link .....	37
11.2 Process data .....	40
11.3 Parameter overview .....	41
11.4 Parameter .....	45
11.5 Events .....	62
<b>12 Operation .....</b>	<b>64</b>
12.1 Initialization .....	64
12.2 Manual override .....	64
<b>13 Inspection and maintenance .....</b>	<b>65</b>
13.2 Removing the actuator .....	65
13.3 Removing the diaphragm .....	65
13.6 Mounting the actuator .....	67
<b>14 Troubleshooting .....</b>	<b>68</b>
<b>15 Removal from piping .....</b>	<b>70</b>
<b>16 Disposal .....</b>	<b>70</b>
<b>17 Returns .....</b>	<b>70</b>
<b>18 EU Declaration of Incorporation according to the EC Machinery Directive 2006/42/EC, Annex II B ...</b>	<b>71</b>
<b>19 EU Declaration of Conformity in accordance with 2014/68/EU (Pressure Equipment Directive) .....</b>	<b>72</b>
<b>20 EU Declaration of Conformity in accordance with 2014/30/EU (EMC Directive) .....</b>	<b>73</b>
<b>21 EU Declaration of Conformity in accordance with 2011/65/EU (RoHS Directive) .....</b>	<b>74</b>

## 1 General information

### 1.1 Information

- The descriptions and instructions apply to the standard versions. For special versions not described in this document the basic information contained herein applies in combination with any additional special documentation.
- Correct installation, operation, maintenance and repair work ensure faultless operation of the product.
- Should there be any doubts or misunderstandings, the German version is the authoritative document.
- Contact us at the address on the last page for staff training information.

### 1.2 Symbols used

The following symbols are used in this document:

Symbol	Meaning
●	Tasks to be performed
►	Response(s) to tasks
–	Lists

### 1.3 LED symbols

The following LED symbols are used in the documentation:

Symbol	LED conditions
○	Off
●	Lit (on)
⦿	Flashing

### 1.4 Definition of terms

#### Working medium

The medium that flows through the GEMÜ product.

#### Diaphragm size

Uniform seat size of GEMÜ diaphragm valves for different nominal sizes.

### 1.5 Warning notes



Wherever possible, warning notes are organised according to the following scheme:



SIGNAL WORD	
Possible symbol for the specific danger	<b>Type and source of the danger</b> <ul style="list-style-type: none"> <li>► Possible consequences of non-observance.</li> <li>● Measures for avoiding danger.</li> </ul>


Warning notes are always marked with a signal word and sometimes also with a symbol for the specific danger.

The following signal words and danger levels are used:




 <b>DANGER</b>	
	<b>Imminent danger!</b> <ul style="list-style-type: none"> <li>► Non-observance can cause death or severe injury.</li> </ul>

 <b>WARNING</b>	
	<b>Potentially dangerous situation!</b> <ul style="list-style-type: none"> <li>► Non-observance can cause death or severe injury.</li> </ul>

 <b>CAUTION</b>	
	<b>Potentially dangerous situation!</b> <ul style="list-style-type: none"> <li>► Non-observance can cause moderate to light injury.</li> </ul>

<b>NOTICE</b>	
	<b>Potentially dangerous situation!</b> <ul style="list-style-type: none"> <li>► Non-observance can cause damage to property.</li> </ul>

The following symbols for the specific dangers can be used within a warning note:

Symbol	Meaning
	Danger of explosion!
	Corrosive chemicals!
	Hot plant components!

## 2 Safety information

The safety information in this document refers only to an individual product. Potentially dangerous conditions can arise in combination with other plant components, which need to be considered on the basis of a risk analysis. The operator is responsible for the production of the risk analysis and for compliance with the resulting precautionary measures and regional safety regulations.

The document contains fundamental safety information that must be observed during commissioning, operation and maintenance. Non-compliance with these instructions may cause:

- Personal hazard due to electrical, mechanical and chemical effects.
- Hazard to nearby equipment.
- Failure of important functions.
- Hazard to the environment due to the leakage of dangerous substances.

The safety information does not take into account:

- Unexpected incidents and events, which may occur during installation, operation and maintenance.
- Local safety regulations which must be adhered to by the operator and by any additional installation personnel.

### Prior to commissioning:

1. Transport and store the product correctly.
2. Do not paint the bolts and plastic parts of the product.
3. Carry out installation and commissioning using trained personnel.
4. Provide adequate training for installation and operating personnel.
5. Ensure that the contents of the document have been fully understood by the responsible personnel.
6. Define the areas of responsibility.
7. Observe the safety data sheets.
8. Observe the safety regulations for the media used.

### During operation:


9. Keep this document available at the place of use.
10. Observe the safety information.
11. Operate the product in accordance with this document.
12. Operate the product in accordance with the specifications.
13. Maintain the product correctly.
14. Do not carry out any maintenance work and repairs not described in this document without consulting the manufacturer first.

### In cases of uncertainty:

15. Consult the nearest GEMÜ sales office.

## 3 Product description


### 3.1 Construction

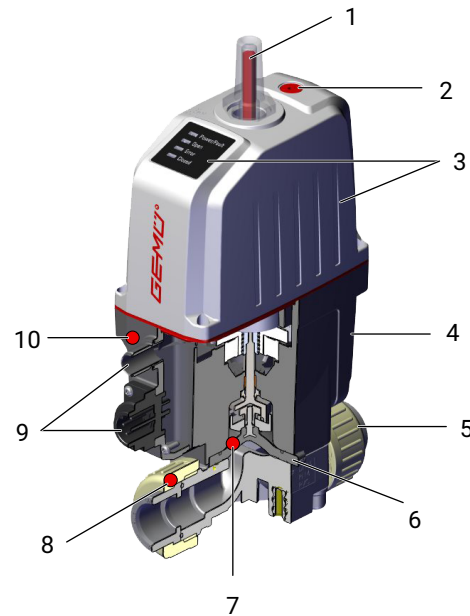

Item	Name	Materials
1	Optical position indicator	PA 12
2	Manual override	
3	Actuator top with LED display	Reinforced polyamide
4	Actuator base	Reinforced polyamide
5	Valve body	PVC-U, grey ABS PP, reinforced PVDF inliner PP-H, grey, outliner PP, reinforced inliner PVDF/outliner PP, reinforced PP-H, natural
6	Diaphragm	EPDM, FKM, NBR, PTFE / EPDM
7	CONEXO diaphragm RFID chip (see Conexo information)	
8	CONEXO body RFID chip (see Conexo information)	
9	Electrical connections	
10	CONEXO actuator RFID chip (see Conexo information)	

### 3.2 LED displays

#### 3.2.1 Status LEDs



LED	Colour		Function
	Standard	Inversed <sup>1)</sup>	
<b>Power/fault</b>	green	green	Operating indication/ communication status
	red	red	
<b>Open</b>	orange	green	Process valve in OPEN position
<b>Error</b>	red	red	Error
<b>Closed</b>	green	orange	Process valve in CLOSED position

1) Inversed representation of the OPEN and CLOSED LEDs, adjustable via IO-Link

#### 3.2.2 LED conditions

Status process valve	Power/fault	Open	Error	Closed
OPEN position	●	●	○	○
CLOSED position	●	○	○	●
Position unknown	●	○	○	○
Initialization	●	☀	○	☀
		Open and Closed flash alternately		

LED conditions					
●	lit (on)	☀	flashes	○	off

### 3.3 Description

The GEMÜ R639 eSyStep 2/2-way diaphragm valve is electrically operated. The eSyStep electric actuator is available as On/Off actuator or with integrated positioner. An integral optical and electrical position indicator is standard. The self-locking actuator holds its position in a stable manner when idle and in the event of power supply failure.

### 3.4 Function

The product controls or regulates (depending on version) a flowing medium by being closed or opened by a motorized actuator.

The product is equipped as standard with a mechanical position indicator as well as an electrical position and status indicator.

### 4 Correct use

**⚠ DANGER**

**Danger of explosion!**

- ▶ Risk of death or severe injury
- Do **not** use the product in potentially explosive zones.

**⚠ WARNING**

**Improper use of the product!**

- ▶ Risk of severe injury or death
- ▶ Manufacturer liability and guarantee will be void.
- Only use the product in accordance with the operating conditions specified in the contract documentation and in this document.

The product is designed for installation in piping systems and for controlling a working medium.

The product is not intended for use in potentially explosive areas.

- Use the product in accordance with the technical data.

## 5 Order data

The order data provide an overview of standard configurations.

Please check the availability before ordering. Other configurations available on request.

### Order codes

1 Type	Code
Diaphragm valve, electrically operated, eSyStep	R639

2 DN	Code
DN 12	12
DN 15	15
DN 20	20
DN 25	25
DN 32	32
DN 40	40
DN 50	50

3 Body configuration	Code
2/2-way body	D

4 Connection type	Code
<b>Spigot</b>	
Spigot DIN	0
Spigot for IR butt welding	20
Spigot for IR butt welding, BCF	28
Spigot – inch, for welding or solvent cementing, depending on the body material	30
Body with threaded spigots for unions	7X
<b>Union end</b>	
Union end with insert (socket) – DIN	7
Union end with insert (Rp threaded socket) – DIN	7R
Union end with inch insert – BS (socket)	33
Union end with inch insert – ASTM (socket)	3M
Union end with insert – JIS (socket)	3T
Union end with insert (for IR butt welding) – DIN	78
<b>Threaded socket</b>	
Threaded socket DIN ISO 228	1
<b>Solvent cement socket</b>	
Solvent cement socket DIN	2
<b>Flange</b>	
Flange EN 1092, PN 10, form B, face-to-face dimension FTF EN 558 series 1, ISO 5752, basic series 1	4
Flange ANSI Class 125/150 RF, face-to-face dimension FTF EN 558 series 1, ISO 5752, basic series 1, length only for body configuration D	39
<b>Flare</b>	
Flare connection with PVDF union nut	75

5 Valve body material	Code
PVC-U, grey	1
ABS	4
PP, reinforced	5

5 Valve body material	Code
PVDF	20
Inliner PP-H, grey, outliner PP, reinforced	71
Inliner PVDF/outliner PP, reinforced	75
PP-H, natural	N5

6 Diaphragm material	Code
<b>Elastomer</b>	
NBR	2
FKM	4
EPDM	29
<b>PTFE</b>	
PTFE/EPDM one-piece	54
PTFE/EPDM two-piece	5M
<b>Note:</b> The PTFE/EPDM diaphragm (code 5M) is available from diaphragm size 25.	

7 Voltage/Frequency	Code
24 V DC	C1

8 Control module	Code
Positioner	S0
Positioner, configured for emergency power supply module (NC)	S5
Positioner, configured for emergency power supply module (NO)	S6

9 Actuator version	Code
Actuator size 0 diaphragm size 10	0C
Actuator size 1	1A

10 Mounting plate	Code
Including mounting plate	M
Without	

**Order example**

Ordering option	Code	Description
1 Type	R639	Diaphragm valve, electrically operated, eSyStep
2 DN	15	DN 15
3 Body configuration	D	2/2-way body
4 Connection type	7	Union end with insert (socket) – DIN
5 Valve body material	1	PVC-U, grey
6 Diaphragm material	29	EPDM
7 Voltage/Frequency	C1	24 V DC
8 Control module	S0	Positioner
9 Actuator version	0C	Actuator size 0 diaphragm size 10
10 Mounting plate		Without



## 6 Technical data

### 6.1 Medium

**Working medium:** Corrosive, inert, gaseous and liquid media which have no negative impact on the physical and chemical properties of the body and diaphragm material.

### 6.2 Temperature

**Media temperature:**

Valve body material	Media temperature
PVC-U, grey (code 1)	10 – 60 °C
ABS (code 4)	-10 – 60 °C
PP, reinforced (code 5)	5 – 80 °C
PVDF (code 20)	-10 – 80 °C
Inliner PP-H grey / outliner PP, reinforced (code 71)	5 – 80 °C
Inliner PVDF / outliner PP, reinforced (code 75)	-10 – 80 °C
PP-H, natural (code N5)	5 – 80 °C

**Ambient temperature:**

Valve body material	Ambient temperature
PVC-U, grey (code 1)	10 – 50 °C
ABS (code 4)	-10 – 50 °C
PP, reinforced (code 5)	5 – 50 °C
PVDF (code 20)	-10 – 50 °C
Inliner PP-H grey / outliner PP, reinforced (code 71)	5 – 50 °C
Inliner PVDF / outliner PP, reinforced (code 75)	-5 – 50 °C
PP-H, natural (code N5)	5 – 50 °C

### 6.3 Pressure

**Operating pressure:**

MG	DN	Actuator version	Diaphragm materials	
			Elastomer	PTFE
<b>10</b>	<b>12 - 20</b>	<b>0C</b>	0 - 6	0 - 6
<b>20</b>	<b>15 - 25</b>	<b>1A</b>	0 - 8	0 - 8
<b>25</b>	<b>32</b>	<b>1A</b>	0 - 8	0 - 8
<b>40</b>	<b>40 - 50</b>	<b>1A</b>	0 - 8	0 - 4

MG = diaphragm size

All pressures are gauge pressures. Operating pressure values were determined with static operating pressure applied on one side of a closed valve. Sealing at the valve seat and atmospheric sealing is ensured for the given values.

Information on operating pressures applied on both sides and for high purity media on request.

The operating pressures apply at room temperature. In case of deviating temperatures, observe the pressure / temperature correlation.

**Pressure rating:**

PN 10

**Pressure/temperature correlation:**

MG	Actuator version	Materials	Code	Temperatures in °C (valve body)										
				-10	0	5	10	20	30	40	50	60	70	80
<b>10</b>	<b>0C</b>	<b>PVC-U</b>	<b>1</b>	-	-	-	6.0	6.0	6.0	6.0	3.5	1.5	-	-
		<b>PP-H</b>	<b>5</b>	-	-	6.0	6.0	6.0	6.0	6.0	5.5	4.0	2.7	1.5
		<b>PVDF</b>	<b>20</b>	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	5.4	4.7
		<b>PP-H-Natur</b>	<b>N5</b>	-	-	6.0	6.0	6.0	6.0	6.0	5.5	4.0	2.7	1.5
<b>20, 25</b>	<b>1A</b>	<b>PVC-U</b>	<b>1</b>	-	-	-	8.0	8.0	8.0	6.0	3.5	1.5	-	-
		<b>ABS</b>	<b>4</b>	8.0	8.0	8.0	8.0	8.0	8.0	6.0	4.0	2.0	-	-
		<b>PP-H</b>	<b>71</b>	-	-	8.0	8.0	8.0	8.0	7.0	5.5	4.0	2.7	1.5
		<b>PVDF</b>	<b>75</b>	8.0	8.0	8.0	8.0	8.0	8.0	8.0	7.1	6.3	5.4	4.7

MG = diaphragm size

Actuator version 1A with PTFE diaphragm can be used up to max. 4 bar. At temperatures above 30 °C the maximum operating pressure decreases.

The pressure rating (PN) depends on the diaphragm size.

Data for extended temperature ranges on request. Please note that the ambient temperature and media temperature generate a combined temperature at the valve body which must not exceed the above values.

Depending on the valve configuration, the maximum operating pressure of the pressure rating may be lower.

Observe the operating pressure table.

**Leakage rate:**

Leakage rate A to P11/P12 EN 12266-1

**Kv values:**

MG	Nominal size	Kv value
<b>MG 10</b>	<b>DN 12</b>	2.8
	<b>DN 15</b>	3.5
	<b>DN 20</b>	3.5
<b>MG 20</b>	<b>DN 15</b>	6.0
	<b>DN 20</b>	10.0
	<b>DN 25</b>	12.0
<b>MG 25</b>	<b>DN 32</b>	20.0
<b>MG 40</b>	<b>DN 40</b>	42.0
	<b>DN 50</b>	46.0

Kv values in m³/h

MG = diaphragm size

Kv values determined acc.to DIN EN 60534 standard, inlet pressure 5 bar, Δp 1 bar, PVC-U valve body and soft elastomer diaphragm.

The Kv values for other product configurations (e.g. other diaphragm or body materials) may differ. In general, all diaphragms are subject to the influences of pressure, temperature, the process and their tightening torques. Therefore the Kv values may exceed the tolerance limits of the standard.

The Kv value curve (Kv value dependent on valve stroke) can vary depending on the diaphragm material and duration of use.

## 6.4 Product compliance

**Machinery Directive:** 2006/42/EC

**Pressure Equipment Directive:** 2014/68/EU  
FDA\*

\* depending on version and / or operating parameters

**EMC Directive:** 2014/30/EU

**RoHS Directive:** 2011/65/EU

## 6.5 Materials

**Materials:**

Diaphragm material	O-ring material
PTFE	FKM
NBR	EPDM
FKM	FKM
EPDM	EPDM

**6.6 Mechanical data****Protection class:** IP 65 acc. to EN 60529**Actuating speed:** Max. 3 mm/s**Weight:****Actuator**

Actuator size 0 (code 0C) 0.95 kg

Actuator size 1 (code 1A) 1.88 kg

**Valve body**

MG	DN	Spigot			Union end				Flange	Threaded socket	Solvent cement socket	Flare
		Connection type code										
0, 30	20	28	7, 7R	33	3M, 3T	78	4, 39	1	2	75		
10	12	-	-	-	-	-	-	-	-	0.08	0.06	-
	15	-	-	0.13	0.18	0.13	-	0.20	-	-	-	0.08
	20	-	-	-	-	-	-	-	-	-	-	0.125
20	15	0.12	0.10	-	0.17	0.24	0.26	0.27	0.67	-	-	-
	20	0.13	0.12	-	0.21	0.28	0.30	0.36	0.84	-	-	-
	25	0.16	0.14	-	0.26	0.33	0.38	0.37	1.28	-	-	-
25	32	0.22	0.18	-	0.40	0.70	0.73	0.63	1.89	-	-	-
40	40	0.50	0.40	-	0.73	0.83	0.93	1.13	2.36	-	-	-
	50	0.57	0.47	-	1.00	1.40	1.50	1.60	3.08	-	-	-

MG = diaphragm size, weight in kg

**Installation position:** Optional**Flow direction:** Optional

## 6.7 Actuator duty cycle and service life


### Service life:

**Control operation** - Class C according to EN 15714-2 (1,800,000 starts and 1200 starts per hour).

**Open/Close duty** - At least 500,000 switching cycles at room temperature and permissible duty cycle.

### Duty cycle:

Control module Positioner (code S0, S5, S6), Open/Close duty

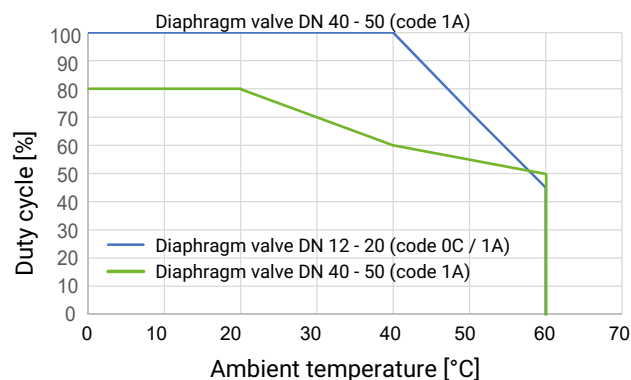

Control module positioner (code S0, S5, S6), control operation - class C acc. to EN 15714-

- DN 4 - 25 (code 0A) up to 50 °C ambient temperature
- DN 40 - 50 (code 1A) up to 30 °C ambient temperature

### NOTICE

- The specified characteristics and values apply to the default setting.
- With reduced forces, higher duty cycles and/or higher ambient temperatures are possible. At higher force settings the duty cycle and/or ambient temperature is reduced.
- IO-Link: Index 0x90 - Subindex 2 - Force

**6.8 Electrical data**

<b>Supply voltage U<sub>v</sub>:</b>	24 V DC $\pm$ 10%	
<b>Rating:</b>	Actuator size 0 (code 0C)	20 W
	Actuator size 1 (code 1A)	60 W
<b>Operation:</b>	Stepper motor, self-locking	
<b>Reverse battery protection:</b>	Yes	

**6.8.1 Analogue input signals – Control module Positioner (code S0, S5, S6)****6.8.1.1 Set value**

<b>Input signal:</b>	0/4 - 20 mA; 0 - 10 V (function selectable via IO-Link)
<b>Input type:</b>	passive
<b>Input resistance:</b>	250 $\Omega$
<b>Accuracy/linearity:</b>	$\leq \pm 0.3\%$ of full flow
<b>Temperature drift:</b>	$\leq \pm 0.1\%$ / 10°K
<b>Resolution:</b>	12 bit
<b>Reverse battery protection:</b>	Yes (up to $\pm$ 24 V DC)

**6.8.2 Digital input signals**

<b>Inputs:</b>	Function selectable via IO-Link (see table Overview of available functions – Input and output signals)
<b>Input voltage:</b>	24 V DC
<b>Logic level "1":</b>	> 15.3 V DC
<b>Logic level "0":</b>	< 5.8 V DC
<b>Input current:</b>	typically < 0.5 mA

**6.8.3 Analogue output signals – Control module Positioner (code S0, S5, S6)****6.8.3.1 Actual value**

<b>Output signal:</b>	0/4 - 20 mA; 0 - 10 V (function selectable via IO-Link)
<b>Output type:</b>	Active
<b>Accuracy:</b>	$\leq \pm 1\%$ of full flow
<b>Temperature drift:</b>	$\leq \pm 0.1\%$ / 10°K
<b>Load resistor:</b>	$\leq$ 750 k $\Omega$
<b>Resolution:</b>	12 bit
<b>Short-circuit proof:</b>	Yes

### 6.8.4 Digital output signals

<b>Outputs:</b>	Function selectable via IO-Link (see table Overview of available functions – Input and output signals)
<b>Type of contact:</b>	Push-Pull
<b>Switching voltage:</b>	Power supply $U_v$
<b>Switching current:</b>	$\leq 140$ mA
<b>Short-circuit proof:</b>	Yes

### 6.8.5 Communication

<b>Interface:</b>	IO-Link
<b>Function:</b>	Parameterization/process data
<b>Transmission rate:</b>	38400 baud
<b>Frame type in Operate:</b>	2.V (eSyStep positioner, code S0, S5, S6), PDout 3Byte; PDin 3 Byte; OnRequestData 2 Byte
<b>Min. cycle time:</b>	20 ms (eSyStep positioner, code S0, S5, S6)
<b>Vendor-ID:</b>	401
<b>Device-ID:</b>	1906801 (eSyStep positioner, code S0, S5, S6),
<b>Product-ID:</b>	eSyStep Positioner (code S0, S5, S6)
<b>ISDU support:</b>	Yes
<b>SIO operation:</b>	Yes
<b>IO-Link specification:</b>	V1.1

IODD files can be downloaded via <https://ioddfinder.io-link.com/> or [www.gemu-group.com](http://www.gemu-group.com).

### 6.9 Behaviour in the event of an error

<b>Function:</b>	In the event of an error the valve moves to the error position. Notes: Moving to the error position is only possible with full power supply. This behaviour is not a safety position. The valve must be operated with a GEMÜ 1571 emergency power supply module (see accessories) to ensure the function in case of voltage loss.
<b>Error position:</b>	Closed, open or hold (adjustable via IO-Link).


## 7 Electrical connection

### NOTICE

#### Appropriate cable socket/appropriate mating connector


- The appropriate connectors are included for X1 and X2.

### 7.1 Position of the connectors

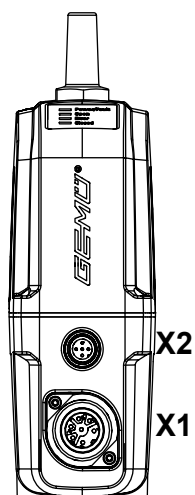

### 7.2 Electrical connection


#### 7.2.1 Connection X1



7-pin plug, Binder, type 693

Pin	Signal name
1	Uv, 24 V DC supply voltage
2	GND
3	Digital input 1
4	Digital input 2
5	Digital input/output
6	Digital output, IO-Link
7	n.c.



**7.2.2 Connection X2 (only for positioner design)**

5-pin M12 plug, A-coded

Pin	Signal name
1	I+/U+, set value input
2	I-/U-, set value input
3	I+/U+, actual value output
4	I-/U-, actual value output
5	n.c.

**7.3 Overview of available functions – Input and output signals****NOTICE**


- The factory default setting "Configured for emergency power supply module" is reset to default settings when a reset is carried out.

**NOTICE**

- When the digital inputs for OPEN and CLOSE are activated simultaneously, the defined error position is approached.

	Function	Control module S0	Control module S5, S6
		Default settings	Factory default setting "Configured for emergency power supply module"
Digital input 1	Off/Open/Closed/Safe/On/Initialization	Initialization	Initialization
Digital input 2	Off/Open/Closed/Safe/On/Initialization	Off	Safe/On
Digital input/output	Open/Closed/Error/Error and warning/Initialization	Error	Error
Digital output	Open/Closed/Error/Error and warning	Closed	Closed
Analogue input	4–20 mA/0–20 mA/0–10 V	4–20 mA	4–20 mA
Analogue output	4–20 mA/0–20 mA/0–10 V	4–20 mA	4–20 mA


## 7.4 Connection diagram

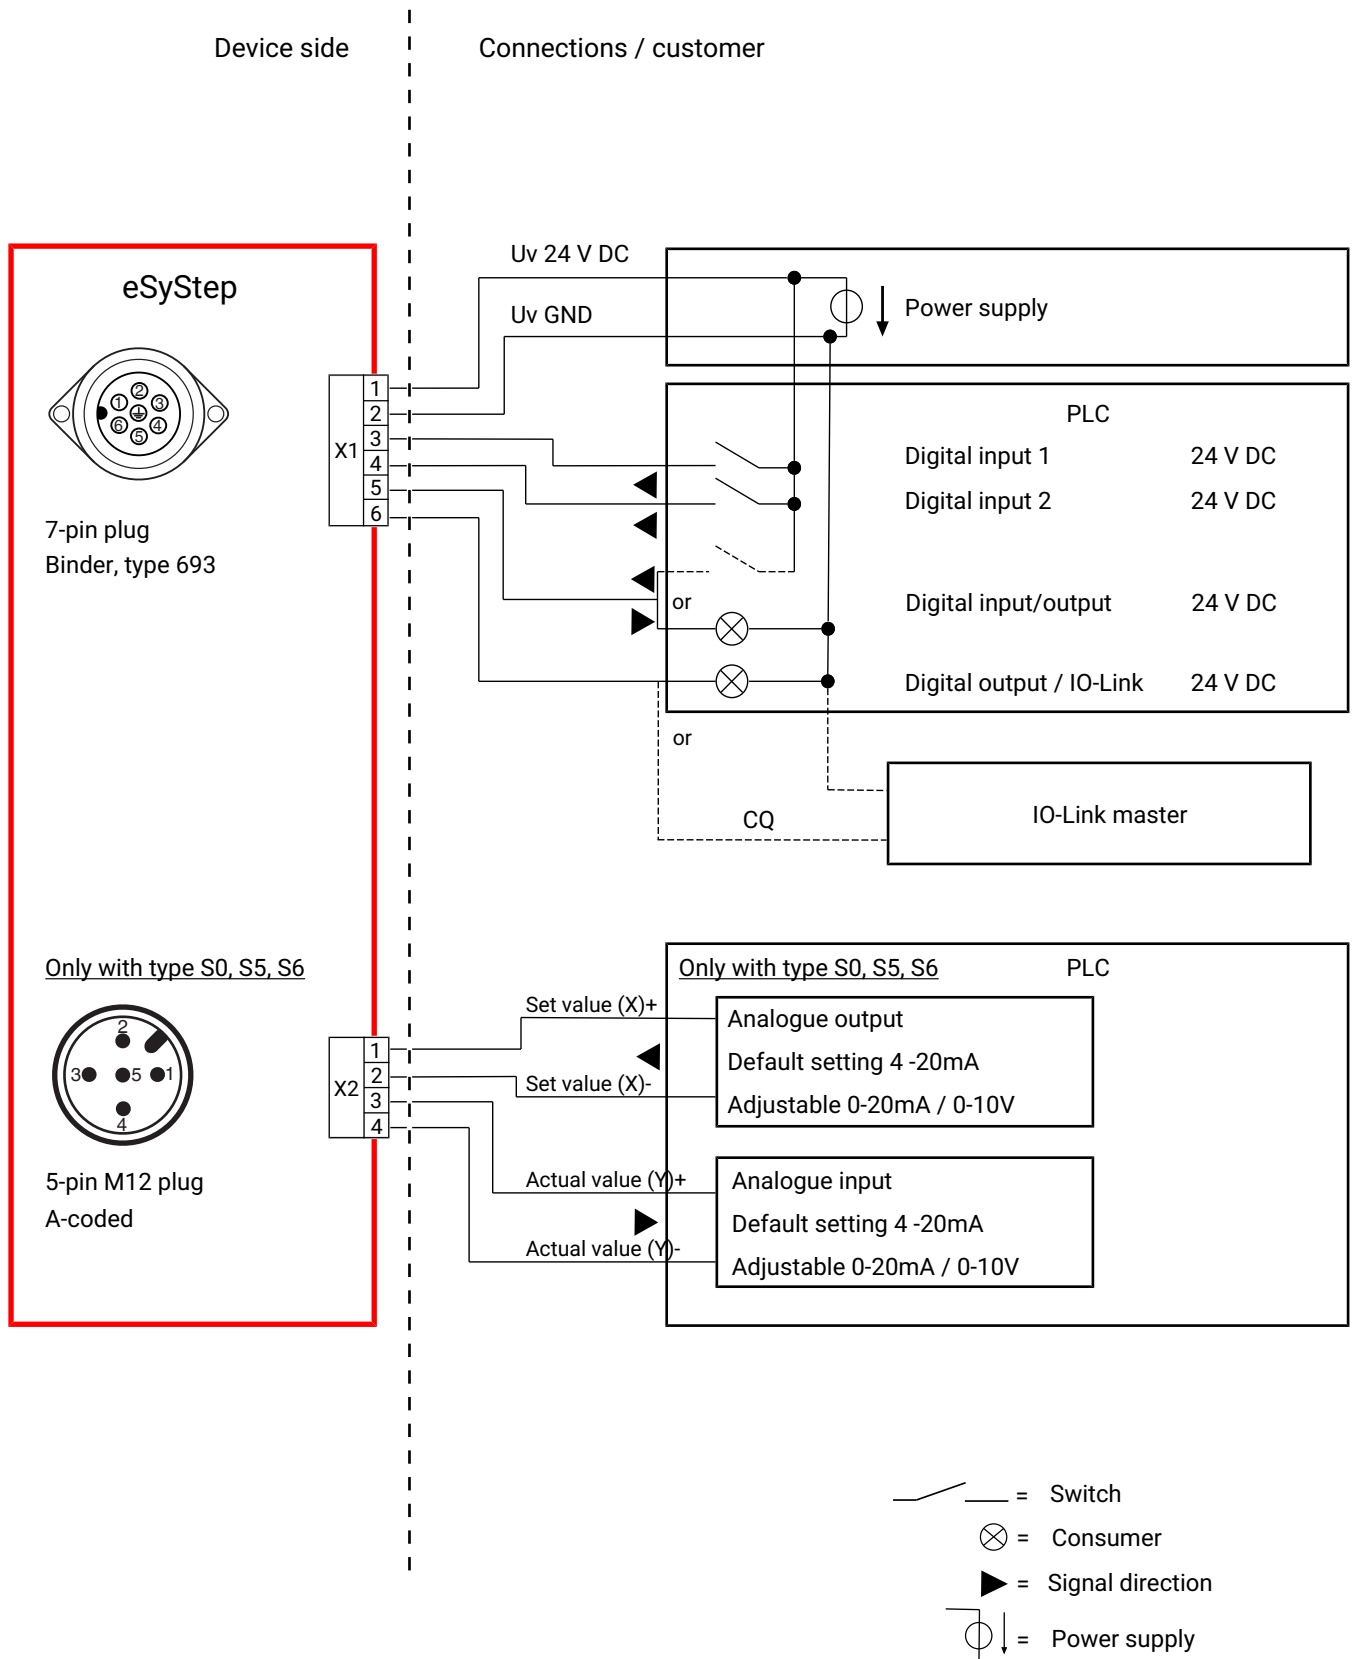

## 8 Dimensions

### 8.1 Installation and actuator dimensions

#### 8.1.1 Actuator version code 0C

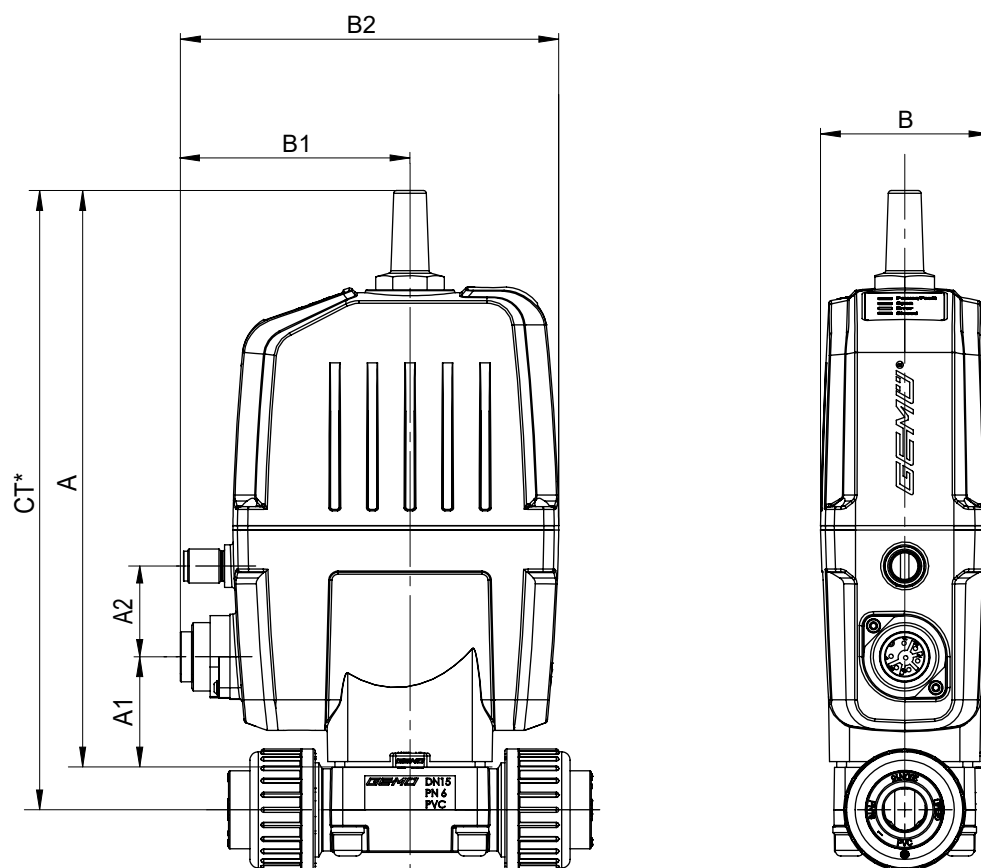


MG	DN	Actuator version	A	A1	A2	B	B1	B2
10	12 - 20	0C	203.5	39.0	33.2	59.4	81.0	133.5

Dimensions in mm, MG = diaphragm size

\* CT = A + H1 (see body dimensions)

8.1.2 Actuator version code 1A

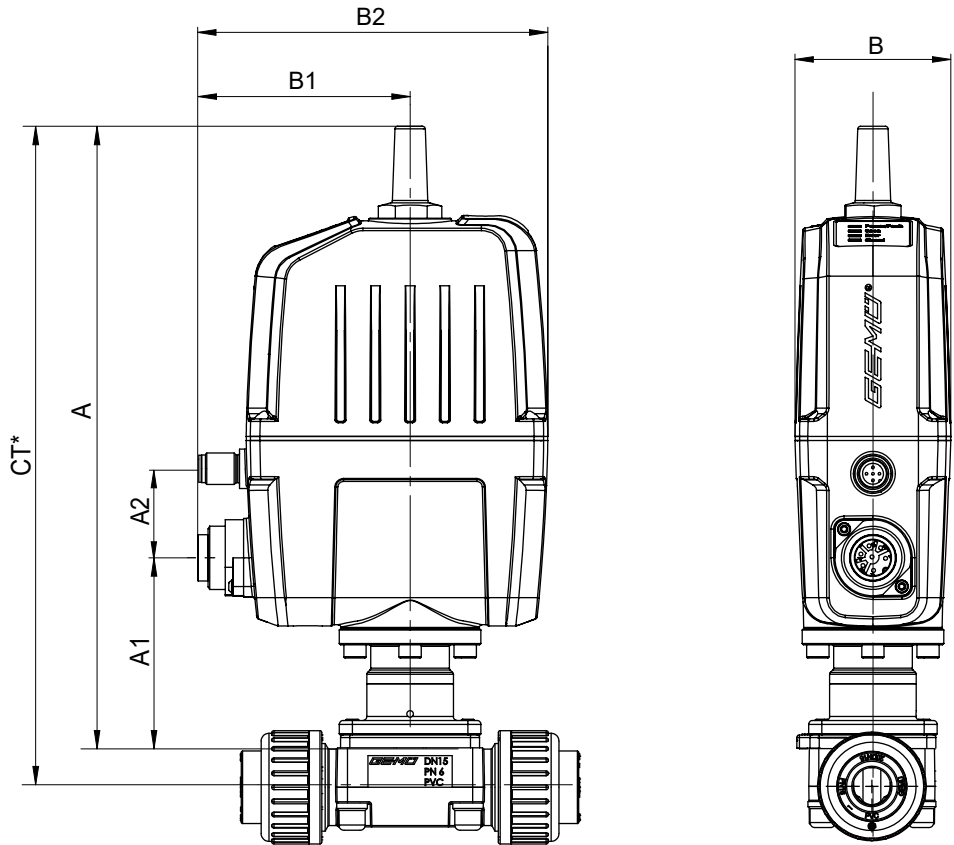


MG	DN	Actuator version	A	A1	A2	B	B1	B2
20	15 - 25	1A	298.0	116.0	32.5	70.0	82.0	150.0
25	32	1A	306.0	124.0	32.5	70.0	82.0	150.0
40	40 - 50	1A	304.0	122.0	32.5	70.0	82.0	150.0

Dimensions in mm, MG = diaphragm size

\* CT = A + H1 (see body dimensions)

## 8.2 Body dimensions

### 8.2.1 Spigot DIN / inch (code 0, 30)

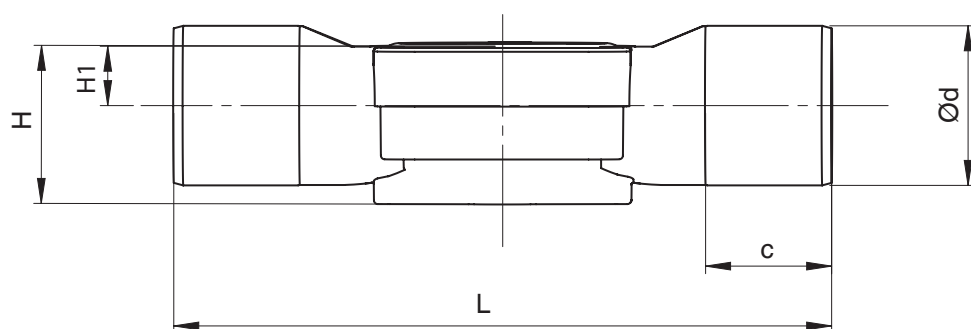

Connection type spigot DIN (code 0)<sup>1)</sup>, body material PVC-U (code 1), inliner/outliner (code 71, 75)<sup>2)</sup>

MG	DN	NPS	c		ød	H		H1	L
			Material			Material			
			1	71, 75		1	71, 75		
20	15	1/2"	16.0	18.0	20.0	36.0	36.0	10.0	124.0
	20	3/4"	19.0	19.0	25.0	38.0	38.0	12.0	144.0
	25	1"	22.0	22.0	32.0	39.0	39.0	13.0	154.0
25	32	1¼"	32.0	32.0	40.0	41.0	41.0	15.0	174.0
40	40	1½"	35.0	26.0	50.0	63.2	63.2	23.2	194.0
	50	2"	38.0	33.0	63.0	63.2	63.2	23.2	224.0

Connection type spigot – inch (code 30)<sup>1)</sup>, body material PVC-U (code 1), ABS (code 4)<sup>2)</sup>

MG	DN	NPS	c	ød	H	H1	L
20	15	1/2"	24.0	21.4	36.0	10.0	141.0
	20	3/4"	27.0	26.7	38.0	12.0	144.0
	25	1"	30.0	33.6	39.0	13.0	154.0
25	32	1¼"	33.0	42.2	41.0	15.0	174.0
40	40	1½"	35.0	48.3	63.2	23.2	194.0
	50	2"	40.0	60.3	63.2	23.2	224.0

Dimensions in mm

MG = diaphragm size

#### 1) Connection type

Code 0: Spigot DIN

Code 30: Spigot – inch, for welding or solvent cementing, depending on the body material

#### 2) Valve body material


Code 1: PVC-U, grey

Code 4: ABS

Code 71: Inliner PP-H, grey, outliner PP, reinforced

Code 75: Inliner PVDF/outliner PP, reinforced

### 8.2.2 Spigot IR (code 20)

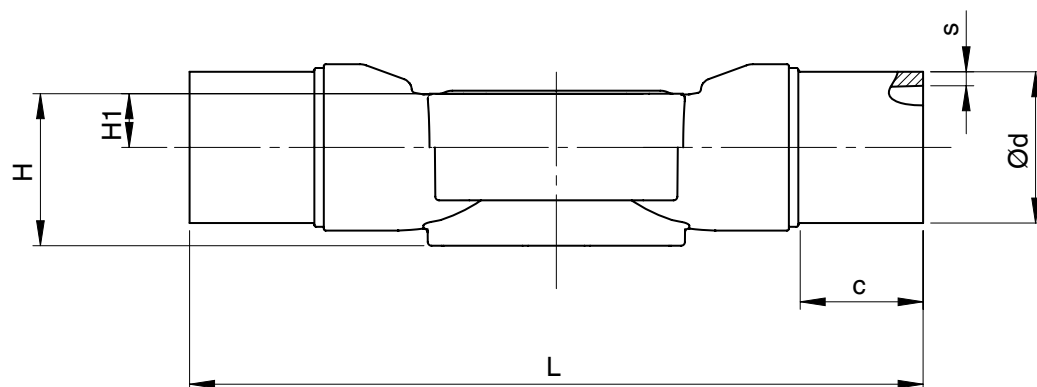

Connection type spigot IR (code 20)<sup>1)</sup>, body material inliner/outliner (code 71, 75)<sup>2)</sup>

MG	DN	NPS	c	Ød	H	H1	L	s	
								Material	
								71	75
20	15	1/2"	33.0	20.0	36.0	10.0	154.0	1.9	1.9
	20	3/4"	33.0	25.0	38.0	12.0	154.0	2.3	1.9
	25	1"	33.0	32.0	39.0	13.0	154.0	2.9	2.4
25	32	1¼"	33.0	40.0	41.0	15.0	194.0	3.7	2.4
40	40	1½"	33.0	50.0	63.2	23.2	194.0	4.6	3.0
	50	2"	33.0	63.0	63.2	23.2	224.0	5.8	3.0

Dimensions in mm

MG = diaphragm size


1) **Connection type**

Code 20: Spigot for IR butt welding

2) **Valve body material**

Code 71: Inliner PP-H, grey, outliner PP, reinforced

Code 75: Inliner PVDF/outliner PP, reinforced

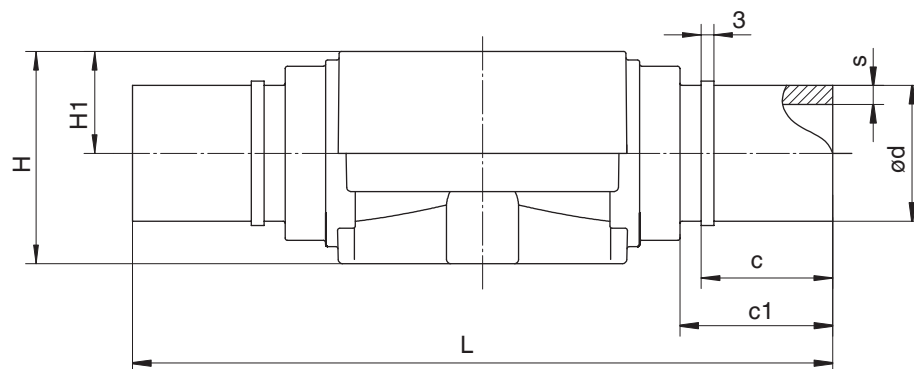**8.2.3 Spigot (code 28)****Connection type spigot (code 28) <sup>1)</sup>, body material PVDF (code 20) <sup>2)</sup>**

MG	DN	NPS	c	c1	ød	H	H1	L	s
10	15	1/2"	31.0	37.0	20.0	41.0	16.0	134.0	1.9

Dimensions in mm

MG = diaphragm size

**1) Connection type**


Code 28: Spigot for IR butt welding, BCF

**2) Valve body material**

Code 20: PVDF



### 8.2.4 Union end DIN (code 7)

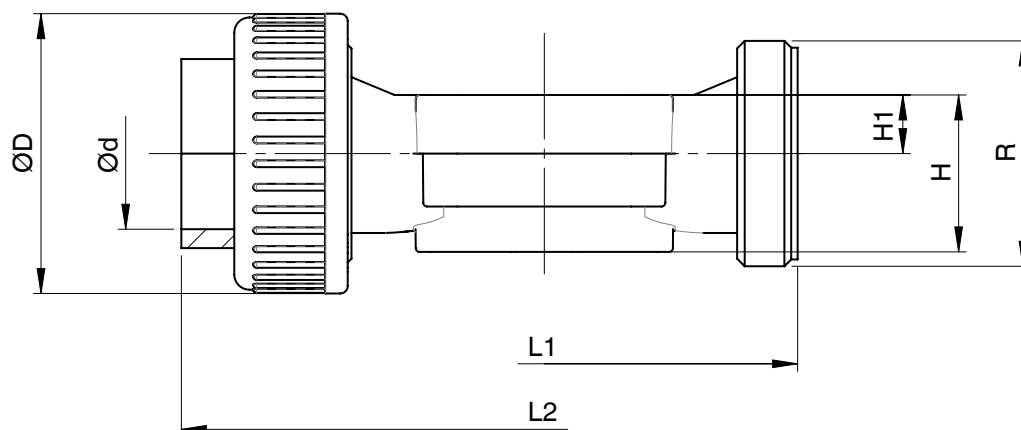

Connection type union end DIN (code 7)<sup>1)</sup>, body material PVC-U (code 1), PP (code 5), PVDF (code 20), PP-H (code N5)<sup>2)</sup>, diaphragm size 10

MG	DN	NPS	ød	øD	H		H1		L1	L2		R
					Material		Material			Material		
					1, 20	5, N5	1, 20	5, N5		1, 20	5, N5	
10	15	1/2"	20.0	43.0	30.0	41.0	15.0	16.0	90.0	128.0	125.0	G 1

Connection type union end DIN (code 7)<sup>1)</sup>, body material PVC-U (code 1), ABS (code 4), inliner/outliner (code 71, 75)<sup>2)</sup>, diaphragm size 20 – 40

MG	DN	NPS	ød	øD	H	H1	L1	L2				R
								Material				
								1	4	71	75	
20	15	1/2"	20.0	43.0	36.0	10.0	108.0	146.0	150.0	143.0	146.0	G 1
	20	3/4"	25.0	53.0	38.0	12.0	108.0	152.0	156.0	146.0	150.0	G 1¼
	25	1"	32.0	60.0	39.0	13.0	116.0	166.0	170.0	158.0	162.0	G 1½
25	32	1¼"	40.0	74.0	41.0	15.0	134.0	192.0	196.0	181.0	184.0	G 2
40	40	1½"	50.0	83.0	63.2	23.2	154.0	222.0	222.0	207.0	210.0	G 2¼
	50	2"	63.0	103.0	63.2	23.2	184.0	266.0	266.0	245.0	248.0	G 2¾

Dimensions in mm

MG = diaphragm size

#### 1) Connection type

Code 7: Union end with insert (socket) – DIN

#### 2) Valve body material

Code 1: PVC-U, grey

Code 4: ABS


Code 5: PP, reinforced

Code 20: PVDF

Code 71: Inliner PP-H, grey, outliner PP, reinforced

Code 75: Inliner PVDF/outliner PP, reinforced

Code N5: PP-H, natural

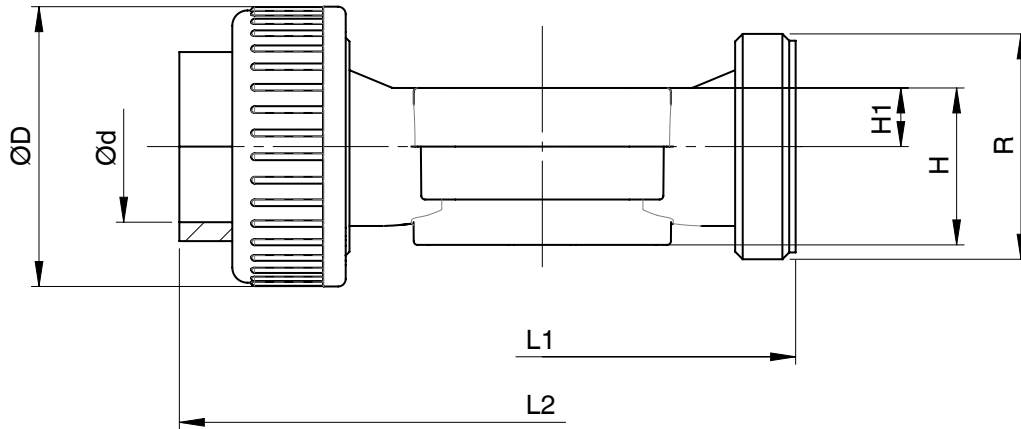**8.2.5 Union end inch (code 33, 3M, 3T)****Connection type union end inch (code 33)<sup>1)</sup>, body material PVC-U (code 1)<sup>2)</sup>, diaphragm size 10**

MG	DN	NPS	ød	øD	H	H1	L1	L2	R
10	15	1/2"	21.4	43.0	30.0	15.0	90.0	128.0	G1

**Connection type union end inch (code 33, 3M, 3T)<sup>1)</sup>, body material PVC-U (code 1)<sup>2)</sup>, diaphragm sizes 20 - 40**

MG	DN	NPS	ød			øD		H	H1	L1	L2			R	
			Connection type								Connection type				
			33	3M	3T	33, 3M	3T				33	3M	3T	33, 3M	3T
20	15	1/2"	21.4	21.4	22.0	43.0	53.0 *	36.0	10.0	108.0	146.0	158.0	152.0	G 1	G 1¼ *
	20	3/4"	26.8	26.7	26.0	53.0	53.0	38.0	12.0	108.0	152.0	164.0	152.0	G 1¼	G 1¼
	25	1"	33.6	33.5	32.0	60.0	60.0	39.0	13.0	116.0	166.0	180.0	166.0	G 1½	G 1½
25	32	1¼"	42.3	42.2	38.0	74.0	74.0	41.0	15.0	134.0	192.0	204.0	192.0	G 2	G 2
40	40	1½"	48.3	48.3	48.0	83.0	83.0	63.2	23.2	154.0	222.0	230.0	222.0	G 2¼	G 2¼
	50	2"	60.4	60.4	60.0	103.0	103.0	63.2	23.2	184.0	264.0	266.0	266.0	G 2¾	G 2¾

**Connection type BS (code 33)<sup>1)</sup>, body material ABS (code 4)<sup>2)</sup>**

MG	DN	NPS	ød	øD	H	H1	L1	L2	R
20	15	1/2"	21.4	43.0	36.0	10.0	108.0	150.0	G 1
	20	3/4"	26.8	53.0	38.0	12.0	108.0	156.0	G 1¼
	25	1"	33.6	60.0	39.0	13.0	116.0	170.0	G 1½
25	32	1¼"	42.3	74.0	41.0	15.0	134.0	198.0	G 2
40	40	1½"	48.3	83.0	63.2	23.2	154.0	220.0	G 2¼
	50	2"	60.4	103.0	63.2	23.2	184.0	264.0	G 2¾

Dimensions in mm

MG = diaphragm size

\* Insert requires valve body DN 20

**1) Connection type**

Code 33: Union end with inch insert – BS (socket)

Code 3M: Union end with inch insert – ASTM (socket)


Code 3T: Union end with insert – JIS (socket)

**2) Valve body material**

Code 1: PVC-U, grey

Code 4: ABS

### 8.2.6 Union end DIN, IR butt welding (code 78)

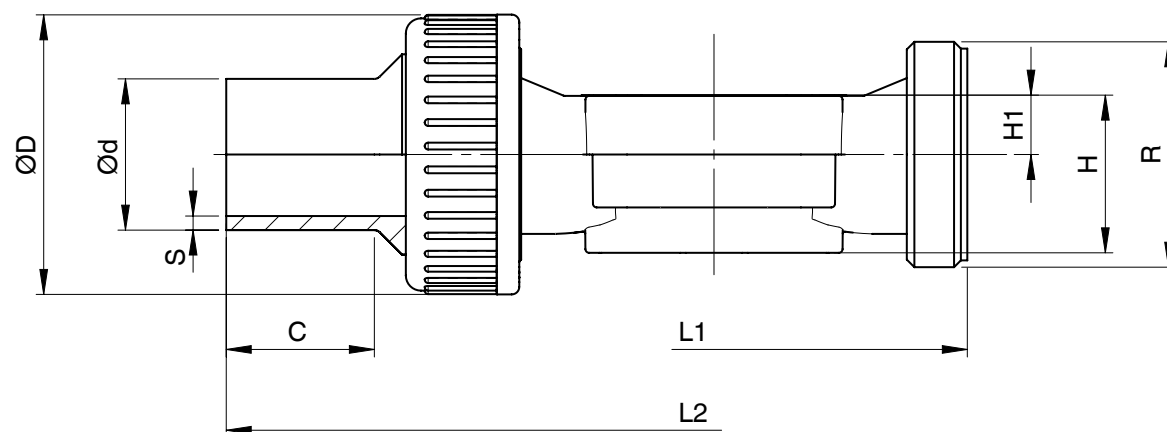

Connection type union end DIN, IR butt welding (code 78)<sup>1)</sup>, body materials PP (code 5), PVDF (code 20), PP-H (code N5)<sup>2)</sup>

MG	DN	NPS	c	ød	øD	H		H1		L1	L2	R	s
						Material		Material					
						5	20, N5	5	20, N5				
10	15	1/2"	36.0	20.0	42.0	30.0	41.0	15.0	16.0	90.0	196.0	G 1	1.9

Connection type union end DIN, IR butt welding (code 78)<sup>1)</sup>, body material inliner/outliner (code 71, 75)<sup>2)</sup>

MG	DN	NPS	c	ød	øD	H	H1	L1	L2	R	s	
											Material	
											71	75
20	15	1/2"	36.0	20.0	43.0	36.0	10.0	108.0	214.0	G 1	1.9	1.9
	20	3/4"	37.0	25.0	53.0	38.0	12.0	108.0	220.0	G 1¼	2.3	1.9
	25	1"	39.0	32.0	60.0	39.0	13.0	116.0	234.0	G 1½	2.9	2.4
25	32	1¼"	39.0	40.0	74.0	41.0	15.0	134.0	258.0	G 2	3.7	2.4
40	40	1½"	43.0	50.0	83.0	63.2	23.2	154.0	284.0	G 2¼	4.6	3.0
	50	2"	43.0	63.0	103.0	63.2	23.2	184.0	320.0	G 2¾	5.8	3.0

Dimensions in mm

MG = diaphragm size

#### 1) Connection type

Code 78: Union end with insert (for IR butt welding) – DIN

#### 2) Valve body material


Code 5: PP, reinforced

Code 20: PVDF

Code 71: Inliner PP-H, grey, outliner PP, reinforced

Code 75: Inliner PVDF/outliner PP, reinforced

Code N5: PP-H, natural

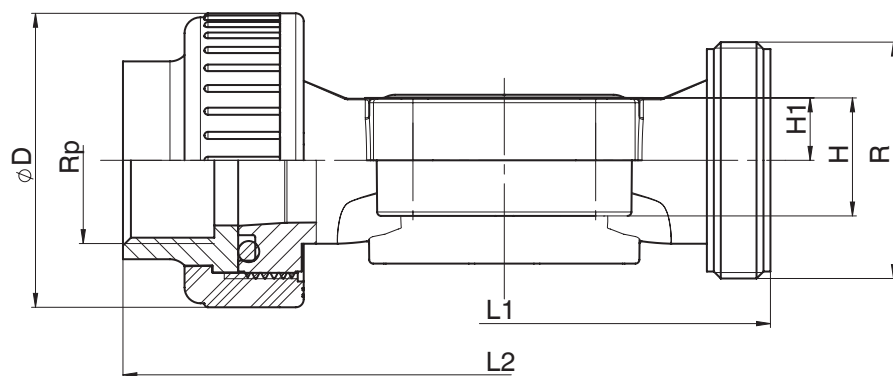**8.2.7 Union end Rp (code 7R)****Connection type union end Rp (code 7R) <sup>1)</sup>, body material PVC-U (code 1) <sup>2)</sup>**

MG	DN	NPS	$\varnothing D$	H	H1	L1	L2	R	Rp
<b>20</b>	<b>15</b>	<b>1/2"</b>	43.0	36.0	10.0	108.0	146.0	G 1	1/2
	<b>20</b>	<b>3/4"</b>	53.0	38.0	12.0	108.0	152.0	G 1 1/4	3/4
	<b>25</b>	<b>1"</b>	60.0	39.0	13.0	116.0	166.0	G 1 1/2	1
<b>25</b>	<b>32</b>	<b>1 1/4"</b>	74.0	41.0	15.0	134.0	192.0	G 2	1 1/4
<b>40</b>	<b>40</b>	<b>1 1/2"</b>	83.0	63.2	23.2	154.0	222.0	G 2 1/4	1 1/2
	<b>50</b>	<b>2"</b>	103.0	63.2	23.2	184.0	266.0	G 2 3/4	2


Dimensions in mm

**1) Connection type**

Code 7R: Union end with insert (Rp threaded socket) – DIN

**2) Valve body material**

Code 1: PVC-U, grey

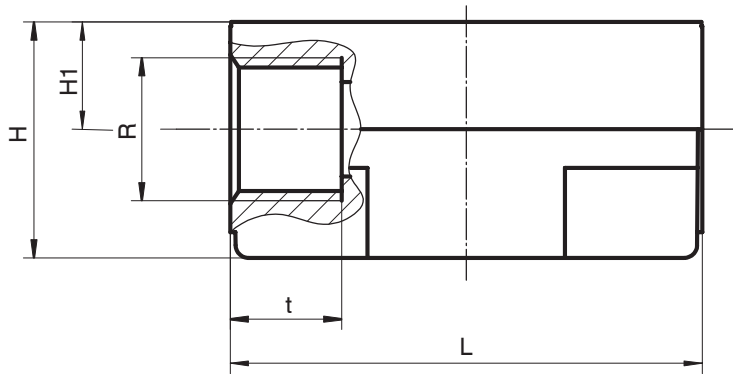**8.2.8 Threaded socket (code 1)****Connection type threaded socket (code 1)<sup>1)</sup>, body materials PVC-U (code 1), PP (code 5), PVDF (code 20)<sup>2)</sup>**

MG	DN	NPS	H		H1	L	R	t
			Material					
			1, 5	20				
10	12	3/8"	27.5	31.5	12.5	55.0	G3/8	13.0

Dimensions in mm

MG = diaphragm size

**1) Connection type**


Code 1: Threaded socket DIN ISO 228

**2) Valve body material**

Code 1: PVC-U, grey

Code 5: PP, reinforced

Code 20: PVDF

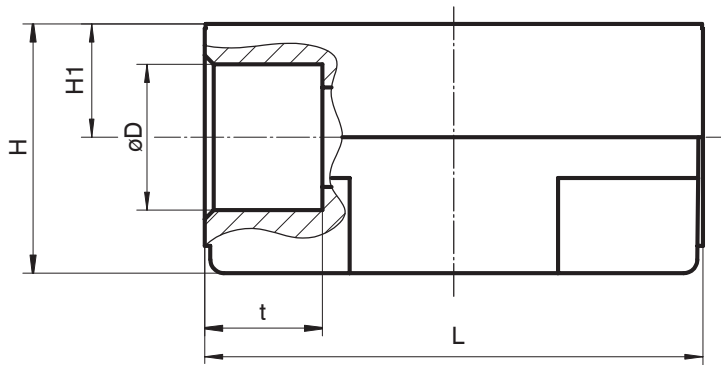**8.2.9 Solvent cement socket (code 2)****Connection type solvent cement socket (code 2)<sup>1)</sup>, body material PVC-U (code 1)<sup>2)</sup>**

MG	DN	NPS	ø D	H	H1	L	t
10	12	3/8"	16.0	27.5	12.5	55.0	13.0

Dimensions in mm


MG = diaphragm size

**1) Connection type**

Code 2: Solvent cement socket DIN

**2) Valve body material**

Code 1: PVC-U, grey

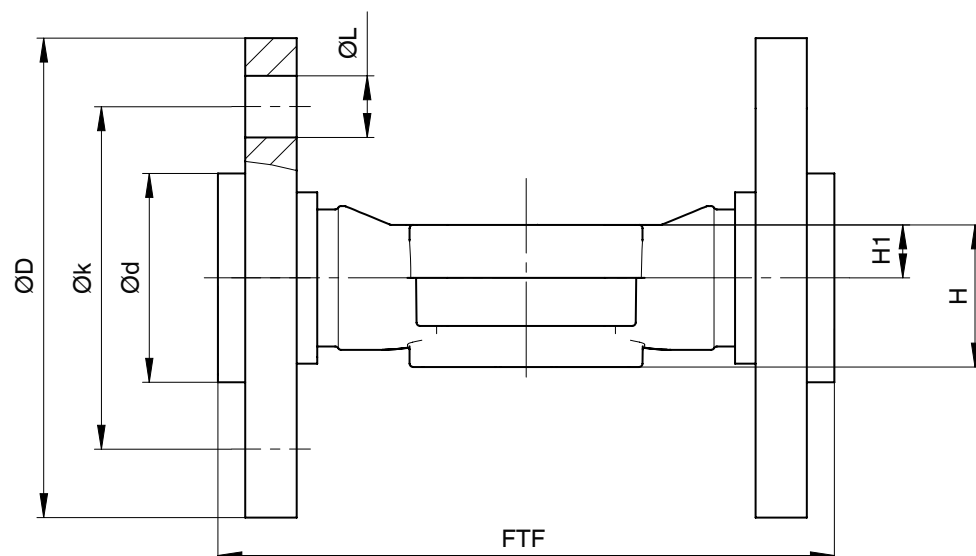**8.2.10 Flange EN (code 4)****Connection type flange EN (code 4)<sup>1)</sup>, body materials PVC-U (code 1)<sup>2)</sup>**

MG	DN	NPS	ød	øD	FTF	H	H1	øk	øL	n
20	15	1/2"	34.0	95.0	130.0	36.0	10.0	65.0	14.0	4
	20	3/4"	41.0	105.0	150.0	38.0	12.0	75.0	14.0	4
	25	1"	50.0	115.0	160.0	39.0	13.0	85.0	14.0	4
25	32	1¼"	61.0	140.0	180.0	41.0	15.0	100.0	18.0	4
40	40	1½"	73.0	150.0	200.0	63.2	23.2	110.0	18.0	4
	50	2"	90.0	165.0	230.0	63.2	23.2	125.0	18.0	4

**Connection type flange EN (code 4)<sup>1)</sup>, body material inliner/outliner (code 71, 75)<sup>2)</sup>**

MG	DN	NPS	ød	øD	FTF	H	H1	øk	øL	n
20	15	1/2"	45.0	95.0	130.0	36.0	10.0	65.0	14.0	4
	20	3/4"	58.0	105.0	150.0	38.0	12.0	75.0	14.0	4
	25	1"	68.0	115.0	160.0	39.0	13.0	85.0	14.0	4
25	32	1¼"	78.0	140.0	180.0	41.0	15.0	100.0	18.0	4
40	40	1½"	88.0	150.0	200.0	63.2	23.2	110.0	18.0	4
	50	2"	102.0	165.0	230.0	63.2	23.2	125.0	18.0	4

Dimensions in mm

MG = diaphragm size

n = number of bolts

**1) Connection type**

Code 4: Flange EN 1092, PN 10, form B, face-to-face dimension FTF EN 558 series 1, ISO 5752, basic series 1


**2) Valve body material**

Code 1: PVC-U, grey

Code 71: Inliner PP-H, grey, outliner PP, reinforced

Code 75: Inliner PVDF/outliner PP, reinforced

### 8.2.11 Flange ANSI (code 39)

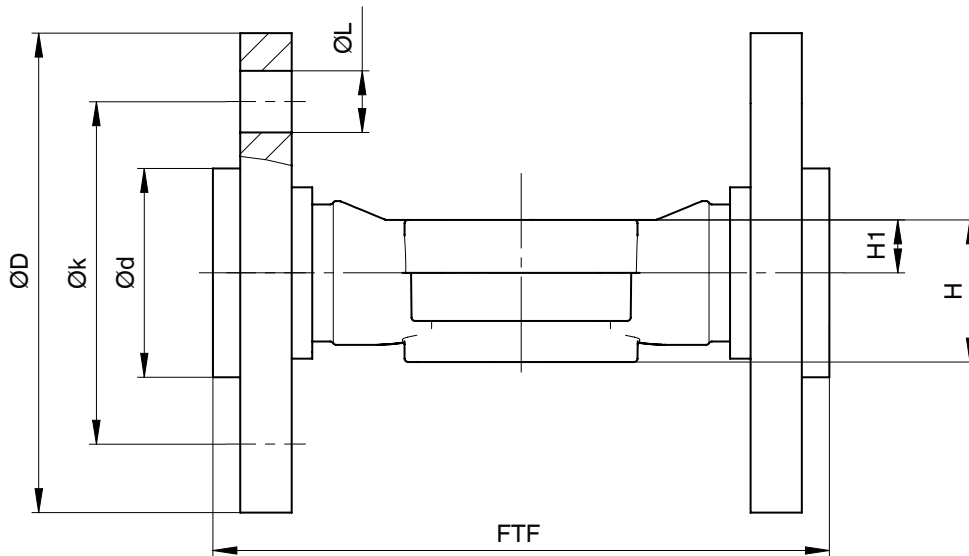

Connection type flange ANSI (code 39)<sup>1)</sup>, body material PVC-U (code 1)<sup>2)</sup>

MG	DN	NPS	ød	øD	FTF	H	H1	øk	øL	n
20	15	1/2"	34.0	95.0	130.0	36.0	10.0	60.0	16.0	4
	20	3/4"	41.0	105.0	150.0	38.0	12.0	70.0	16.0	4
	25	1"	50.0	115.0	160.0	39.0	13.0	79.0	16.0	4
25	32	1¼"	61.0	140.0	180.0	41.0	15.0	89.0	16.0	4
40	40	1½"	73.0	150.0	200.0	63.2	23.2	98.0	16.0	4
	50	2"	90.0	165.0	230.0	63.2	23.2	121.0	19.0	4

Connection type flange ANSI (code 39)<sup>1)</sup>, body material inliner/outliner (code 71, 75)<sup>2)</sup>

MG	DN	NPS	ød	øD	FTF	H	H1	øk	øL	n
20	15	1/2"	45.0	95.0	130.0	36.0	10.0	60.0	16.0	4
	20	3/4"	54.0	105.0	150.0	38.0	12.0	70.0	16.0	4
	25	1"	63.0	115.0	160.0	39.0	13.0	79.0	16.0	4
25	32	1¼"	73.0	140.0	180.0	41.0	15.0	89.0	16.0	4
40	40	1½"	82.0	150.0	200.0	63.2	23.2	98.0	16.0	4
	50	2"	102.0	165.0	230.0	63.2	23.2	121.0	19.0	4

Dimensions in mm

MG = diaphragm size

n = number of bolts

#### 1) Connection type


Code 39: Flange ANSI Class 125/150 RF, face-to-face dimension FTF EN 558 series 1, ISO 5752, basic series 1, length only for body configuration D

#### 2) Valve body material

Code 1: PVC-U, grey

Code 71: Inliner PP-H, grey, outliner PP, reinforced

Code 75: Inliner PVDF/outliner PP, reinforced

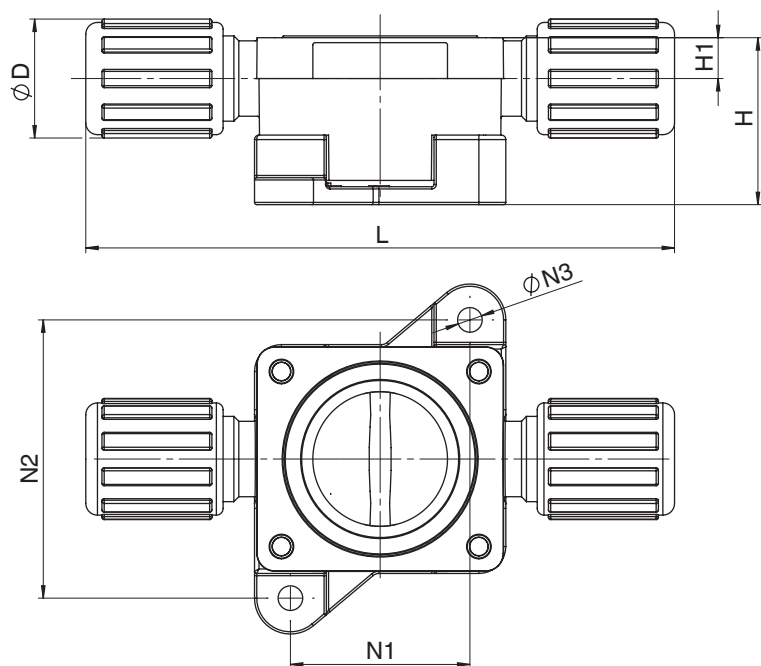**8.2.12 Flare (code 75)****Connection type flare (code 75)<sup>1)</sup>, body material PP-H (code N5)<sup>2)</sup>**

MG	DN	NPS	ØD	H	H1	L	N1	N2	ØN3
10	15	1/2"	26.5	38.1	10.0	132.0	40.0	62.0	5.5
	20	3/4"	26.5	44.5	15.0	134.0	40.0	62.0	5.5

Dimensions in mm


MG = diaphragm size

**1) Connection type**

Code 75: Flare connection with PVDF union nut

**2) Valve body material**

Code N5: PP-H, natural

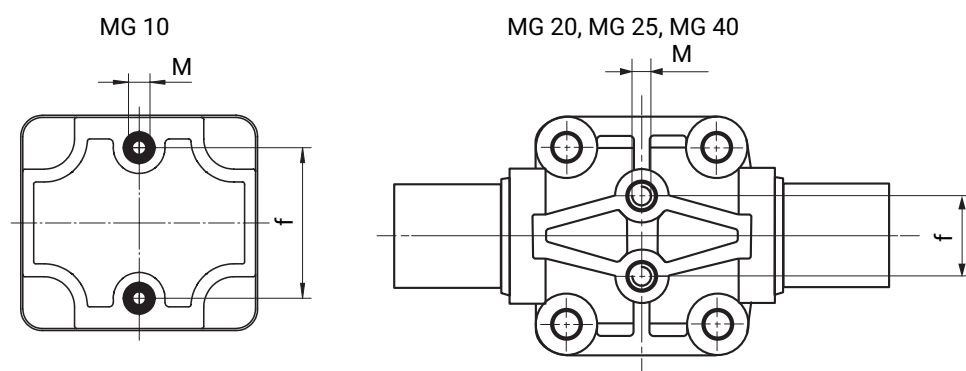
**8.3 Valve body mounting**

Diaphragm size	Nominal size	M	f
MG 10	DN 10 - 20	M5	35.0
MG 20	DN 15 - 25	M6	25.0
MG 25	DN 32	M6	25.0
MG 40	DN 40, DN 50	M8	44.5

Dimensions in mm

MG = diaphragm size

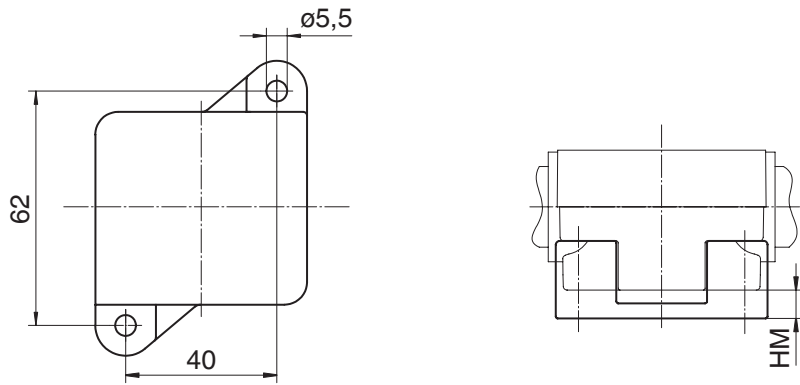

**8.4 Mounting plate**

MG	DN	HM
10	12	5.0
	15	4.5
	20	4.5

Dimensions in mm, MG = diaphragm size

## 9 Manufacturer's information

### 9.1 Delivery

- Check that all parts are present and check for any damage immediately upon receipt.

The product's performance is tested at the factory. The scope of delivery is apparent from the dispatch documents and the design from the order number.

### 9.2 Packaging

The product is packaged in a cardboard box which can be recycled as paper.

### 9.3 Transport

1. Only transport the product by suitable means. Do not drop. Handle carefully.
2. After the installation dispose of transport packaging material according to relevant local or national disposal regulations / environmental protection laws.

### 9.4 Storage

1. Store the product free from dust and moisture in its original packaging.
2. Avoid UV rays and direct sunlight.
3. Do not exceed the maximum storage temperature (see chapter "Technical data").
4. Do not store solvents, chemicals, acids, fuels or similar fluids in the same room as GEMÜ products and their spare parts.

## 10 Installation in piping

### 10.1 Preparing for installation

#### **WARNING**

##### **The equipment is subject to pressure!**

- Risk of severe injury or death
- Depressurize the plant.
- Completely drain the plant.

#### **WARNING**



##### **Corrosive chemicals!**

- Risk of caustic burns
- Wear appropriate protective gear.
- Completely drain the plant.

#### **CAUTION**



##### **Hot plant components!**

- Risk of burns
- Only work on plant that has cooled down.

#### **CAUTION**

##### **Exceeding the maximum permissible pressure!**

- Damage to the product
- Provide precautionary measures against exceeding the maximum permitted pressures caused by pressure surges (water hammer).

#### **CAUTION**

##### **Use as step!**

- Damage to the product
- Risk of slipping-off
- Choose the installation location so that the product cannot be used as a foothold.
- Do not use the product as a step or a foothold.

#### **NOTICE**

##### **Suitability of the product!**

- The product must be appropriate for the piping system operating conditions (medium, medium concentration, temperature and pressure) and the prevailing ambient conditions.

## NOTICE

### Tools!

- The tools required for installation and assembly are not included in the scope of delivery.
- Use appropriate, functional and safe tools.

1. Ensure the product is suitable for the relevant application.
2. Check the technical data of the product and the materials.
3. Keep appropriate tools ready.
4. Wear appropriate protective gear, as specified in the plant operator's guidelines.
5. Observe appropriate regulations for connections.
6. Have installation work carried out by trained personnel.
7. Shut off plant or plant component.
8. Secure plant or plant component against recommissioning.
9. Depressurize the plant or plant component.
10. Completely drain the plant (or plant component) and let it cool down until the temperature is below the media vaporization temperature and cannot cause scalding.
11. Correctly decontaminate, rinse and ventilate the plant or plant component.
12. Lay piping so that the product is protected against transverse and bending forces, and also from vibrations and tension.
13. Only install the product between matching aligned pipes (see chapters below).

### 10.2 Installation position

The installation position of the product is optional.

### 10.3 Installation with butt weld spigots

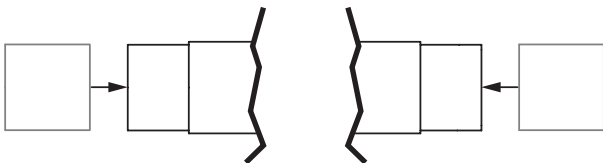


Fig. 1: Butt weld spigots

1. Carry out preparations for installation (see chapter "Preparing for installation").
2. Adhere to good welding practices!
3. Disassemble the actuator with the diaphragm before welding in the valve body (see "Removing the actuator" chapter).
4. Weld the body of the product in the piping.
5. Allow butt weld spigots to cool down.
6. Reassemble the valve body and the actuator with diaphragm (see "Mounting the actuator" chapter).
7. Re-attach or reactivate all safety and protective devices.
8. Flush the system.

### 10.4 Installation with threaded sockets

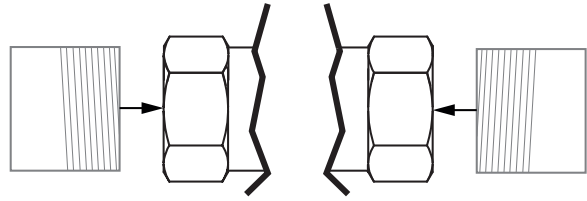


Fig. 2: Threaded socket

## NOTICE

### Sealing material

- The sealing material is not included in the scope of delivery.
- Only use appropriate sealing material.

1. Keep thread sealant ready.
2. Carry out preparations for installation (see chapter "Preparing for installation").
3. Screw the threaded connections into the pipe in accordance with valid standards.
4. Screw the body of the product onto the piping using appropriate thread sealant.
5. Re-attach or reactivate all safety and protective devices.

### 10.5 Installation with union ends

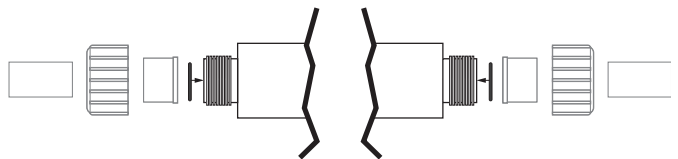


Fig. 3: Union end with insert

## NOTICE

- The solvent cement is not included in the scope of delivery.
- Only use suitable solvent cement!

1. Carry out preparations for installation (see chapter "Preparing for installation").
2. Depending on the application, comply with the welding standards and the specifications of the solvent cement manufacturer for adhesive bonds.
3. Screw the threaded connections into the piping in accordance with valid standards.
4. Unscrew the union nut from the body of the product.
5. Reinsert the O-ring if necessary.
6. Push the union nut over the piping.
7. Connect the insert with the piping by solvent cementing/welding.
8. Screw the union nut back onto the body of the product.
9. Connect the other side of the body of the product with the piping in the same way.
10. Reactivate all safety and protective devices.

### 10.6 Installation with solvent cement sockets

#### NOTICE

- ▶ The solvent cement is not included in the scope of delivery.
  - Only use suitable solvent cement!
1. Carry out preparations for installation (see chapter "Preparations for installation").
  2. Apply solvent cement on the inside of the valve body and on the outside of the piping as specified by the solvent cement manufacturer.
  3. Connect the body of the product with the piping.
  4. Reactivate all safety and protective devices.

### 10.7 Installation with flare connection

#### NOTICE

##### Fittings!

- ▶ For preparation and connection of the flare connections, please refer to the GEMÜ FlareStar® brochure and the GEMÜ flare and assembly instructions.
  - Depending on the ambient conditions, use resistant and suitable connection fittings.
1. Carry out preparations for installation (see chapter "Preparations for installation").
  2. Push the flared PFA tubing onto the flare fitting body.
  3. Screw the union nut over it.
  4. Re-attach or reactivate all safety and protective devices.


## 11 Specific data IO-Link (pin 6)

IO-Link process data and parameters can be set via pin 6 for the motorized linear actuator eSyStep. The assignment of the connectors and the current consumption of the actuator are non-compliant with the IO-Link specification.

### 11.1 Operation on IO-Link

#### 11.1.1 Operation on PLC as a 24 V device

The motorized actuator GEMÜ eSyStep can be operated directly in a PLC control unit without limitations. Technical data of the product and of PLC must be complied with.

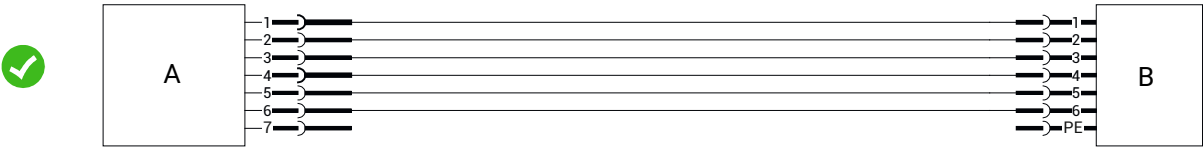

Item	Name
A	eSyStep
B	PLC with supply voltage

#### 11.1.2 Operation on PLC and additional parameterization via USB master with galvanic isolation


##### Basics

When operating the product on a PLC control unit, a parameterization via a USB IO-Link master is possible at the same time. In this case, a galvanically isolated USB interface must be used. The PC/laptop can be used as usual and all peripheral devices can remain connected.

##### Connection

1. Connect **pin 3 (L-)** of the master with **pin 2 (GND)** of the product.
2. Connect **pin 4 (CQ)** of the master with **pin 6** of the product.

During IO-Link operation, pin 6 **cannot** be evaluated by the PLC control unit as an output signal.

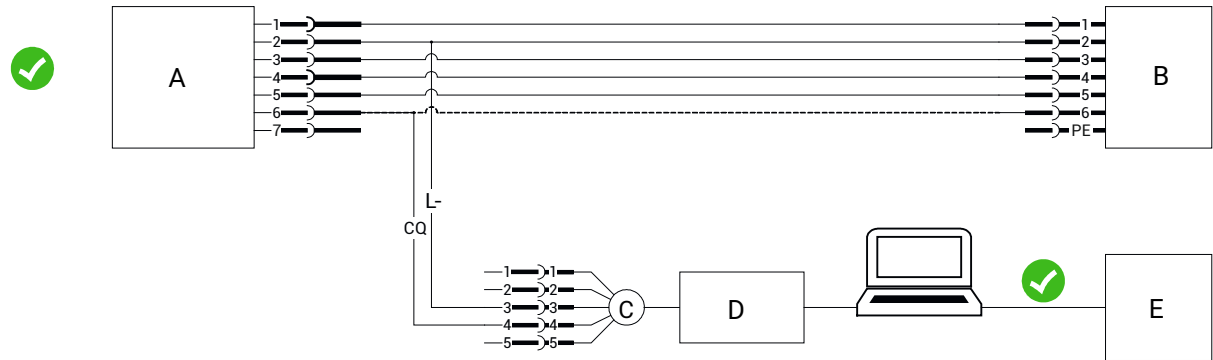

Item	Name
A	eSyStep
B	PLC with supply voltage
C	USB IO-Link Master
D	Galvanically isolated USB interface
E	Mains plug – laptop

11.1.3 Operation on PLC and additional parameterization via USB master without galvanic isolation


Basics

Only one laptop can be used if no galvanic isolation is available for the USB interface during communication via a USB IO-Link master. No other peripheral devices may be connected to the laptop. The laptop may only be operated without a power supply unit.

If further peripheral devices and the power supply unit are not disconnected, different ground potentials to the product can result in excessive compensating currents. These can damage the USB interface of the laptop, the connected peripheral devices or the USB IO-Link master.

Connection

- 1. Connect **pin 3 (L-)** of the master with **pin 2 (GND)** of the product.
  - 2. Connect **pin 4 (CQ)** of the master with **pin 6** of the product.
- During IO-Link operation, pin 6 **cannot** be evaluated by the PLC control unit as an output signal.

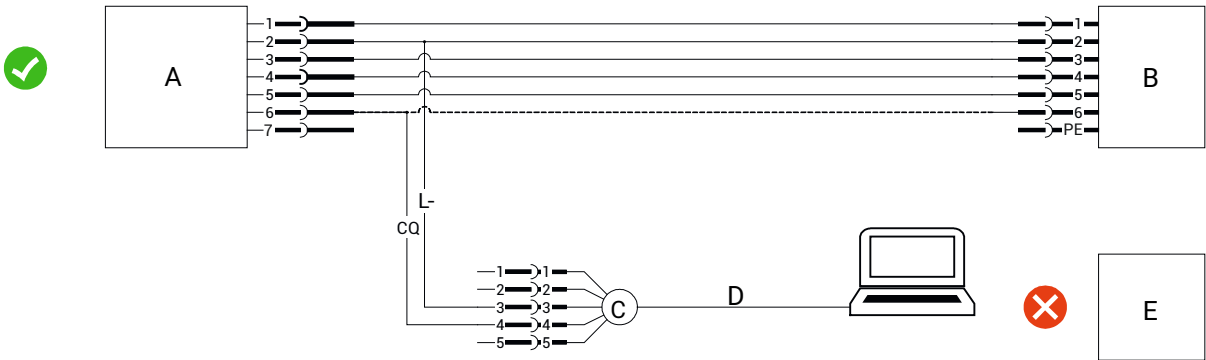

Item	Name
A	eSyStep
B	PLC with supply voltage
C	USB IO-Link Master
D	USB interface
E	Mains plug – laptop

### 11.1.4 Direct operation on the IO-Link master

#### Basics

If the product is to be operated on an IO-Link master, it must be ensured that the **GND** levels in the product and in the IO-Link master have the same potential so that there are no compensating currents which would cause damage in the system. This can be made possible using several procedures.


#### 11.1.4.1 Identical power supply

The IO-Link master is operated from the same power supply as the product.

- Connect **pin 4 (CQ)** of the master with **pin 6** of the product.

However, **pin 3 (L-)** of the master should **not** be connected to **pin 2 (GND)** of the product under any circumstances.

This prevents a ground loop and no unexpected high currents can occur via **pin 3 (L-)** which can damage the master.

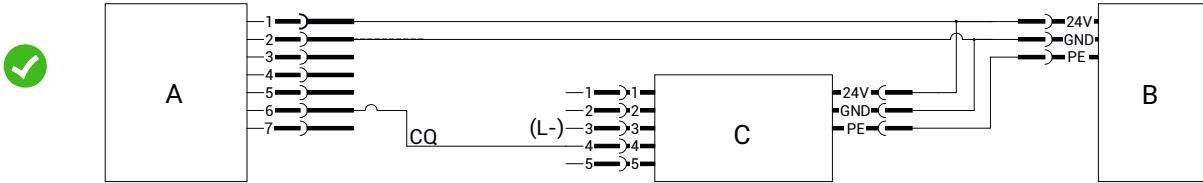


Item	Name
A	eSyStep
B	Supply voltage
C	USB IO-Link Master

#### 11.1.4.2 Separate power supply, GND-connected

The IO-Link master and the product can also be operated with different power supply sources if the **GND** of both power supply sources is connected. In this case, the master is connected as when the power supply is identical

- Connect **pin 4 (CQ)** IO-Link master with **pin 6** of the product.

Do **not** connect (**pin 3**) L- IO-Link master.

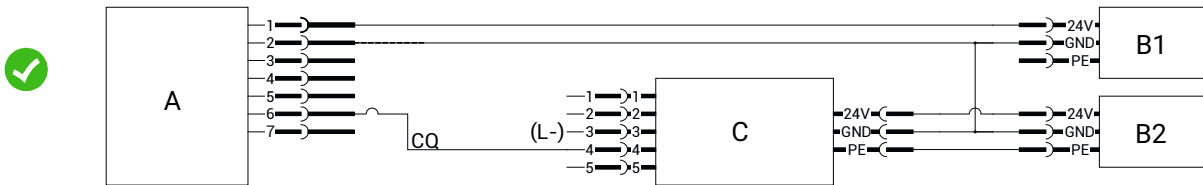

Item	Name
A	eSyStep
B1 and B2	Supply voltages
C	USB IO-Link Master

## 11.2 Process data

The motorized linear actuator has access to process data via the IO-Link. This is transmitted in cycles with every IO-Link telegram.

### Master → Device

Name	Bit	Values
Drive go Open	0	0 → Actuator does not move into position Open
		1 → Actuator moves into position Open
Drive go Close	1	0 → Actuator does not move into position Closed
		1 → Actuator moves into position Closed
Start initialization	2	0 → No initialization
		1 → Start initialization
Locate	3	0 → Off
		1 → On
Setpoint analog	8 ... 23	Setpoint in the range 0 ... 1000

### Device → Master

Name	Bit	Values
Valve position Open	0	0 → Process valve not in Open position
		1 → Process valve in Open position
Valve position Close	1	0 → Process valve not in Closed position
		1 → Process valve in Closed position
Operating mode	2	0 → Normal operation
		1 → Initialization mode
Valve position analog	8 ... 23	Position of the valve in the range 0 ... 1000



### 11.3 Parameter overview

#### NOTICE

► All IO-Link parameters that contain sub-indexes can also be addressed in bundles via sub-index 0.

Index	Sub-Index	Access rights	Index name	Parameter	Function	Default settings	Setting options
0x02	0	W	System command		Transmission of commands for block parameterization and data storage		0x01 to 0x06 0x82
0x03	1	R/W	Data storage index	Data storage cmd	Saving and restoring parameter data for device identical in construction		
	2	RO		State property			
	3	RO		Data storage size			
	4	RO		Parameter checksum			
	5	RO		Index list			
0x0C	1	R/W	Device access locks	Parameter (write) access	Parameter write protection		0 → unlocked 1 → locked
	2	R/W		Data storage	Data memory		0 → unlocked 1 → locked
	3	R/W		Local parameterization	Local parameterization		0 → unlocked 1 → locked
	4	R/W		Local user interface	Local user interface		0 → unlocked 1 → locked
0x0D	0	RO	Profile characteristics		Supported Device Profile IDs, Common Application Profile IDs, Function Class IDs		0x8000 (Device Ident. Objects) 0x8002 (Process Data Mapping) 0x8003 (Diagnosis) 0x8100 (Ext. Identification)
0x0E	0	RO	Process data input descriptor		Data format of input process data		0x00 (Bit offset) 0x03 (Type Length) 0x01 (DataType -> BoolT)
0x0F	0	RO	Process data output descriptor		Data format of output process data		0x00 (Bit offset) 0x04 (Type Length) 0x01 (DataType -> BoolT)
0x10	0	RO	Vendor name		Read out manufacturer name		"GEMUE"
0x12	0	RO	Product name		Read out device name		"eSyStep Positioner"
0x13	0	RO	Product ID		Read out product ID		"eSyStep Positioner"
0x15	0	RO	Serial number		Read out serial number		"XXXXXXXX/YYYY"
0x16	0	RO	Hardware revision		Read out hardware version		"Rev. XX/XX"
0x17	0	RO	Firmware revision		Read out software version		"V X.X.X.X."

Index	Sub-Index	Access rights	Index name	Parameter	Function	Default settings	Setting options
0x18	0	R/W	Application specific tag		Text with 32 characters can be entered		*****"
0x19	0	R/W	Function tag		Text with 32 characters can be entered		*****"
0x1A	0	R/W	Location tag		Text with 32 characters can be entered		*****"
0x24	0	RO	Device status		(Simple) device status		0 → Operating properly 2 → Out of specification 4 → Failure
0x25	0	RO	Device status		Detailed device status		
0x40	0	RO	Actuator size		Read out actuator size	Depending on the actuator size used	0 → Actuator size 0 1 → Actuator size 1 2 → Actuator size 2
0x4B	1	R/W	Function digital inputs	Input 1	Configure digital input 1	4	0 → Off 1 → Open 2 → Close 3 → Safe/On 4 → Init
	2	R/W		Input 2	Configure digital input 2	0	0 → Off 1 → Open 2 → Close 3 → Safe/On 4 → Init
0x4C	1	R/W	Function digital in-/output 1	In- / output 1	Configure digital inputs/outputs	2	0 → Output open 1 → Output close 2 → Output error 3 → Output Error & warning 4 → Input init
	2	R/W		Type in- / output 1	Configure type of digital inputs/outputs	0	0 → Push-pull 1 → NPN 2 → PNP
0x4D	0	R/W	Function digital output 2		Configure digital output	1	0 → Output open 1 → Output close 2 → Output error 3 → Output error & warning
0x4E	1	R/W	Logic digital inputs / outputs	Input 1	Configure logical digital input 1	0	0 → Active high 1 → Active low
	2	R/W		Input 2	Configure logical digital input 2	0	0 → Active high 1 → Active low
	3	R/W		Input / output 1	Configure logical digital input/output	0	0 → Active high 1 → Active low
	4	R/W		Output 2	Configure logical digital output	0	0 → Active high 1 → Active low

Index	Sub-Index	Access rights	Index name	Parameter	Function	Default settings	Setting options
0x4F	1	R/W	Error action	Error action	Set safety position	2	0 → Hold 1 → Open 2 → Close
	2	R/W		Error time	Determine time from error detection to error message	1 (0.1s)	1 ... 1000 (0.1s ... 100s)
0x50	1	R/W	Basic settings	Inversion of LED colours	Activate / deactivate inversion of LEDs	0	0 → Standard 1 → Inversed
	2	R/W		On site initialization	Activate / deactivate on site initialization	0	0 → Enabled 1 → Disabled
	3	R/W		Operating mode	Operating mode change-over (positioner; ON/OFF)	0	0 → Positioner 1 → On/Off
	4	R/W		IO-Link process data	Activate/deactivate use of IO-Link process data	0	0 → Disabled 1 → Enabled
0x51	1	R/W	Actuator position feedback	Open request	Request valve position OPEN	900 (90.0%)	30 ... 970 (3.0 ... 97.0%)
	2	R/W		Close request	Request valve position CLOSED	100 (10.0%)	30 ... 970 (3.0 ... 97.0%)
	3	RO		Open real	Real valve position OPEN		0 ... 4095
	4	RO		Close real	Real valve position CLOSED		0 ... 4095
0x53	1	RO	Initialized positions	Open	Analog value valve position OPEN		0 ... 4095
	2	RO		Close	Analogue value valve position CLOSED		0 ... 4095
	3	RO		Stroke	Read out the analog value for stroke (difference between OPEN and CLOSED).		0 ... 4095
0x55	1	RO	Calibrated positions	Max.	OPEN end position		0 ... 4095
	2	RO		Min.	CLOSED end position		0 ... 4095
0x60	1	RO	Analog values	Potentiometer	Analog value potentiometer		0 ... 4095
	2	RO		Supply voltage	Analog value supply voltage		0 ... 4095
	3	RO		Temperature	Analog value temperature sensor		0 ... 4095
	4	RO		Set value (W)	Analog value set value signal		0 ... 4095
0x62	1	RO	Operating times	Open	Operating time OPEN	0	0 to 255 (0 to 25.5s)
	2	RO		Close	Operating time CLOSE	0	0 to 255 (0 to 25.5s)
0x90	2	R/W	Drive sets	Force	Force, dependent on valve used		1 ... 6

Index	Sub-Index	Access rights	Index name	Parameter	Function	Default settings	Setting options
	3	R/W		Force initialization	Force during initialization, dependent on valve used		1 ... 6
0xB0	1	R/W	Control parameters	P amplification	P component – positioner	200	1 ... 200 (0.1 ... 20.0)
	2	R/W		D amplification	D component – positioner	10	1 ... 200 (0.1 ... 20.0)
	3	R/W		Derivative time	Delay constant	0	0 to 100 (0 to 100 s)
	4	R/W		Dead band	Permissible system deviation	10	1 ... 250 (0.1 ... 25.0 %)
0xB2	1	R/W	Open / close tight	Open tight	Sealing function valve position OPEN	995	800 ... 1000 (80.0 ... 100.0 %)
	2	R/W		Close tight	Sealing function valve position CLOSED	5	0 ... 200 (0 ... 20.0 %)
0xB4	1	R/W	Split range	Split start	Set set value start	0	0 to Split End – 100 (0.0 to Split End – 10.0%)
	2	R/W		Split end	Set set value end	1000	Split Start + 100 to 1000 (Split Start + 10.0% to 100.0%)
0xB6	1	R/W	Stroke limiter	Max pos	Stroke limiter valve position OPEN	1000	Min Pos to 1000 (Min Pos to 100.0%)
	2	R/W		Min pos	Stroke limiter valve position CLOSED	0	0 to Max Pos (0.0% to Max Pos)
0xB8	1	R/W	Set value (W) input	Direction	Set value direction set value input	0	0 → Rise (rising) 1 → Fall (falling)
	2	R/W		Type	Determine signal input	1	0 → 0 to 20 mA 1 → 4 to 20 mA 2 → 0 to 10 V
	3	R/W		I min	Determine minimum current input	35	0 to 40 (0 to 4.0 mA)
	4	R/W		I max	Determine maximum current input	205	200 to 220 (20.0 to 22.0 mA)
	5	R/W		U max	Determine maximum current input	103	100 to 110 (10.0 to 11.0 V)
0xBA	1	R/W	Analog output	Direction	Set value direction set value output	0	0 → Rise (rising) 1 → Fall (falling)
	2	R/W		Type	Determine signal output	1	0 → 0 to 20 mA 1 → 4 to 20 mA 2 → 0 to 10 V
	3	R/W		Min.	Determine minimum signal output	0	0 to Max (0.0% to Max)
	4	R/W		Max	Determine maximum signal output	1000	Min to 1000 (Min to 100%)

## 11.4 Parameter

The motorized linear actuator eSyStep supports parameter data in the ISDU (Index Service Data Unit). Parameters can be transmitted non-cyclically with ISDU. Block parametrization and data storage are also supported.

### 11.4.1 System command

The commands required for block parametrization and data storage are transmitted with the **System command** parameter.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x02	0	0	W	1 byte	<b>System command</b>		UIntegerT	0x01 to 0x06
								0x82

#### Description of parameter values

Index name	Parameter	Values	Description
System command		0x01 to 0x06	Access to IO-Link
		0x82	Reset product to default settings *

\* Except the index 0x90 settings – Drive Sets, these are not reset.

### 11.4.2 Data storage index

Changes to the parameters are stored in the IO-Link master with the **Data storage index** parameter and restored with a IO-Link device identical in construction when replaced. To do so, the **Data storage** parameter must be enabled in the Device access locks (see Chapter 11.4.3, page 46) parameter. The parameters are automatically replaced via the IO-Link master.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x03	1	0	R/W	1 byte	<b>Data storage index</b>	Data Storage Cmd	UIntegerT8	
	2	8	RO	1 byte		State Property	UIntegerT8	
	3	16	RO	4 bytes		Data Storage Size	UIntegerT32	
	4	48	RO	4 bytes		Parameter Check-sum	UIntegerT32	
	5	80	RO	41 bytes		Index List	OctetStringT	

### 11.4.3 Device access locks

Access to the parameters can be controlled with the **Device access locks** parameter.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x0C	1	0	R/W	1 bit	Device access locks	Parameter (write) access	BooleanT	0
								1
	2	1	R/W	1 bit		Data storage	BooleanT	0
								1
	3	2	R/W	1 bit		Local parameterization	BooleanT	0
								1
	4	3	R/W	1 bit		Local user interface	BooleanT	0
								1

#### Description of parameter values

Index name	Parameter	Values	Description
Device access locks	Local user interface	0	Enable write access
		1	Block write access
	Data storage	0	Enable storage of parameter data in the IO-Link master
		1	Block storage of parameter data in the IO-Link master
	Local parameterization	0	Enable local parameterization
		1	Block local parameterization
	Local user interface	0	Enable local user interface
		1	Block local user interface

### 11.4.4 Profile Characteristics

The **Profile Characteristics** parameter specifies which DeviceProfileIDs, CommonApplicationProfileIDs and FunctionClassIDs are supported.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x0D	0	0	RO	8 bytes	<b>Profile Characteristics</b>		ArrayT	0x8000
								0x8002
								0x8003
								0x8100

#### Description of parameter values

Index name	Parameter	Values	Description
Profile Characteristics		0x8000	Device identification objects
		0x8002	Process data mapping
		0x8003	Diagnostics
		0x8100	External identification

#### 11.4.5 ProcessData Input Descriptor

The **ProcessData Input Descriptor** parameter describes the data format of the process data. Thus the master receives information about the process data without IODD.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x0E	0	0	RO	3 byte	<b>ProcessData Input Descriptor</b>		ArrayT	0x00 0x03 0x01

##### Description of parameter values

Index name	Parameter	Values	Description
ProcessData Input Descriptor		0x00	Bit offset
		0x03	Type length
		0x01	Data type -> BoolT

#### 11.4.6 ProcessData Output Descriptor

The **ProcessData Output Descriptor** parameter describes the data format of the process data. Thus the master receives information about the process data without IODD.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x0F	0	0	RO	3 byte	<b>ProcessData Output Descriptor</b>		ArrayT	0x00 0x04 0x01

##### Description of parameter values

Index name	Parameter	Values	Description
ProcessData Output Descriptor		0x00	Bit offset
		0x04	Type length
		0x01	Data type -> BoolT

#### 11.4.7 Vendor name

The manufacturer name can be read out in ASCII format with the **Vendor name** parameter.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x10	0	0	RO	5 bytes	<b>Vendor name</b>		StringT	"GEMUE"

#### 11.4.8 Product name

The device name can be read out in ASCII format with the **Product name** parameter.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x12	0	0	RO	18 byte	<b>Product name</b>		StringT	"eSyStep Positioner"

#### 11.4.9 Product ID

The product ID can be read out in ASCII format with the **Product ID** parameter.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x13	0	0	RO	18 byte	<b>Product ID</b>		StringT	"eSyStep Positioner"

#### 11.4.10 Serial number

The serial number of the device can be read out with the **Serial number** parameter.

The serial number consists of an 8-digit traceability number, a forward slash and a 4-digit index.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x15	0	0	RO	13 bytes	<b>Serial number</b>		StringT	"XXXXXXXX/YYY"

#### 11.4.11 Hardware revision

The circuit boards' version can be read out with the **Hardware revision** parameter.

The hardware version is displayed with the 2-digit version number of the basic assembly and the 2-digit version number of the OPEN/CLOSED or positioner assembly.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x16	0	0	RO	10 bytes	<b>Hardware revision</b>		StringT	"Rev. XX/XX"

#### 11.4.12 Firmware revision

The software version can be read out with the **Firmware revision** parameter.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x17	0	0	RO	21 byte	<b>Firmware revision</b>		StringT	"V X.X.X.X"

#### 11.4.13 Application specific tag

A text with 32 characters can be stored in the device with the **Application specific tag** parameter.

For example, installation location, function, installation date, etc.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x18	0	0	R/W	32 bytes	<b>Application specific tag</b>		StringT	"***** "



#### 11.4.14 Function tag

A text with 32 characters can be stored in the device with the **Function tag** parameter.

For example, installation location, function, installation date, etc.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x19	0	0	R/W	32 bytes	<b>Function tag</b>		StringT	„*****“

#### 11.4.15 Location tag

A text with 32 characters can be stored in the device with the **Location tag** parameter.

For example, installation location, function, installation date, etc.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x1A	0	0	R/W	32 bytes	<b>Location tag</b>		StringT	„*****“

#### 11.4.16 Device Status

The simple device status can be read out with the **Device Status** parameter.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x24	0	0	RO	1 byte	<b>Device Status</b>		uint: 8	0
								2
								4

#### Description of parameter values

Index name	Parameter	Values	Description
Device Status		0	The valve is operating properly
		2	The valve is operated outside the specification
		4	The valve is in fault status

#### 11.4.17 Detailed Device Status

The detailed device status can be read out with the **Detailed Device Status** parameter. The values of the array correspond to the IO-Link events (see chapter 12.5 Events).

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x25	0	0	RO	39 byte	<b>Detailed Device Status</b>		ArrayT	See chapter 12.5 Events

#### Description of parameter values

Index name	Parameter	Values	Description
Detailed Device Status			See chapter 12.5 Events

**11.4.18 Actuator size**

The actuator size can be read out in numbers with the **Actuator size** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x40	0	0	RO	2 bits	<b>Actuator size</b>		uint: 8	Depending on the actuator size used	0 → size 0 1 → size 1 2 → size 2

**11.4.19 Function digital inputs**

The functions of the digital inputs can be configured with the **Function digital inputs** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x4B	1	0	R/W	3 bits	Function digital inputs	Input 1	uint:8	4	0
									1
									2
									3
									4
	2	8	R/W	3 bits		Input 2	uint:8	0	0
									1
									2
									3
									4

## Description of parameter values

Index name	Parameter	Values	Description
Function digital inputs	Input 1	0	<b>(Off)</b> Input without function.
		1	<b>(Open)</b> In case of the corresponding signal, the actuator moves in the <b>OPEN</b> direction. If the other input (Digital Input 2) is configured as "Close", the actuator stops when the inputs are not actuated. If the other input is not configured as "Close", the actuator moves independently in the CLOSED direction when the "Open" input is not actuated.
		2	<b>(Close)</b> In case of the corresponding signal, the actuator moves in the <b>CLOSED</b> direction. If the other input (Digital Input 2) is configured as "Open", the actuator stops when the inputs are not actuated. If the other input is not configured as "Open", the actuator moves independently in the OPEN direction when the "Close" input is not actuated.
		3	<b>(Safe / On)</b> Safety position of the device is triggered. The device operates normally if the signal is active. If there is no signal, the device moves into the safety position. The safety position is defined by the parameter Error Action (index 0x4F (see "Error Action")).
		4	<b>(Init)</b> Input can be used as an initialization input.
	Input 2	0	<b>(Off)</b> Input without function.
		1	<b>(Open)</b> In case of the corresponding signal, the actuator moves in the <b>OPEN</b> direction. If the other input (Digital Input 1) is configured as "Close", the actuator stops when the inputs are not actuated. If the other input is not configured as "Close", the actuator moves independently in the CLOSED direction when the "Open" input is not actuated.
		2	<b>(Close)</b> In case of the corresponding signal, the actuator moves in the <b>CLOSED</b> direction. If the other input (Digital Input 1) is configured as "Open", the actuator stops when the inputs are not actuated. If the other input is not configured as "Open", the actuator moves independently in the OPEN direction when the "Close" input is not actuated.
		3	<b>(Safe/On)</b> Safety position of the device is triggered. The device operates normally if the signal is active. If there is no signal, the device moves into the safety position. The safety position is defined by the parameter Error Action (index 0x4F (see "Error Action")).
		4	<b>(Init)</b> Input can be used as an initialization input.

### 11.4.20 Function digital in- / output 1

The function of the input/output can be set with the **Function Digital In-/Output 1** (subindex 1) parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x4C	1	0	R/W	3 bits	Function digital in- / output 1	In- / output 1	uint:8	2	0
									1
									2
									3
									4
	2	8	R/W	3 bits		Type in- / output 1	uint:8	0	0
									1
									2

#### Description of parameter values

Index name	Parameter	Values	Description
Function digital in- / output 1	In- / output	0	<b>(Output Open)</b> Signal is output with the corresponding valve position. Detection of Open depends on the setting of the parameter <b>Position Feedback</b> (index 0x51 (see "Actuator position feedback", page 56)) and a correct initialization.
		1	<b>(Output Close)</b> Signal is output with the corresponding valve position. Detection of Close depends on the setting of the parameter <b>Position Feedback</b> (index 0x51 (see "Actuator position feedback", page 56)) and a correct initialization.
		2	<b>(Output Error)</b> Only output error detection.
		3	<b>(Output Error &amp; Warning)</b> Output error and warnings.
		4	<b>(Input Init)</b> Configure input/output as initialization input.
	Type in- / output	0	<b>(Push-Pull)</b> Configure output as Push-Pull.
		1	<b>(NPN)</b> Configure output as NPN.
		2	<b>(PNP)</b> Configure output as PNP.

### 11.4.21 Function digital output 2

The output function can be set with the **Function digital output 2** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x4D	0	0	R/W	2 bits	<b>Function digital output 2</b>		uint:8	<b>2</b>	0
									1
									<b>2</b>
									3

#### Description of parameter values

Index name	Parameter	Values	Description
Function digital output		0	<b>(Output Open)</b> Signal is output with the corresponding valve position. Detection of Open depends on the setting of the parameter <b>Position Feedback</b> (index 0x51 (see "Actuator position feedback", page 56)) and a correct initialization.
		1	<b>(Output Close)</b> Signal is output with the corresponding valve position. Detection of Close depends on the setting of the parameter <b>Position Feedback</b> (index 0x51 (see "Actuator position feedback", page 56)) and a correct initialization.
		2	<b>(Output Error)</b> Only output error detection.
		3	<b>(Output Error &amp; Warning)</b> Output error and warnings.

### 11.4.22 Logic digital inputs / outputs

The inputs and outputs can be inversed with the **Logic digital inputs/outputs** parameters.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x4E	1	0	R/W	1 bit	<b>Logic digital inputs / outputs</b>	Input 1	Boolean	0	<b>0</b>
				1 bit					1
	2	1	R/W	1 bit		Input 2	Boolean	0	<b>0</b>
				1 bit					1
	3	2	R/W	1 bit		Input / output 1	Boolean	0	<b>0</b>
				1 bit					1
	4	3	R/W	1 bit		Output 2	Boolean	0	<b>0</b>
				1 bit					1

#### Description of parameter values

Index name	Parameter	Values	Description
Logic digital inputs / outputs	Input 1	0	<b>(Active high)</b> Input 1 <b>not</b> inversed.
		1	<b>(Active low)</b> Input 1 inversed.
	Input 2	0	<b>(Active high)</b> Input 2 <b>not</b> inversed.
		1	<b>(Active low)</b> Input 2 inversed.
	Input / output 1	0	<b>(Active high)</b> Input/output <b>not</b> inversed.
		1	<b>(Active low)</b> Input/output inversed.
	Output 2	0	<b>(Active high)</b> Output <b>not</b> inversed.
		1	<b>(Active low)</b> Output inversed.

**11.4.23 Error action**

The safety position can be set with the **Error action** parameter.

The safety position is approached when an error occurs, if the supply voltage is too low within the range of 17.8 V to 21.1 V or in case of the corresponding signal present at Safe/On.

**NOTICE**

- Except the Temperature Over-Run error device, exceeding the permissible motor temperature. If the permissible temperature is exceeded, the motor is switched off to prevent damage.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x4F	1	0	R/W	2 bits	<b>Error action</b>	Error action	uint:8	<b>2</b>	0
									1
									2
	2	0	R/W	10 bits		Error time	uint:16	1 (0.1s)	1 ... 1000 (0.1s to 100s)

**Description of parameter values**

Index name	Parameter	Values	Description
Error action	Error action	0	<b>(Hold)</b> Actuator remains in the current position in case of an error.
		1	<b>(Open)</b> Actuator moves to the OPEN position in case of an error.
		2	<b>(Close)</b> Actuator moves to the CLOSED position in case of an error.
	Error time	1 ... 1000	Determine delay time between error detection and error message.

#### 11.4.24 Basic settings

The different settings are summarized with the **Basic settings** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x50	1	0	R/W	1 bit	Basic settings	Inversion of LED colours	Boolean	0	0
									1
	2	1	R/W	1 bit		On site initialization	Boolean	0	0
									1
	3	2	R/W	1 bit		Operating mode	Boolean	0	0
									1
	4	3	R/W	1 bit		IO-Link process data	Boolean	0	0
									1

#### Description of parameter values

Index name	Parameter	Values	Description
Basic settings	Inversion of LED colours	0	<b>(Standard)</b> LEDs Close = green and Open = yellow ( <b>not</b> inverted).
		1	<b>(Inversed)</b> LEDs Close = yellow and Open = green (inversed).
	On site initialization	0	<b>(Enabled)</b> On-site initialization (see "Initialization", page 64) activated.
		1	<b>(Disabled)</b> On-site initialization (see "Initialization", page 64) deactivated.
	Operating mode	0	Operating mode for positioner activated.
		1	Operating mode for OPEN/CLOSE control activated.
	IO-Link process data	0	<b>(Disabled)</b> Use of IO-Link process data (see "Process data", page 40) is deactivated.
		1	<b>(Enabled)</b> Use of IO-Link process data (see "Process data", page 40) is activated.

### 11.4.25 Actuator position feedback

The settings for the OPEN and CLOSED position feedback can be stored with the **Actuator position feedback** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x51	1	0	R/W	10 bits	<b>Actuator position feedback</b>	Open request	uint:16	900 (90.0%)	30 ... 970 (3.0 ... 97.0%)
	2	16	R/W	10 bits		Close request	uint:16	100 (10.0%)	30 ... 970 (3.0 ... 97.0%)
	3	32	RO	10 bits		Open real	uint:16		0 ... 4095
	4	48	RO	10 bits		Close real	uint:16		0 ... 4095

#### Description of parameter values

Index name	Parameter	Values	Description
Actuator position feedback	Open request	30 ... 970 (3.0 ... 97.0%)	Request valve position OPEN
	Close request	30 ... 970 (3.0 ... 97.0%)	Request valve position CLOSED
	Open real	0 ... 4095	Real valve position OPEN
	Close real	0 ... 4095	Real valve position CLOSED

### 11.4.26 Initialized positions

The analog values of the initialized valve positions can be read out with the **Initialized positions** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x53	1	0	RO	12 bits	<b>Initialized positions</b>	Open	uint:16	0	0 ... 4092
	2	16	RO	12 bits		Close	uint:16	4092	0 ... 4092
	3	32	RO	12 bits		Stroke	uint:16	0	0 ... 4092

#### Description of parameter values

Index name	Parameter	Values	Description
Initialized positions	Open	0 ... 4092	Analog value valve position OPEN
	Close	0 ... 4092	Analog value valve position CLOSED
	Stroke	0 ... 4092	Analog value stroke (difference between OPEN and CLOSED).



### 11.4.27 Calibration positions

The values of the factory calibration can be read out with the **Calibration positions** parameter.

The values are analog values of the potentiometer in the mechanical end positions of the actuator.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x55	1	0	RO	12 bits	<b>Calibration positions</b>	Max.	uint:16	0	0 ... 4092
	2	16	RO	12 bits		Min.	uint:16	4092	0 ... 4092

#### Description of parameter values

Index name	Parameter	Values	Description
Calibration positions	Max.	0 ... 4092	Read out analog value of the potentiometer for the mechanical end position OPEN.
	Min.	0 ... 4092	Read out analog value of the potentiometer for the mechanical end position CLOSED.

### 11.4.28 Analog values

Different analog values can be read out with the **Analog values** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Values
0x60	1	0	RO	12 bits	<b>Analog values</b>	Potentiometer	uint:16	0 ... 4095
	2	16	RO	12 bits		Supply voltage	uint:16	0 ... 4095
	3	32	RO	12 bits		Temperature	uint:16	0 ... 4095
	4	48	RO	12 bits		Set value (W)	uint:16	0 ... 4095

#### Description of parameter values

Index name	Parameter	Values	Description
Analog values	Potentiometer	0 ... 4095	Read out current analog value of the potentiometer.
	Supply voltage	0 ... 4095	Read out current analog value of the supply voltage.
	Temperature	0 ... 4095	Read out current analog value of the temperature sensor.
	Set value (W)	0 ... 4095	Read out current analog value of the set value.

**11.4.29 Operating times**

The current valve travel times can be read out with the **Operating times** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x62	1	0	RO	8 bits	<b>Operating times</b>	Open	uint:8	0	0 to 255, 0 to 25.5 s
	2	8	RO	8 bits		Close	uint:8	0	0 to 255, 0 to 25.5 s

**Description of parameter values**

Index name	Parameter	Values	Description
Operating times	Open	0 to 255 0 to 25.5 s	Read out operating time (in tenths of seconds) from end position CLOSED to end position OPEN.
	Close	0 to 255 0 to 25.5 s	Read out operating time (in tenths of seconds) from end position OPEN to end position CLOSED.

**11.4.30 Drive sets**

The force of the actuator can be influenced with the **Drive sets** parameter when the valve is initialized and during initialization.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x90	2	8	R/W	3 bits	<b>Drive sets</b>	Force	uint:16	-	1 ... 6
	3	16	R/W	3 bits		Force initialization	uint:16	-	1 ... 6

**Description of parameter values**

Index name	Parameter	Values	Description
Drive sets	Force	1 ... 6	Set the force of the valve. Preset at the factory depending on the valve type.
	Force initialization	1 ... 6	Set the force during initialization. Preset at the factory depending on the valve type.

**Force settings**

Actuator size	Setting parameter	Force
AG0 and AG1	1	Minimum force
	6	Maximum force

### 11.4.31 Control parameters

The properties can be set with the **Control parameters** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0xB0	1	0	R/W	16 bits	<b>Control parameters</b>	P amplification	uint: 16	200	1 ... 200 (0.1 ... 20.0)
	2	16	R/W	16 bits		D amplification	uint: 16	10	1 ... 200 (0.1 ... 20.0)
	3	32	R/W	16 bits		Derivative time	uint: 16	0	0 to 100 (0 to 100 s)
	4	48	R/W	16 bits		Dead band	uint: 16	10	1 ... 250 (0.1 ... 25.0 %)

#### Description of parameter values

Index name	Parameter	Values	Description
Control parameters	P amplification	1 ... 200 (0.1 ... 20.0)	Set the P component of the positioner.
	D amplification	1 ... 200 (0.1 ... 20.0)	Set the D component of the positioner.
	Derivative time	0 to 100 (0 to 100 s)	Set the delay constant of the positioner.
	Dead band	1 ... 250 (0.1 ... 25.0 %)	Set the permissible system deviation of the positioner.

### 11.4.32 Open / close tight

The sealing function can be set for the **Open / close tight** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0xB2	1	0	R/W	16 bits	<b>Open / close tight</b>	Open tight	uint:16	995	800 ... 1000 (80.0 ... 100.0 %)
	2	16	R/W	16 bits		Close tight	uint:16	5	0 ... 200 (0.0 ... 20.0 %)

#### Description of parameter values

Index name	Parameter	Values	Description
Open / close tight	Open tight	800 ... 1000 (80.0 ... 100.0 %)	Set the sealing function valve position OPEN.
	Close tight	0 ... 200 (0 ... 20.0 %)	Set the sealing function valve position CLOSED.

**11.4.33 Split range**

The start and end of the set value range can be set for **Split range** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0xB4	1	0	R/W	16 bits	<b>Split range</b>	Split start	uint: 16	0	0 to Split End – 100 (0.0 to Split End – 10.0%)
	2	16	R/W	16 bits		Split end	uint: 16	1000	Split Start + 100 to 1000 (Split Start + 10.0% to 100.0%)

**Description of parameter values**

Index name	Parameter	Values	Description
Split range	Split start	0 to Split End – 100 (0.0 to Split End – 10.0%)	Set the start of the set value range.
	Split end	Split Start + 100 to 1000 (Split Start + 10.0% to 100.0%)	Set the end of the set value range.

**11.4.34 Stroke limiter**

The upper and lower valve position of the control range can be set as stroke limiter with the **Stroke limiter** parameter.

**NOTICE**

**To use the stroke limiter, the close tight function (open/close tight) must be deactivated. To do this, Open tight must be set to the value 1000 (100.0%) and Close tight to the value 0 (0.0%).**

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0xB6	1	0	R/W	16 bits	<b>Stroke limiter</b>	Max pos	uint:16	1000	Min Pos to 1000 (Min Pos to 100.0%)
	2	16	R/W	16 bits		Min pos	uint:16	0	0 to Max Pos (0.0% to Max Pos)

**Description of parameter values**

Index name	Parameter	Values	Description
Stroke limiter	Max pos	Min Pos to 1000 (Min Pos to 100.0%)	Set the stroke limiter of the control range in valve position OPEN.
	Min pos	0 to Max Pos (0.0% to Max Pos)	Set the stroke limiter of the control range in valve position CLOSED.

### 11.4.35 Set value (W) input

The function of the analog input can be set with the **Set value (W) input** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0xB8	1	0	R/W	1 bit	<b>Set value (W) input</b>	Direction	uint:1	0	0 1
	2	8	R/W	2 bits		Type	uint:2	1	0 1 2
	3	16	R/W	8 bits		I min	uint:8	35	0 to 40 (0 to 4.0 mA)
	4	24	R/W	8 bits		I max	uint:8	205	200 to 220 (20.0 to 22.0 mA)
	5	32	R/W	8 bits		U max	uint:8	103	100 to 110 (10.0 to 11.0 V)

#### Description of parameter values

Index name	Parameter	Values	Description
Set value (W) input	Direction	0 1	Specify direction of the set value input. 0 = Rise (rising) 1 = Fall (falling)
	Type	0 1 2	Determine signal input. 0 = 0 to 20 mA 1 = 4 to 20 mA 2 = 0 to 10 V
	I min	0 to 40 (0 to 4.0 mA)	Determine minimum value of the current input. If the set value is not reached, the message "Set value too small" is issued.
	I max	200 to 220 (20.0 to 22.0 mA)	Determine maximum value of the current input. If the set value is exceeded, the message "Set value too high" is issued.
	U max	100 to 110 (10.0 to 11.0 V)	Determine maximum value of the voltage input. If the set value is exceeded, the message "Set value too high" is issued.

### 11.4.36 Analog output

The analog output function can be set with the **Analog Output** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0xBA	1	0	R/W	1 bit	<b>Analog output</b>	Direction	Boolean	0	0 1
	2	8	R/W	2 bits		Type	uint:8	1	0 1 2
	3	16	R/W	16 bits		Min.	uint:16	0	0 to Max (0.0% to Max)
	4	32	R/W	16 bits		Max.	uint:16	1000	Min to 1000 (Min to 100%)

#### Description of parameter values

Index name	Parameter	Values	Description
Analog output	Direction	0 1	Specify direction of the set value output. 0 = Rise (rising) 1 = Fall (falling)
	Type	0 1 2	Determine signal output. 0 = 0 to 20 mA 1 = 4 to 20 mA 2 = 0 to 10 V
	Min.	0 to Max (0.0% to Max)	Determine minimum value of the output.
	Max.	Min to 1000 (Min to 100%)	Determine maximum value of the output.

### 11.5 Events

The following IO-Link events can be transmitted.

Event	Mode	Type	Code
Device Hardware Fault	App/Disapp	Error	0x5000
Motor Unable To Move	App/Disapp	Error	0x8CE0
Device Temperature Over-Run	App/Disapp	Warning/Error	0x4210
Emergency Power	App/Disapp	Warning	0x5100
Primary Supply Voltage Under-Run	App/Disapp	Error	0x5111
Potifail Close	App/Disapp	Warning	0x8CA5
Potifail Open	App/Disapp	Warning	0x8CA4

#### Description – Events

Event	Description	Possible cause	Troubleshooting
Device Hardware Fault 0x5000	The event occurs when a hardware fault is detected.	Fault in valve position detection. Parameter can no longer be read when switching the device on.	Contact GEMÜ Support
Motor Unable To Move 0x8CE0	The event occurs when the motor is blocked.	Valve is blocked (for example, solid stuck in valve). Valve corroded (rust in place).	Check valve Carry out initialization if valve is OK

Event	Description	Possible cause	Troubleshooting
		End position can no longer be reached (after replacing the diaphragm).	
Device Temperature Over-Run 0x4210	The event occurs as a warning or error if the motor temperature is too high.	Control is operated outside of the specification. The ambient temperature is too high.	Check temperature Set control correctly (check duty cycle (ED) of the actuator)
Emergency Power 0x5100	The event occurs if the supply is too low. The event is triggered as a warning if the supply voltage $U_v$ is below a value of 21.1 V. (If the supply voltage is below 17.4 V, the event Primary Supply Voltage Under-Run (0x5111) is triggered as an error).	Power supply unit overloaded. Cross-section of the supply line is too small. Supply line is too long.	Check supply
Primary Supply Voltage Under-Run 0x5111	The event occurs if the supply voltage is too low.	Power supply unit overloaded. Cross-section of the supply line is too small. Supply line is too long.	Check supply
Potifail Close 0x8CA5	The event occurs if a valve position is read which can never be achieved in the "Close" direction.	Fault in valve position detection. Error when replacing a diaphragm (stroke of the valve in incorrect area). Actuator has been fitted on the valve incorrectly (stroke of the valve in the incorrect area).	Check valve/diaphragm
Potifail Open 0x8CA4	The event occurs if a valve position is read which can never be achieved in the "Open" direction.	Fault in valve position detection. Error when replacing a diaphragm (stroke of the valve in incorrect area). Actuator has been fitted on the valve incorrectly (stroke of the valve in the incorrect area).	Check valve/diaphragm

## 12 Operation

### 12.1 Initialization

#### NOTICE

- Initialization should be carried out in a depressurized condition (initialization force = 1/2 nominal force). For initialization under operating pressure, the initialization force (IO-Link index 0x90 – subindex 3 – Force initialization) must be adapted.

Initialization must be carried out in the following situations:


- Retrofitting an electrical position indicator
- Replacing the actuator
- Replacing the diaphragm

If the process valve is fully assembled at the factory, initialization has already been carried out.

Initialization can be carried out using the following procedures:

- On-site initialization
- Initialization via IO-Link
- Initialization via configurable digital input (digital input must be set to "Init")

#### 12.1.1 On-site initialization of the end positions

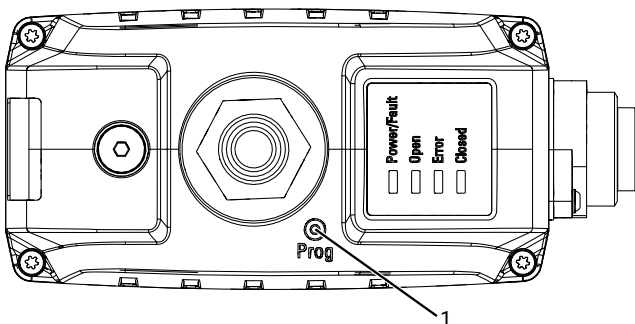


1. Connect supply voltage.
2. Hold the magnet briefly (>100 ms) at the point on the housing cover marked with PROG 1.
  - ⇒ OPEN and CLOSED LEDs flash alternately.
3. Valve automatically moves into the OPEN position.
4. Valve automatically moves into the CLOSED position.
5. Initialization mode is automatically ended.
6. The end positions are set.

#### 12.1.2 Initialization of the end positions via IO-Link


1. Briefly activate (>100 ms) initialization mode (process data "Selection of operating mode").
  - ⇒ OPEN and CLOSED LEDs flash alternately.
2. Valve automatically moves into the OPEN position.
3. Valve automatically moves into the CLOSED position.
4. Initialization mode is automatically ended.
5. The end positions are set.

### 12.2 Manual override

Open, actuate and close the manual override with the hexagon socket (SW3).

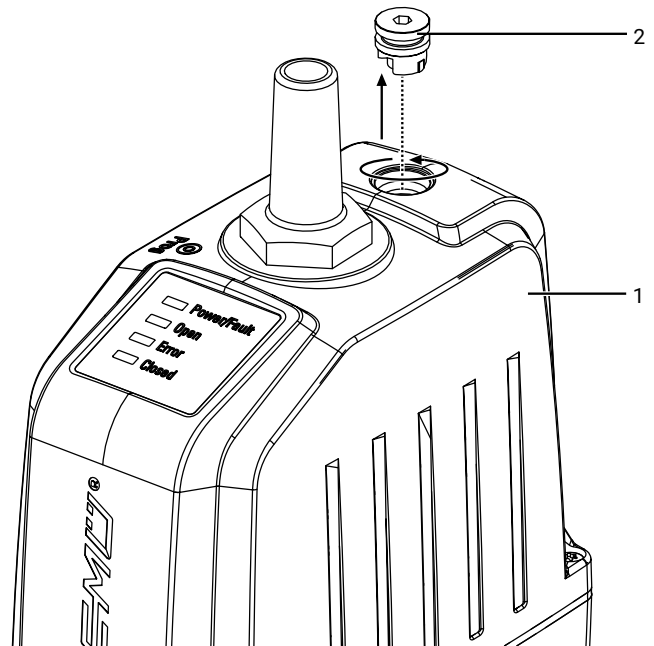

1. Unscrew sealing plug 2 anti-clockwise out of cover 1 and remove it.

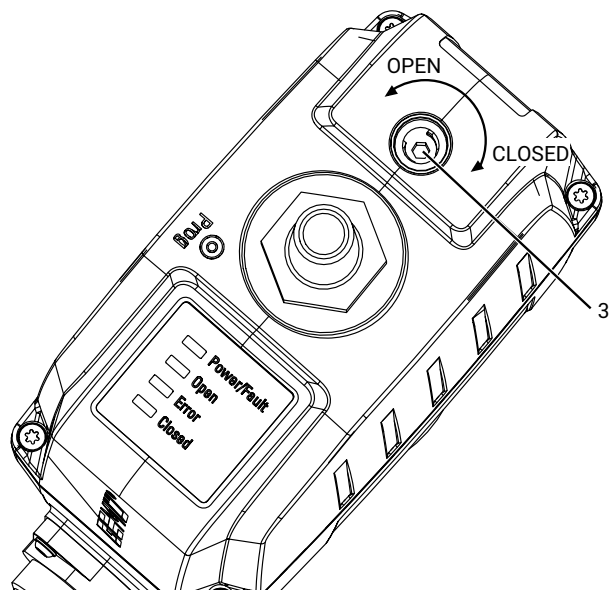

2. Operate the manual override 3 with the hexagon socket (WAF3).
  - ⇒ Turn clockwise to close the valve.
  - ⇒ Turn anticlockwise to open the valve.



## 13 Inspection and maintenance

### ⚠ WARNING

#### The equipment is subject to pressure!

- ▶ Risk of severe injury or death
- Depressurize the plant.
- Completely drain the plant.

### ⚠ CAUTION

#### Use of incorrect spare parts!

- ▶ Damage to the GEMÜ product
- ▶ Manufacturer liability and guarantee will be void
- Use only genuine parts from GEMÜ.

### ⚠ CAUTION



#### Hot plant components!

- ▶ Risk of burns
- Only work on plant that has cooled down.

### NOTICE


#### Exceptional maintenance work!

- ▶ Damage to the GEMÜ product
- Any maintenance work and repairs not described in these operating instructions must not be performed without consulting the manufacturer first.

The operator must carry out regular visual examination of the GEMÜ products dependent on the operating conditions and the potential danger in order to prevent leakage and damage. The product also must be disassembled and checked for wear in the corresponding intervals.

1. Have servicing and maintenance work performed by trained personnel.
2. Wear appropriate protective gear as specified in plant operator's guidelines.
3. Shut off plant or plant component.
4. Secure the plant or plant component against recommissioning.
5. Depressurize the plant or plant component.
6. Actuate GEMÜ products which are always in the same position four times a year.
7. If necessary, the end position counter **User** can be reset after maintenance or other changes under parameter Cycle Counter.

## 13.1 Spare parts

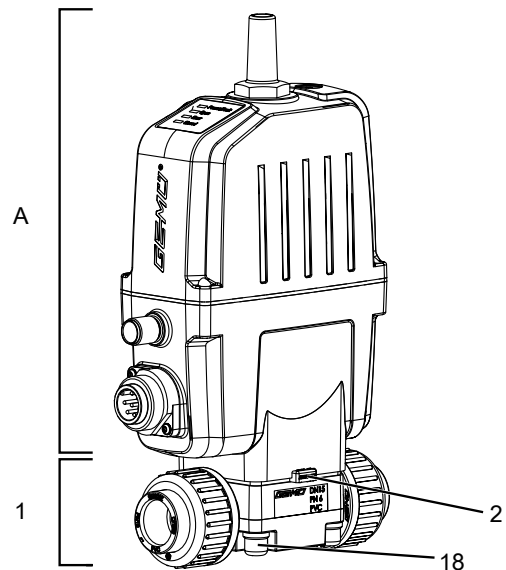

Item	Name	Order description
A	Actuator	A639...
1	Valve body	K610...
2	Diaphragm	600...M...
18	Screw	639...S30...


### 13.2 Removing the actuator

1. Move the actuator **A** to the open position.
2. Loosen the fastening elements between actuator **A** and valve body **1** diagonally and remove them.
3. Lift actuator **A** off valve body **1**.
4. Move the actuator **A** to the closed position.
5. Clean all parts of contamination (do not damage parts during cleaning).
6. Check parts for potential damage, replace if necessary (only use genuine parts from GEMÜ).

### 13.3 Removing the diaphragm

1. Remove actuator **A** (see chapter "Removing the actuator").
2. Unscrew the diaphragm.
  - ⇒ Please note: Depending on the version, the compressor may fall out.
3. Clean all parts of contamination (do not damage parts during cleaning).
4. Check parts for potential damage, replace if necessary (only use genuine parts from GEMÜ).

### 13.4 Mounting the compressor

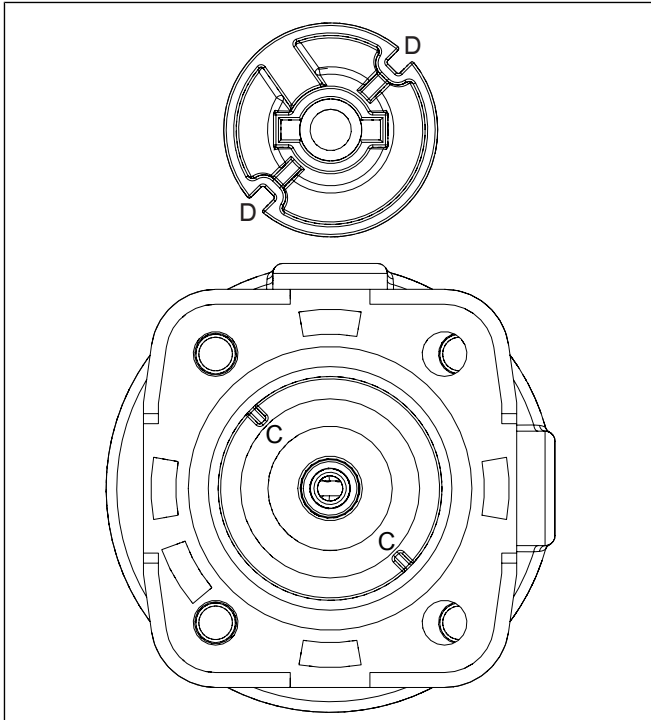

1. Place the compressor loosely on the actuator spindle.
  2. Fit recesses **D** into guides **C**.
- ⇒ The compressor must be able to be moved freely between the guides.

### 13.5 Mounting the diaphragm

#### 13.5.1 Mounting the convex diaphragm

#### NOTICE

- Fit the diaphragms suitable for the product (suitable for medium, medium concentration, temperature and pressure). The diaphragm is a wearing part. Check the technical condition and function of the product before commissioning and during the whole term of use. Carry out checks regularly and determine the check intervals in accordance with the conditions of use and/or the regulatory codes and provisions applicable for this application.

#### NOTICE

- If the diaphragm is not screwed into the adapter far enough, the closing force is transmitted directly onto the diaphragm pin and not via the compressor. This will cause damage and early failure of the diaphragm and leakage of the product. If the diaphragm is screwed in too far, perfect sealing at the valve seat will not be achieved. The function of the product is no longer ensured.

#### NOTICE

- Incorrectly mounted diaphragms cause the product leakage and emission of medium. In this case, remove the diaphragms, check the complete valve and diaphragms and reassemble again proceeding as described above.

#### NOTICE

- The compressor is loose and can fall out.

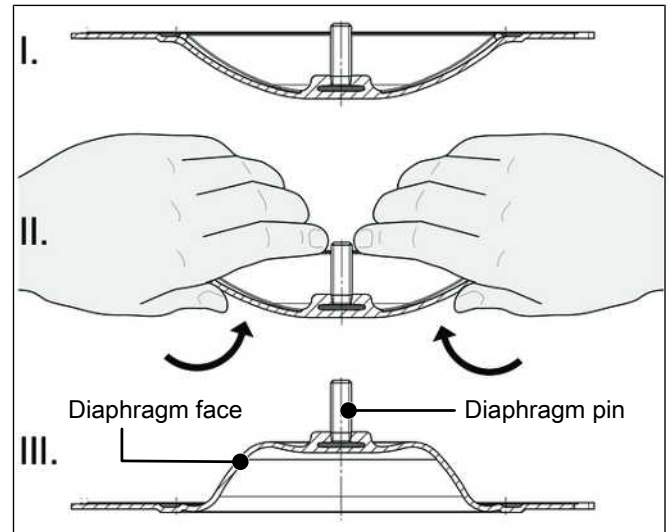


Fig. 4: Inverting the diaphragm face


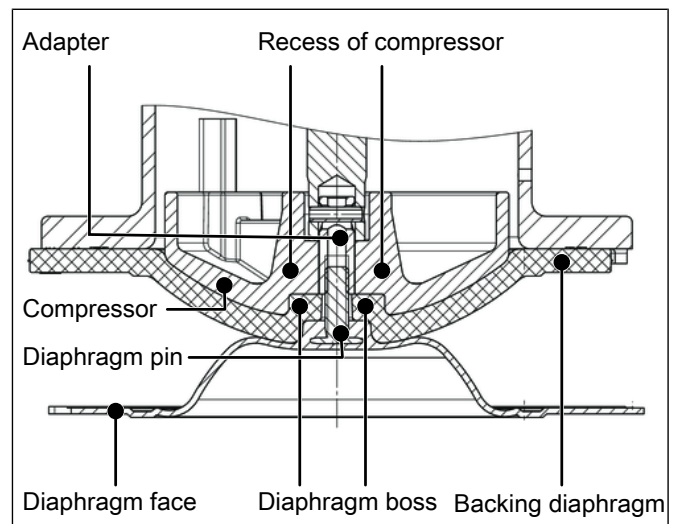


Fig. 5: Screwing in the diaphragm face

1. Move the actuator **A** to the closed position.
2. Mount the compressor (see "Mounting the compressor").
3. Check if the compressor is fitted in the guides.
4. Invert the new diaphragm face manually (use a clean, padded mat with larger nominal sizes).
5. Position the new backing diaphragm onto the compressor.
6. Position the diaphragm face onto the backing diaphragm.
7. Screw diaphragm face tightly into the compressor manually.

- ⇒ The diaphragm boss must fit closely in the recess of the compressor.
- 8. If it is difficult to screw it in, check the thread and replace damaged parts.
- 9. When definitive resistance is felt, turn back the diaphragm until its bolt holes are in correct alignment with the bolt holes of the actuator.
- 10. Press the diaphragm face tightly onto the backing diaphragm manually so that it returns to its original shape and fits closely on the backing diaphragm.
- 11. Align the weir of compressor and diaphragm in parallel.

### 13.5.2 Mounting the concave diaphragm

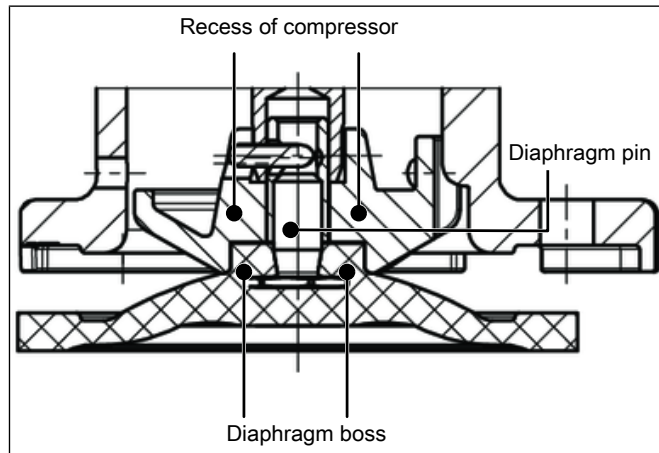

1. Move the actuator **A** to the closed position.
2. Mount the compressor (see "Mounting the compressor").
3. Check if the compressor is fitted in the guides.
4. Manually screw new diaphragm tightly into the compressor.
5. Check if the diaphragm boss fits closely in the recess of the compressor.
6. If it is difficult to screw it in, check the thread and replace damaged parts.
7. When definitive resistance is felt, turn back the diaphragm until its bolt holes are in correct alignment with the bolt holes of the actuator.
8. Align the weir of compressor and diaphragm in parallel.

### 13.6 Mounting the actuator

#### NOTICE


##### Diaphragms set in the course of time.

- Leakage
- After disassembly/assembly of the product, check that the bolts and nuts on the body are tight and retighten if required.
- Retighten the bolts and nuts at the very latest after the first sterilization process.

1. Move the actuator **A** to the open position.
2. Position actuator **A** with the mounted diaphragm on the valve body **1**.
3. Screw in bolts, washers and nuts hand tight.

⇒ Fastening elements may vary depending on the diaphragm size and/or valve body version.

4. Move the actuator **A** to the closed position.
5. Open actuator **A** approx. 20%.
6. Fully tighten the bolts with nuts diagonally.



7. Ensure even compression of the diaphragm (approx. 10 to 15%).































































⇒ Even compression is detected by an even bulge to the outside.

**Please note:** For a code 5M diaphragm (convex diaphragm), the PTFE diaphragm face and the EPDM backing diaphragm must be positioned level with and parallel to the valve body.

8. With the valve fully assembled, check the function and tightness.
9. Carry out initialisation.

## 14 Troubleshooting

### 14.1 LED error message

Function	Power/fault	Open	Error	Closed
Supply voltage too low				
	red			
Software Update				
Internal error				
Product not calibrated				
Motor does not move				
Product not initialized				
		Open and Closed flash alternately		
Temperature error				
Emergency power operation, OPEN position				
	red			
Emergency power operation, CLOSED position				
	red			
Emergency power operation, position unknown				
	red			
Set value too small				
Set value too high				
Abort IO-Link communication				
Maintenance required, OPEN position				
Maintenance required, CLOSED position				
Maintenance required, position unknown				

## 14.2 Troubleshooting

Error	Possible cause	Troubleshooting
The product is leaking downstream (does not close or does not close fully)	Operating pressure too high	Operate the product with operating pressure specified in datasheet
	Foreign matter between shut-off diaphragm and valve body	Remove the actuator, remove foreign matter, check diaphragm and valve body for potential damage, replace damaged parts if necessary
	Valve body leaking or damaged	Check valve body for potential damage, replace valve body if necessary
	Shut off diaphragm faulty	Check shut off diaphragm for potential damage, replace the shut off diaphragm if necessary
	No initialization carried out after diaphragm replacement	Initialize the product
The product does not open or does not open fully	Actuator defective	Replace the actuator
	Shut-off diaphragm incorrectly mounted	Remove the actuator, check the diaphragm mounting, replace the shut-off diaphragm if necessary
	Operating pressure too high	Operate the product with operating pressure specified in datasheet
	Foreign matter in the product	Remove and clean the product
	The actuator design is not suitable for the operating conditions	Use an actuator that is designed for the operating conditions
	Voltage is not connected	Connect voltage
	Cable ends incorrectly wired	Wire cable ends correctly
	No initialization carried out after diaphragm replacement	Initialize the product
The product does not close or does not close fully	The actuator design is not suitable for the operating conditions	Use an actuator that is designed for the operating conditions
	Foreign matter in the product	Remove and clean the product
	Voltage is not connected	Connect voltage
The product is leaking between actuator and valve body	Shut-off diaphragm incorrectly mounted	Remove the actuator, check the diaphragm mounting, replace the shut-off diaphragm if necessary
	Bolting between valve body and actuator loose	Tighten bolting between valve body and actuator
	Shut off diaphragm faulty	Check shut off diaphragm for potential damage, replace the shut off diaphragm if necessary
	Actuator/valve body damaged	Replace actuator/valve body
The product is leaking between actuator flange and valve body	Mounting parts loose	Retighten mounting parts
	Valve body / actuator damaged	Replace valve body/actuator
Valve body of the GEMÜ product is leaking	Valve body of the GEMÜ product is faulty or corroded	Check valve body of the GEMÜ product for potential damage, replace valve body if necessary
Body of the GEMÜ product is leaking	Incorrect installation	Check installation of valve body in piping
Valve body connection to piping leaking	Incorrect installation	Check installation of valve body in piping

### **15 Removal from piping**

1. Remove in reverse order to installation.
2. Unscrew the electrical wiring.
3. Disassemble the product. Observe warning notes and safety information.

### **16 Disposal**

1. Pay attention to adhered residual material and gas diffusion from penetrated media.
2. Dispose of all parts in accordance with the disposal regulations/environmental protection laws.

### **17 Returns**

Legal regulations for the protection of the environment and personnel require that the completed and signed return delivery note is included with the dispatch documents. Returned goods can be processed only when this note is completed. If no return delivery note is included with the product, GEMÜ cannot process credits or repair work but will dispose of the goods at the operator's expense.

1. Clean the product.
2. Request a return delivery note from GEMÜ.
3. Complete the return delivery note.
4. Send the product with a completed return delivery note to GEMÜ.

**18 EU Declaration of Incorporation according to the EC Machinery Directive 2006/42/EC, Annex II B**



## EU Declaration of Incorporation

**according to the EC Machinery Directive 2006/42/EC, Annex II B**

We, the company GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG  
Fritz-Müller-Strasse 6-8  
74653 Ingelfingen-Criesbach, Germany

hereby declare under our sole responsibility that the below-mentioned product complies with the relevant essential health and safety requirements in accordance with Annex I of the above-mentioned Directive.

**Product:** GEMÜ R639  
**Product name:** Motorized diaphragm valve  
**The following essential health and safety requirements of the EC Machinery Directive 2006/42/EC, Annex I have been applied or adhered to:** 1.1.2.; 1.1.3.; 1.1.5.; 1.3.2.; 1.3.4.; 1.3.7.; 1.3.8.; 1.5.1.; 1.5.13.; 1.5.2.; 1.5.4.; 1.5.6.; 1.5.7.; 1.5.8.; 1.6.1.; 1.6.3.; 1.6.5.; 1.7.1.; 1.7.1.1.; 1.7.2.; 1.7.3.; 1.7.4.; 1.7.4.1.; 1.7.4.2.; 1.7.4.3.  
**The following harmonized standards (or parts thereof) have been applied:** EN ISO 12100:2010

We also declare that the specific technical documents have been created in accordance with part B of Annex VII.

The manufacturer undertakes to transmit relevant technical documents on the partly completed machinery to the national authorities in response to a reasoned request. This communication takes place electronically.

This does not affect the industrial property rights.

**The partly completed machinery may be commissioned only if it has been determined, if necessary, that the machinery into which the partly completed machinery is to be installed meets the provisions of the Machinery Directive 2006/42/EC.**

M. Barghoorn  
Head of Global Technics  
Ingelfingen, 20/09/2023

**19 EU Declaration of Conformity in accordance with 2014/68/EU (Pressure Equipment Directive)**



---

## EU Declaration of Conformity

***in accordance with 2014/68/EU (Pressure Equipment Directive)***

We, the company  
GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG  
Fritz-Müller-Strasse 6-8  
74653 Ingelfingen-Criesbach, Germany

hereby declare under our sole responsibility that the below-mentioned product complies with the regulations of the above-mentioned Directive.

**Product:** GEMÜ R639  
**Product name:** Motorized diaphragm valve  
**Notified body:** TÜV Rheinland Industrie Service GmbH  
Am Grauen Stein 1  
51105 Cologne, Germany

**ID number of the notified body:** 0035

**No. of the QA certificate:** 01 202 926/Q-02 0036

**Applied conformity assessment procedure(s):** Module H


**The following harmonized standards (or parts thereof) have been applied:** EN ISO 16138:2006/A1:2019

**Information for products with a nominal size  $\leq$  DN 25:**

The products are developed and produced according to GEMÜ's in-house process instructions and standards of quality which comply with the requirements of ISO 9001 and ISO 14001. According to Article 4, Paragraph 3 of the Pressure Equipment Directive 2014/68/EU, these products must not be identified by a CE-marking.

**Other applied technical standards / Remarks:**

- AD 2000

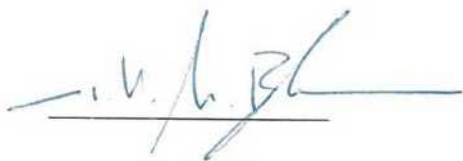

M. Barghoorn  
Head of Global Technics

Ingelfingen, 20/09/2023

---

GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG  
Fritz-Müller-Straße 6-8 D-74653 Ingelfingen-Criesbach

[www.gemu-group.com](http://www.gemu-group.com)  
[info@gemu.de](mailto:info@gemu.de)



**20 EU Declaration of Conformity in accordance with 2014/30/EU (EMC Directive)**



## **EU Declaration of Conformity**

***in accordance with 2014/30/EU (EMC Directive)***


We, the company  
GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG  
Fritz-Müller-Strasse 6-8  
74653 Ingelfingen-Criesbach, Germany

hereby declare under our sole responsibility that the below-mentioned product complies with the regulations of the above-mentioned Directive.

**Product:** GEMÜ R639  
**Product name:** Motorized diaphragm valve  
**The following harmonized standards (or parts thereof) have been applied:** EN 61000-6-4:2007/A1:2011 (only valid for Actuator size AG1)  
EN 61000-6-3:2007/A1:2011 (only valid for Actuator size AG0)  
EN 61000-6-2:2005/AC:2005 (valid for all types)

**Other applied technical standards / Remarks:**

- EN IEC 61800-3:2018

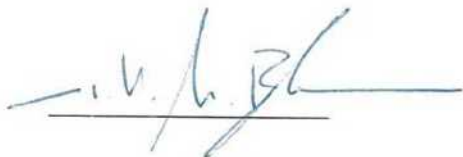

M. Barghoorn  
Head of Global Technics  
Ingelfingen, 20/09/2023

**21 EU Declaration of Conformity in accordance with 2011/65/EU (RoHS Directive)**



---


## **EU Declaration of Conformity**

***In accordance with 2011/65/EU (RoHS Directive)***

We, the company GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG  
Fritz-Müller-Strasse 6-8  
74653 Ingelfingen-Criesbach, Germany

hereby declare under our sole responsibility that the below-mentioned product complies with the regulations of the above-mentioned Directive.

**Product:** GEMÜ R639  
**Product name:** Motorized diaphragm valve  
**The following harmonized standards (or parts thereof) have been applied:** EN IEC 63000:2018

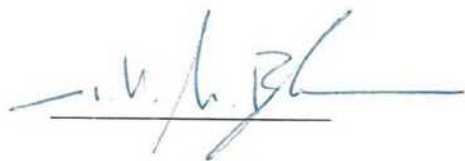

M. Barghoorn  
Head of Global Technics

Ingelfingen, 20/09/2023



GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG  
Fritz-Müller-Straße 6-8, 74653 Ingelfingen-Criesbach, Germany  
Phone +49 (0) 7940 1230 · [info@gemue.de](mailto:info@gemue.de)  
[www.gemu-group.com](http://www.gemu-group.com)

Subject to alteration

10.2023 | 88668345