

GEMÜ 567 eSyDrive

Motorized control valve

EN

Operating instructions



All rights including copyrights or industrial property rights are expressly reserved.

Keep the document for future reference.

© GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG
19.12.2023

Contents

1 General information	4
1.1 Information	4
1.2 Symbols used	4
1.3 Definition of terms	4
1.4 Warning notes	4
2 Safety information	5
3 Product description	5
4 Correct use	9
5 GEMÜ CONEXO	9
6 Order data - eSyDrive	11
6.1.5 Valve body material	11
7 Technical data	13
8 Dimensions	20
9 Manufacturer's information	41
9.1 Delivery	41
9.2 Packaging	41
9.3 Transport	41
9.4 Storage	41
10 Installation in piping	41
10.1 Installation location	41
10.2 Preparing for installation	41
10.3 Installation with clamp connections	42
10.4 Installation with butt weld spigots	42
11 Mounting	43
12 Electrical connection	44
13 Commissioning	47
13.1 Commissioning on the device	47
13.2 Commissioning via the eSy-Web web interface	47
13.3 Commissioning via digital input	47
14 Error messages	47
14.1 LED error messages	47
14.2 Troubleshooting	48
15 Inspection and maintenance	49
16 Removal from piping	58
17 Disposal	58
18 Returns	58
19 Declaration of Incorporation according to 2006/42/EC (Machinery Directive)	59
20 Declaration of conformity according to 2014/68/EU (Pressure Equipment Directive)	60
21 Declaration of conformity according to 2014/30/EU (EMC Directive)	61

1 General information

1.1 Information

- The descriptions and instructions apply to the standard versions. For special versions not described in this document the basic information contained herein applies in combination with any additional special documentation.
- Correct installation, operation, maintenance and repair work ensure faultless operation of the product.
- Should there be any doubts or misunderstandings, the German version is the authoritative document.
- Contact us at the address on the last page for staff training information.

1.2 Symbols used

The following symbols are used in this document:

Symbol	Meaning
●	Tasks to be performed
►	Response(s) to tasks
–	Lists

1.3 Definition of terms

Working medium

The medium that flows through the GEMÜ product.

PD

PD = Plug Diaphragm

1.4 Warning notes



Wherever possible, warning notes are organised according to the following scheme:


SIGNAL WORD	
Possible symbol for the specific danger	Type and source of the danger <ul style="list-style-type: none"> ► Possible consequences of non-observance. ● Measures for avoiding danger.

Warning notes are always marked with a signal word and sometimes also with a symbol for the specific danger.





The following signal words and danger levels are used:

 DANGER	
	Imminent danger! <ul style="list-style-type: none"> ► Non-observance can cause death or severe injury.
 WARNING	
	Potentially dangerous situation! <ul style="list-style-type: none"> ► Non-observance can cause death or severe injury.

 CAUTION	
	Potentially dangerous situation! <ul style="list-style-type: none"> ► Non-observance can cause moderate to light injury.

NOTICE	
	Potentially dangerous situation! <ul style="list-style-type: none"> ► Non-observance can cause damage to property.

The following symbols for the specific dangers can be used within a warning note:

Symbol	Meaning
	Danger of explosion!
	Corrosive chemicals!
	Hot plant components!
	Danger - high voltage!

2 Safety information

The safety information in this document refers only to an individual product. Potentially dangerous conditions can arise in combination with other plant components, which need to be considered on the basis of a risk analysis. The operator is responsible for the production of the risk analysis and for compliance with the resulting precautionary measures and regional safety regulations.

The document contains fundamental safety information that must be observed during commissioning, operation and maintenance. Non-compliance with these instructions may cause:

- Personal hazard due to electrical, mechanical and chemical effects.
- Hazard to nearby equipment.
- Failure of important functions.
- Hazard to the environment due to the leakage of dangerous substances.

The safety information does not take into account:

- Unexpected incidents and events, which may occur during installation, operation and maintenance.
- Local safety regulations which must be adhered to by the operator and by any additional installation personnel.

Prior to commissioning:

1. Transport and store the product correctly.
2. Do not paint the bolts and plastic parts of the product.
3. Carry out installation and commissioning using trained personnel.
4. Provide adequate training for installation and operating personnel.
5. Ensure that the contents of the document have been fully understood by the responsible personnel.
6. Define the areas of responsibility.
7. Observe the safety data sheets.
8. Observe the safety regulations for the media used.

During operation:

9. Keep this document available at the place of use.
10. Observe the safety information.
11. Operate the product in accordance with this document.
12. Operate the product in accordance with the specifications.
13. Maintain the product correctly.
14. Do not carry out any maintenance work and repairs not described in this document without consulting the manufacturer first.


In cases of uncertainty:

15. Consult the nearest GEMÜ sales office.

3 Product description

3.1 Construction

3.1.1 Construction

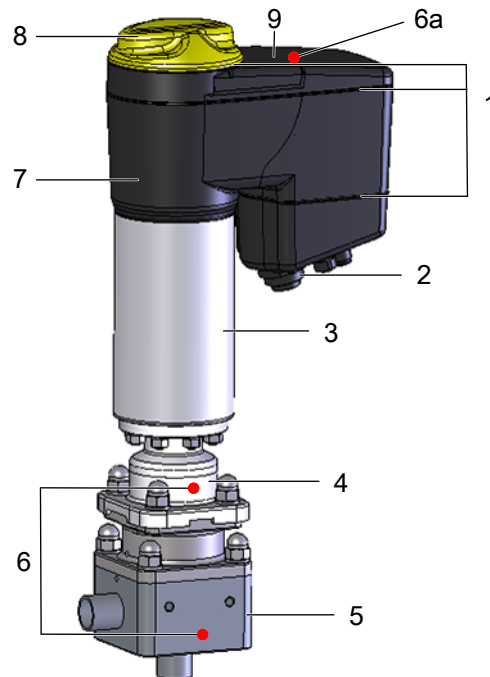

Item	Name	Materials
1	O-rings	EPDM
2	Electrical connections	
3	Actuator base	1.4301
4	Distance piece	1.4408
5	Valve body with leak detection hole	1.4435, 1.4539, 2.4602, 1.4410, 1.4529
6	CONEXO RFID chip	6 (AG2, AG4, AG5) 6a (AG3)
7	Optical position indicator	PESU (AG2, AG4, AG5) PC (AG3)
8	Cover with high visibility LED, manual override and on-site control	PESU (AG2, AG4, AG5) PC (AG3)
9	Actuator top	PESU black (AG2, AG4, AG5) PC black (AG3)

3.1.2 Buttons for on-site control

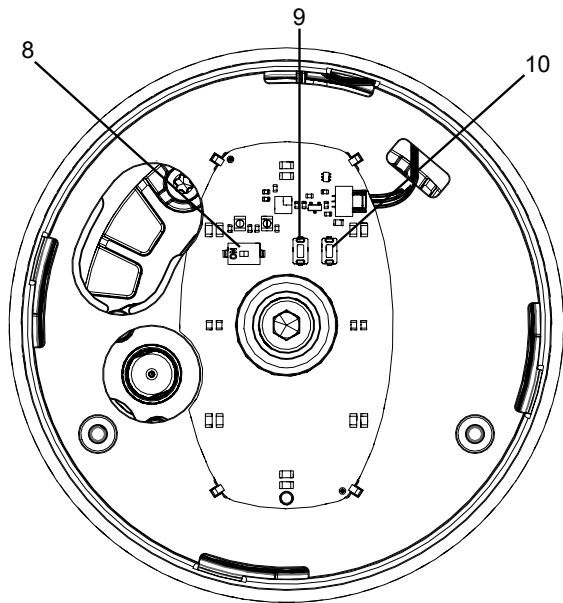


Fig. 1: Position of the buttons

Item	Name	Function
8	DIP switch, "ON-site" control	Switches the on-site control on the device on or off
9	"OPEN" button	Moves actuator to the open position Resets the network settings
10	"INIT/CLOSE" button	Moves actuator to the closed position Starting initialisation

3.1.3 LED displays

3.1.3.1 On-site status LEDs

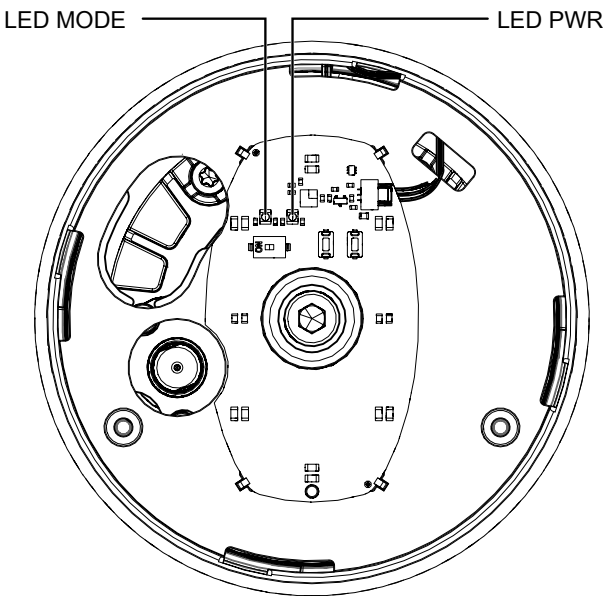































Fig. 2: Position of the status LEDs

The user checks the following conditions directly on-site at the valve using LED MODE and LED PWR:

Function	LED MODE		LED PWR	
	Yellow	Blue	Green	Red
Automatic operation				
Manual operation				
Actuator switched off (OFF mode)				
Manual operation (on-site)				
Software update				
	alternating			
On-site initialisation (buttons)				
Remote initialisation (via Di-gIn)				

Function	LED MODE		LED PWR	
	Yellow	Blue	Green	Red
Operation via emergency power supply module				

3.1.3.2 High visibility LEDs








Fig. 3: Position of the high visibility LEDs

Item	Name
11	High visibility LEDs

Function	High visibility LED	
	green	orange
Initialization		
	alternating	
Location function		

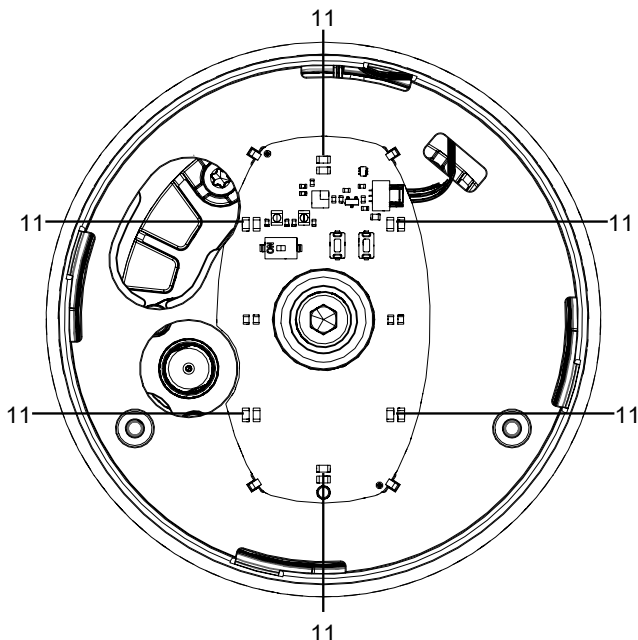









3.2 Description


The GEMÜ 567 eSyDrive 2/2-way diaphragm globe valve is a precise motorized control valve for sterile applications. The GEMÜ eSyDrive hollow shaft actuator can be operated as an actuator with integrated positioner or process controller. Flow rates range from 80 l/h to 63 m³/h, depending on the version.

3.3 Function


The product controls or regulates (depending on version) a flowing medium by being closed or opened by a motorized actuator.

The product has an optical position indicator as standard. The optical position indicator indicates the OPEN and CLOSED positions.

Function		High visibility LED	
		green	orange
OPEN position	Position indicator LEDs standard		
OPEN position	Position indicator LEDs inversed		
CLOSED position	Position indicator LEDs standard		
CLOSED position	Position indicator LEDs inversed		
Position unknown	(e.g. 50%)		


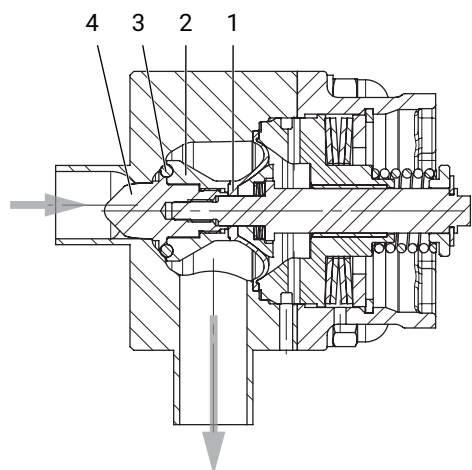
3.4 PD seal system without bypass

Seal material code 4

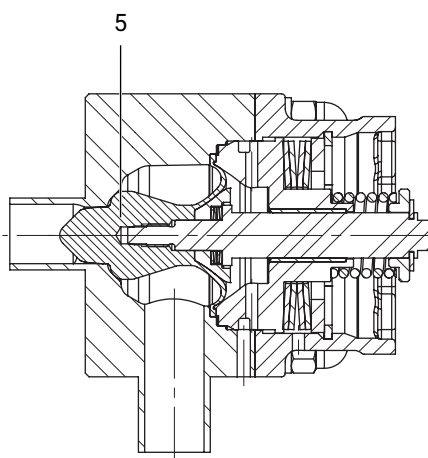


Seal material code 5

Item	Name	Materials
1	Plug diaphragm	PTFE
2	Support ring	1.4435, 1.4539, 2.4602, 1.4410, 1.4529
3	O-ring	FKM
4	Regulating cone	1.4435, 1.4539, 2.4602, 1.4410, 1.4529
5	Plug diaphragm with regulating cone	PTFE

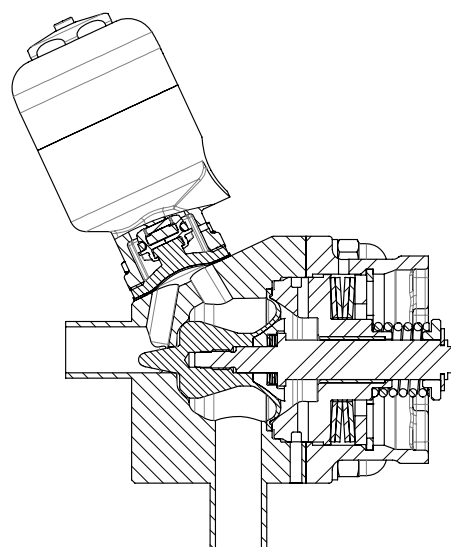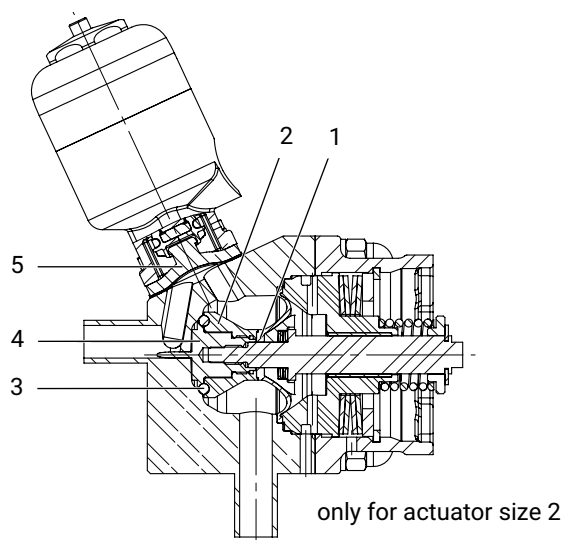3.5 PD seal system with bypass

Item	Name	Materials
1	Plug diaphragm FKM, PTFE	PTFE
2	Support ring	1.4435, 1.4539, 2.4602, 1.4410, 1.4529
3	O-ring	FKM, FFKM
4	Regulating cone	1.4435, 1.4539, 2.4602, 1.4410, 1.4529
5	Bypass valve diaphragm	PTFE-EPDM, EPDM

3.6 Installation position for optimized draining

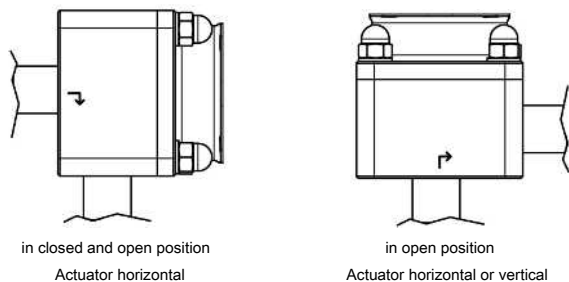


Control range

We recommend designing the valves in such a way that the control range is within an opening stroke of 20% to 90% of the control valve.

3.7 Product label

The product label is located on the actuator. Product label data (example):

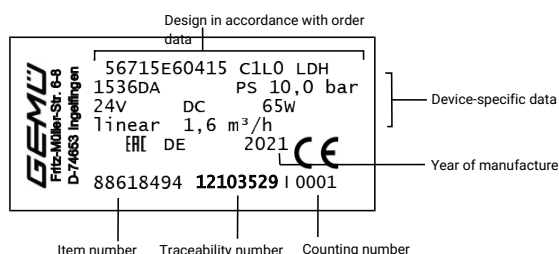

The month of manufacture is encoded in the traceability number and can be obtained from GEMÜ. The product was manufactured in Germany.

4 Correct use

DANGER



Danger of explosion!

- Risk of death or severe injury
- Do **not** use the product in potentially explosive zones.

WARNING

Improper use of the product!

- Risk of severe injury or death
- Manufacturer liability and guarantee will be void.
- Only use the product in accordance with the operating conditions specified in the contract documentation and in this document.

The product is designed for installation in piping systems and for controlling a working medium.

The product is not intended for use in potentially explosive areas.

- Use the product in accordance with the technical data.

5 GEMÜ CONEXO

Order without CONEXO

If you have ordered the product without CONEXO functionality, the RFID chip is used for traceability in the production process and quality assurance. Expansion to include the CONEXO functionality at a later date must be coordinated with GEMÜ.

Order with CONEXO

GEMÜ CONEXO must be ordered separately with the ordering option "CONEXO" (see order data).

For electronic identification purposes, each replaceable component contained in the product you have purchased is equipped with an RFID chip (1). Where you can find the RFID chip differs from product to product.

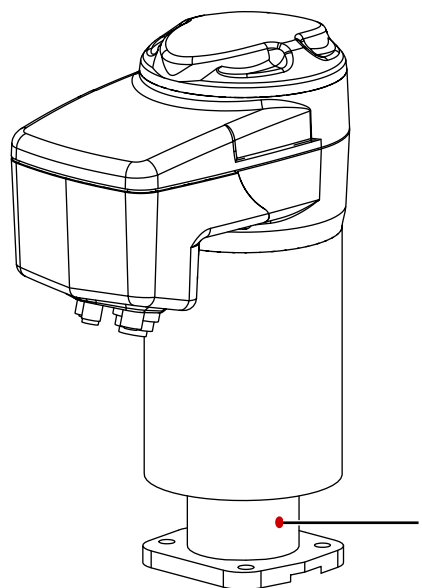


Fig. 4: Actuator RFID chip

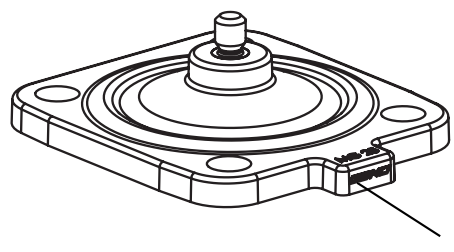


Fig. 5: Diaphragm RFID chip

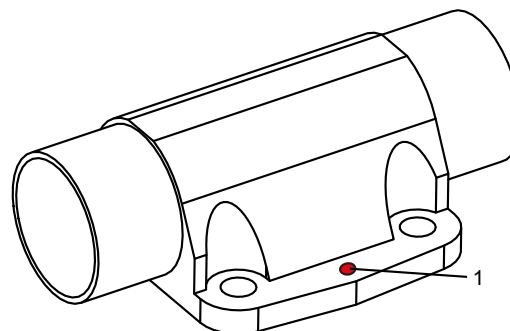


Fig. 6: Valve body RFID chip

The CONEXO pen helps read out information stored in these RFID chips. The CONEXO app or CONEXO portal is required to view this information.

6 Order data - eSyDrive

The order data provide an overview of standard configurations.

Please check the availability before ordering. Other configurations available on request.

Order codes

1 Type	Code
Control valve	567

2 DN	Code
DN 8	8
DN 10	10
DN 15	15
DN 20	20
DN 25	25
DN 32	32
DN 40	40
DN 50	50
DN 65	65

3 Body configuration	Code
2-way angle body	E
2-way angle body with bypass	M

4 Connection type	Code
Spigot	
Spigot DIN	0
Spigot EN 10357 series A (formerly DIN 11850 series 2)/DIN 11866 series A	17
Spigot ASME BPE / DIN 11866 series C	59
Spigot ISO 1127/EN 10357 series C/DIN 11866 series B	60
Clamp	
Clamp DIN 32676 series B	82
Clamp DIN 32676 series A	86
Clamp ASME BPE	88

5 Valve body material	Code
1.4435 (316L), block material	41
1.4435 (BN2), block material, $\Delta Fe < 0.5\%$	43
1.4539, block material	44
2.4602, block material Alloy 22, (NiCr21Mo14W)	A3
1.4410, block material	A7
1.4529, block material	A8

6 Seal material	Code
Actuator seal PTFE / seat seal FKM	4
Actuator seal PTFE / seat seal PTFE	5
Actuator seal PTFE / seat seal FKM / bypass seal EPDM bypass diaphragm code 13	43
Actuator seal PTFE / seat seal FKM / bypass seal PTFE bypass diaphragm code 54	45
Actuator seal PTFE / seat seal FKM / bypass seal EPDM bypass diaphragm code 17	47
Actuator seal PTFE / seat seal PTFE / bypass seal PTFE bypass diaphragm code 54	55
Actuator seal PTFE / seat seal FFKM	F

6 Seal material	Code
Actuator seal PTFE / seat seal FFKM / bypass seal PTFE bypass diaphragm code 54	F5

7 Voltage/Frequency	Code
24 V DC	C1

8 Control module	Code
OPEN/CLOSE, positioner and process controller	L0

9 Control characteristic	Code
Modified equal-percentage	G
Linear	L

10 Kv value	Code
80 l/h	AA
100 l/h	AB
160 l/h	BC
250 l/h	BD
400 l/h	BE
630 l/h	CF
1.0 m³/h	CG
1.6 m³/h	DH
2.6 m³/h	EJ
4.1 m³/h	G1
8.0 m³/h	H2
12.5 m³/h	J3
14.0 m³/h	K4
18.0 m³/h	K5
25.0 m³/h	K6
32.0 m³/h	M7
40.0 m³/h	M8
50.0 m³/h	N9
63.0 m³/h	NK

11 Bypass actuator version	Code
Pneumatically operated, normally closed, diaphragm size 8,	11
Pneumatically operated, normally open, diaphragm size 8,	12
Manually operated, with seal adjuster, diaphragm size 8,	S0

12 Surface	Code
Ra ≤ 0.25 µm (10 µin.) for media wetted surfaces *), in accordance with DIN 11866 HE5, electropolished internal/external, *) for inner pipe diameters < 6 mm, in the spigot Ra ≤ 0.38 µm	1516

12 Surface	Code
Ra ≤ 0.25 µm (10 µin.) for media wetted surfaces *), in accordance with DIN 11866 H5, mechanically polished internal, *) for inner pipe diameters < 6 mm, in the spigot Ra ≤ 0.38 µm	1527
Ra ≤ 0.4 µm (15 µin.) for media wetted surfaces, in accordance with DIN 11866 H4, mechanically polished internal	1536
Ra ≤ 0.4 µm (15 µin.) for media wetted surfaces, in accordance with DIN 11866 HE4, electropolished internal/external	1537
Ra max. 0.51 µm (20 µin.) for media wetted surfaces, in accordance with ASME BPE SF1, mechanically polished internal	SF1

12 Surface	Code
Ra max. 0.38 µm (15 µin.) for media wetted surfaces, in accordance with ASME BPE SF4, electropolished internal/external	SF4
Ra max. 0.51 µm (20 µin.) for media wetted surfaces, in accordance with ASME BPE SF5, electropolished internal/external	SF5
13 Actuator+interface	Code
eSyDrive and analogue	DA
14 CONEXO	Code
Without	
Integrated RFID chip for electronic identification and traceability	C

Order example without bypass

Ordering option	Code	Description
1 Type	567	Control valve
2 DN	15	DN 15
3 Body configuration	M	2-way angle body with bypass
4 Connection type	17	Spigot EN 10357 series A (formerly DIN 11850 series 2)/DIN 11866 series A
5 Valve body material	41	1.4435 (316L), block material
6 Seal material	55	Actuator seal PTFE / seat seal PTFE / bypass seal PTFE bypass diaphragm code 54
7 Voltage/Frequency	C1	24 V DC
8 Control module	L0	OPEN/CLOSE, positioner and process controller
9 Control characteristic	G	Modified equal-percentage
10 Kv value	G1	4.1 m³/h
11 Bypass actuator version	S0	Manually operated, with seal adjuster, diaphragm size 8,
12 Surface	1536	Ra ≤ 0.4 µm (15 µin.) for media wetted surfaces, in accordance with DIN 11866 H4, mechanically polished internal
13 Actuator+interface	DA	eSyDrive and analogue
14 Special version	M	Special version for 3A
15 CONEXO	C	Integrated RFID chip for electronic identification and traceability

7 Technical data

7.1 Medium

Working medium: Corrosive, inert, gaseous and liquid media which have no negative impact on the physical and chemical properties of the body and diaphragm material.

7.2 Temperature

Media temperature:

Without bypass	-10 – 160 °C
With bypass	-10 – 100 °C
Observe pressure/temperature diagram	

Sterilization temperature:

Seat seal FKM, FFKM without bypass, (code 4, F)	160 °C ¹⁾ , steam max. 30 min ²⁾
Seat seal PTFE without bypass, (code 5)	160 °C ¹⁾ , steam max. 30 min ²⁾
Seat seal FKM, FFKM	150 °C ³⁾ , max. 30 min
bypass diaphragm material EPDM, (code 43, F3)	
Seat seal FKM, FFKM	150 °C ³⁾ , max. 30 min
bypass diaphragm material PTFE/EPDM, PTFE laminated, (code 45, F5)	
Seat seal FKM, FFKM	150 °C ³⁾ , max. 30 min
bypass diaphragm material EPDM, (code 47, F7)	
Seat seal PTFE	150 °C ³⁾ , max. 30 min
bypass diaphragm material PTFE/EPDM, PTFE laminated, (code 55)	

1) The sterilization temperature is only valid for steam (saturated steam) or superheated water.

2) Longer sterilization times or continuous operation on request.

3) If the sterilization temperatures listed above are applied to the EPDM diaphragms for longer periods of time, the service life of the diaphragms will be reduced. In these cases, maintenance cycles must be adapted accordingly. This also applies to PTFE diaphragms exposed to high temperature fluctuations. The maintenance cycles must be adapted accordingly.

Ambient temperature: -10 – 60 °C

Storage temperature: 0 – 40 °C

7.3 Pressure


Operating pressure: 0 – 10 bar

All pressures are gauge pressures. Operating pressure values were determined with static operating pressure applied on one side of a closed valve. Sealing at the valve seat and atmospheric sealing is ensured for the given values.

Information on operating pressures applied on both sides and for high purity media on request.

Operating pressure:

Pressure/Temperature diagram

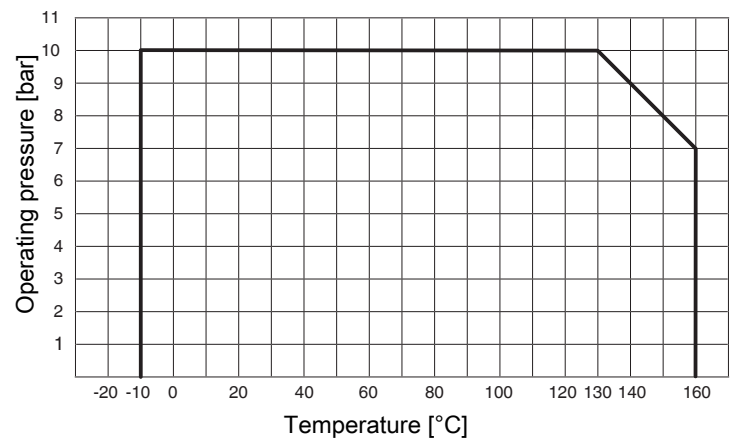


Leakage rate:

Control valve

Seat seal	Standard	Test procedure	Leakage rate	Test medium
FKM, PTFE	DIN EN 60534-4	1	VI	Air

Kv values:

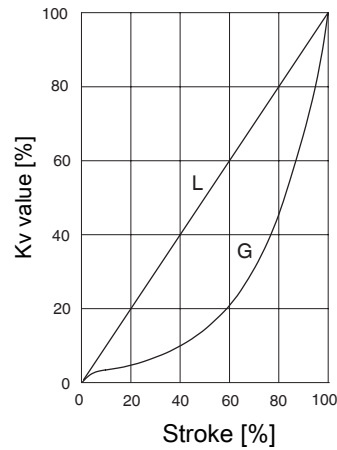

Kv values:

Code 17, 60, 82 and 86

AG	Seal material code	Control characteristic	Kv value	DN 8	DN 10	DN 15	DN 20	DN 25	DN 32	DN 40	DN 50
2	4, 43, 45, 47, F, F5	GAA, LAA	80 l/h	X	X	X	-	-	-	-	-
		GAB, LAB	100 l/h	X	X	X	-	-	-	-	-
		GBC, LBC	160 l/h	X	X	X	-	-	-	-	-
		GBD, LBD	250 l/h	X	X	X	-	-	-	-	-
		GBE, LBE	400 l/h	X	X	X	-	-	-	-	-
	5, 55	GCF, LCF	630 l/h	X	X	X	-	-	-	-	-
		GCG, LCG	1.0 m³/h	-	X	X	-	-	-	-	-
		GDH, LDH	1.6 m³/h	-	X	X	-	-	-	-	-
		GEJ, LEJ	2.6 m³/h	-	-	X	-	-	-	-	-
		GG1, LG1	4.1 m³/h	-	-	X	-	-	-	-	-
3	5	GH2, LH2	8.0 m³/h	-	-	-	X	X	-	-	-
		GJ3, LJ3	12.5 m³/h	-	-	-	-	X	-	-	-
4	5	GK4, LK4	14.0 m³/h	-	-	-	-	-	X	X	-
		GK5, LK5	18.0 m³/h	-	-	-	-	-	X	X	-
		GK6, LK6	25.0 m³/h	-	-	-	-	-	X	X	-
		GM7, LM7	32.0 m³/h	-	-	-	-	-	-	X	-
		GM8, LM8	40.0 m³/h	-	-	-	-	-	-	X	-
5	5	GN9, LN9	50.0 m³/h	-	-	-	-	-	-	-	X
		GNK, LNK	63.0 m³/h	-	-	-	-	-	-	-	X

Code 59 and 88

AG	Seal material code	Control characteristic	Kv value	DN 15	DN 20	DN 25	DN 40	DN 50	DN 65
2	4, 43, 45, 47, F, F5	GAA, LAA	80 l/h	X	X	-	-	-	-
		GAB, LAB	100 l/h	X	X	-	-	-	-
		GBC, LBC	160 l/h	X	X	-	-	-	-
		GBD, LBD	250 l/h	X	X	-	-	-	-
		GBE, LBE	400 l/h	X	X	-	-	-	-
	5, 55	GCF, LCF	630 l/h	X	X	-	-	-	-
		GCG, LCG	1.0 m³/h	X	X	-	-	-	-
		GDH, LDH	1.6 m³/h	X	X	-	-	-	-
		GEJ, LEJ	2.6 m³/h	-	X	-	-	-	-
		GG1, LG1	4.1 m³/h	-	X	-	-	-	-
3	5	GH2, LH2	8.0 m³/h	-	-	X	-	-	-
4	5	GK4, LK4	14.0 m³/h	-	-	-	X	X	-
		GK5, LK5	18.0 m³/h	-	-	-	X	X	-
		GK6, LK6	25.0 m³/h	-	-	-	X	X	-
		GM7, LM7	32.0 m³/h	-	-	-	-	X	-
		GM8, LM8	40.0 m³/h	-	-	-	-	X	-
5	5	GN9, LN9	50.0 m³/h	-	-	-	-	-	X
		GNK, LNK	63.0 m³/h	-	-	-	-	-	X

Kv values:

Kv values - Bypass (only available in AG2)				
Code	DN8	DN10	DN15	DN20
0, 17, 86	1.5 m ³ /h	1.8 m ³ /h	2.1 m ³ /h	-
60, 82	1.8 m ³ /h	2.1 m ³ /h	2.1 m ³ /h	-
59, 88	-	-	1.8 m ³ /h	2.1 m ³ /h

AG = actuator size

Kv values determined acc.to DIN EN 60534.

7.4 Product compliance

Pressure Equipment Directive:	2014/68/EU	
Machinery Directive:	2006/42/EC	
EMC Directive:	2014/30/EU	
	Technical standards used:	
	Interference resistance	DIN EN 61000-6-2 (Nov. 2019) DIN EN 61326-1 (industry)
	Interference emission	Actuator size 2, 3 DIN EN 61000-6-4 Interference emission class: Class A Interference emission group: Group 1 Actuator size 4, 5 DIN EN 61800-3 Category: C3 The product is intended for operation in industrial environments.
Food:	Regulation (EC) No. 1935/2004* Regulation (EC) No. 10/2011* FDA* USP* Class VI * depending on version and/or operating parameters	

7.5 Mechanical data

Protection class:	IP 65 acc. to EN 60529	
Weight:	Actuator	
	Actuator size 2	2.86 kg
	Actuator size 3	4.56 kg
	Actuator size 4	11.52 kg
	Actuator size 5	14.44 kg
	Body	
	Actuator size 2	1.6 kg
	Actuator size 3	2.8 kg
	Actuator size 4	4.3 kg
	Actuator size 5	7.6 kg
Actuating speed:	Actuator size 2	adjustable, max. 6 mm/s
	Actuator size 3	adjustable, max. 6 mm/s
	Actuator size 4	adjustable, max. 4 mm/s
	Actuator size 5	adjustable, max. 4 mm/s

7.6 Duty cycle and service life

Service life:	Control operation - Class C acc. to EN 15714-2 (1,800,000 start-ups and 1200 start-ups per hour). Open / Close duty - Minimum 1,000,000 switching cycles at room temperature and permissible duty cycle.
Duty cycle:	Control operation - Class C acc. to EN 15714-2. Open/Close duty - 100%

7.7 Electrical data**7.7.1 Supply voltage**

	Actuator size 2	Actuator size 3	Actuator size 4, 5
Voltage	U _v = 24 V DC ± 10%		
Rating	Max. 28 W	Max. 65 W	Max. 120 W
Reverse battery protection	Yes		

7.7.2 Analogue input signals**7.7.2.1 Set value**

Input signal:	0/4 - 20 mA; 0 – 10 V DC (selectable using software)
Input type:	passive
Input resistance:	250 Ω
Accuracy/linearity:	≤ ±0.3% of full flow
Temperature drift:	≤ ±0.1% / 10°K
Resolution:	12 bit
Reverse battery protection:	No
Overload proof:	Yes (up to ± 24 V DC)

7.7.2.2 Process actual value

Input signal:	0/4 - 20 mA; 0 – 10 V DC (selectable using software)
Input type:	passive
Input resistance:	250 Ω
Accuracy/linearity:	≤ ±0.3% of full flow
Temperature drift:	≤ ±0.1% / 10°K
Resolution:	12 bit
Reverse battery protection:	No
Overload proof:	Yes (up to ± 24 V DC)

7.7.3 Digital input signals

Digital inputs:	3
Function:	Can be selected using software
Voltage:	24 V DC
Logic level "1":	>14 V DC
Logic level "0":	< 8 V DC
Input current:	typ. 2.5 mA (at 24 V DC)

7.7.4 Analogue output signals

7.7.4.1 Actual value

Output signal:	0/4 - 20 mA; 0 – 10 V DC (selectable using software)
Output type:	Active (AD5412)
Accuracy:	$\leq \pm 1\%$ of full flow
Temperature drift:	$\leq \pm 0.1\% / 10^\circ\text{K}$
Load resistor:	$\leq 750\text{ k}\Omega$
Resolution:	10 bit
Overload proof:	Yes (up to $\pm 24\text{ V DC}$)
Short-circuit proof:	Yes

7.7.5 Digital output signals

7.7.5.1 Switching outputs 1 and 2

Design:	2x make contact, potential-free
Switching voltage:	max. 48 V DC / 48 V AC
Switch rating:	max. 60 W / 2A
Switch points:	Adjustable 0 - 100 %

7.7.5.2 Switching output 3

Function:	Signal fault
Type of contact:	Push-Pull
Switching voltage:	Supply voltage
Switching current:	$\leq 0.1\text{ A}$
Drop voltage:	Max. 2.5 V DC at 0.1 A
Overload proof:	Yes (up to $\pm 24\text{ V DC}$)
Short-circuit proof:	Yes
Pull-Down resistance:	120 k Ω

7.7.6 Communication eSy-Web

Interface:	Ethernet
Function:	Parameterisation via web browser
IP address:	192.168.2.1 alterable via web browser
Subnet screen:	255.255.252.0 alterable via web browser

The actuator and the PC must be in the same network to use the web server. The IP address of the actuator is entered in the web browser and the actuator can then be parametrised. In order to use more than one actuator, a definitive IP address must be assigned to each actuator in the same network.

7.7.7 Communication Modus TCP

Interface: Modbus TCP

IP address: 192.168.2.1 alterable via web browser

Subnet screen: 255.255.252.0 alterable via web browser

Port: 502

Supported function codes:

Code Dezimal	Code Hex	Function
3	0x03	Read Holding Registers
4	0x04	Read Input Registers
6	0x06	Write Single Register
16	0x10	Write Multiple Registers
23	0x17	Read / Write Multiple Registers

7.7.8 Behaviour in the event of an error


Function: In the event of an error the valve moves to the error position.

Notes: Moving to the error position is only possible with full power supply. This behaviour is not a safety position. The valve must be operated with a GEMÜ 1571 emergency power supply module (see accessories) to ensure the function in case of voltage loss.

Error position: Closed, open or hold (adjustable via eSy-web web interface).

8 Dimensions

8.1 Actuator dimensions

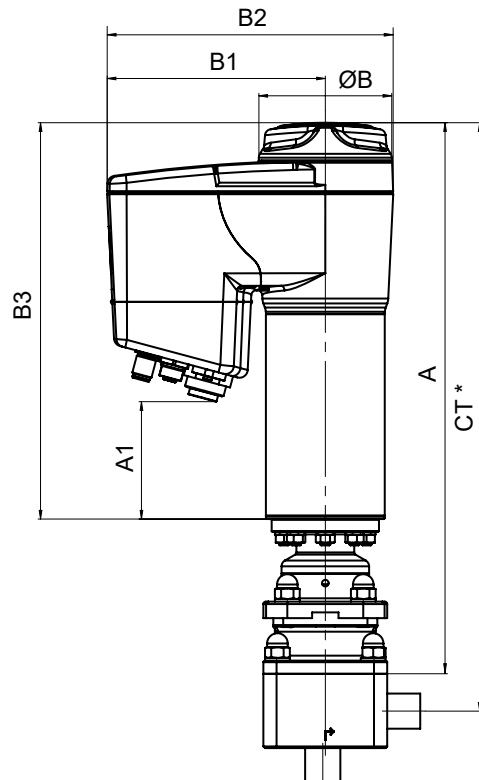

DN	Actuator size	A	A1	ØB	B1	B2	B3
8 - 20	2	263.7	44.0	68.0	126.0	160.0	190.0


DN	Actuator size	A	A1	ØB	B1	B2	B3
20 - 25	3	351.5	83.0	82.0	132.0	172.0	250.0
32 - 50	4	411.5	124.0	134.0	157.0	224.0	296.0
50 - 65	5	433.0	124.0	134.0	157.0	224.0	296.0

Dimensions in mm

* CT = A + H1 (see body dimensions)

8.2 Body dimensions

8.2.1 Spigot without bypass code 0

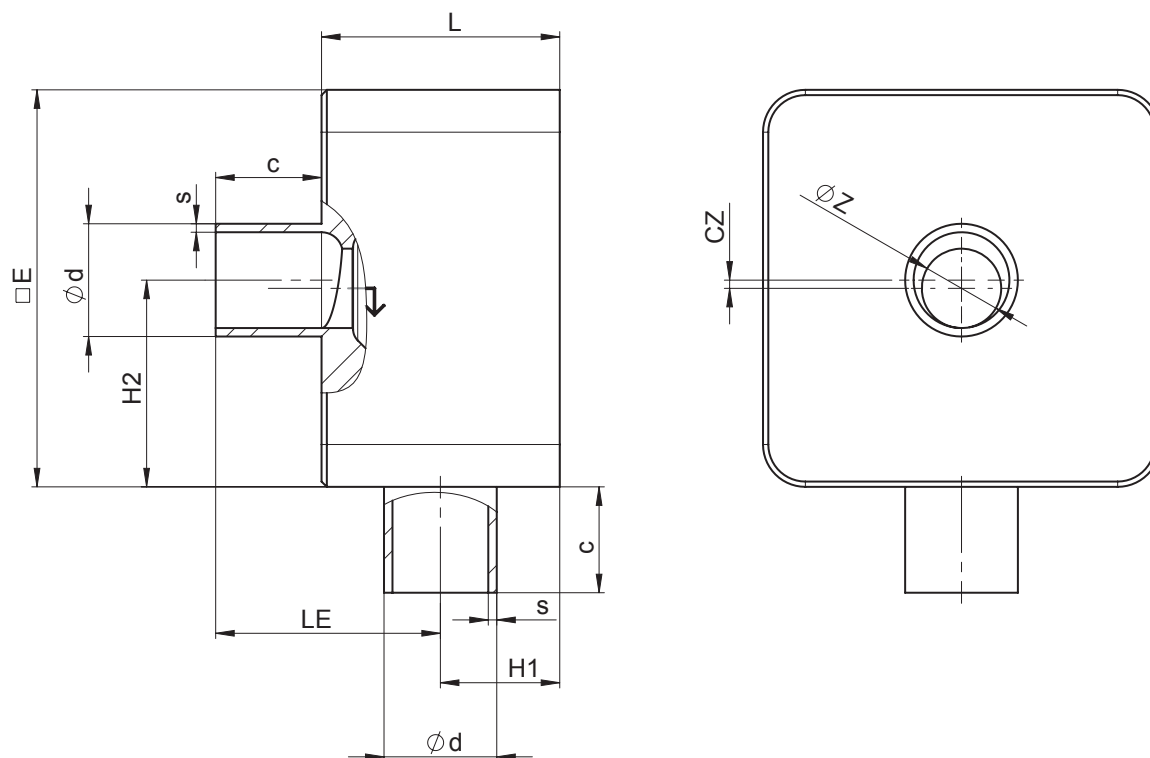


AG	DN	Connection type code 0 ¹⁾										
		Seat size (code)	L	□E	c	Øz	LE	H1	H2	cz	Ød	s
2	15	A	45.0	75.0	20.0	2.0	44.0	21.0	40.5	6.5	18.0	1.5
		B	45.0	75.0	20.0	4.0	44.0	21.0	39.5	5.5	18.0	1.5
		C	45.0	75.0	20.0	6.0	44.0	21.0	38.5	4.5	18.0	1.5
		D	45.0	75.0	20.0	8.0	44.0	21.0	41.0	3.5	18.0	1.5
		E	45.0	75.0	20.0	10.0	44.0	21.0	40.0	2.5	18.0	1.5
		G	45.0	75.0	20.0	15.0	44.0	21.0	37.5	0.0	18.0	1.5
3	20	H	55.0	95.0	25.0	20.0	54.0	26.0	50.0	0.0	22.0	1.5
	25	H	55.0	95.0	25.0	20.0	54.0	26.0	50.0	2.5	28.0	1.5
		J	55.0	95.0	25.0	25.0	54.0	26.0	47.5	0.0	28.0	1.5

Dimensions in mm

AG = actuator size

1) **Connection type**

Code 0: Spigot DIN

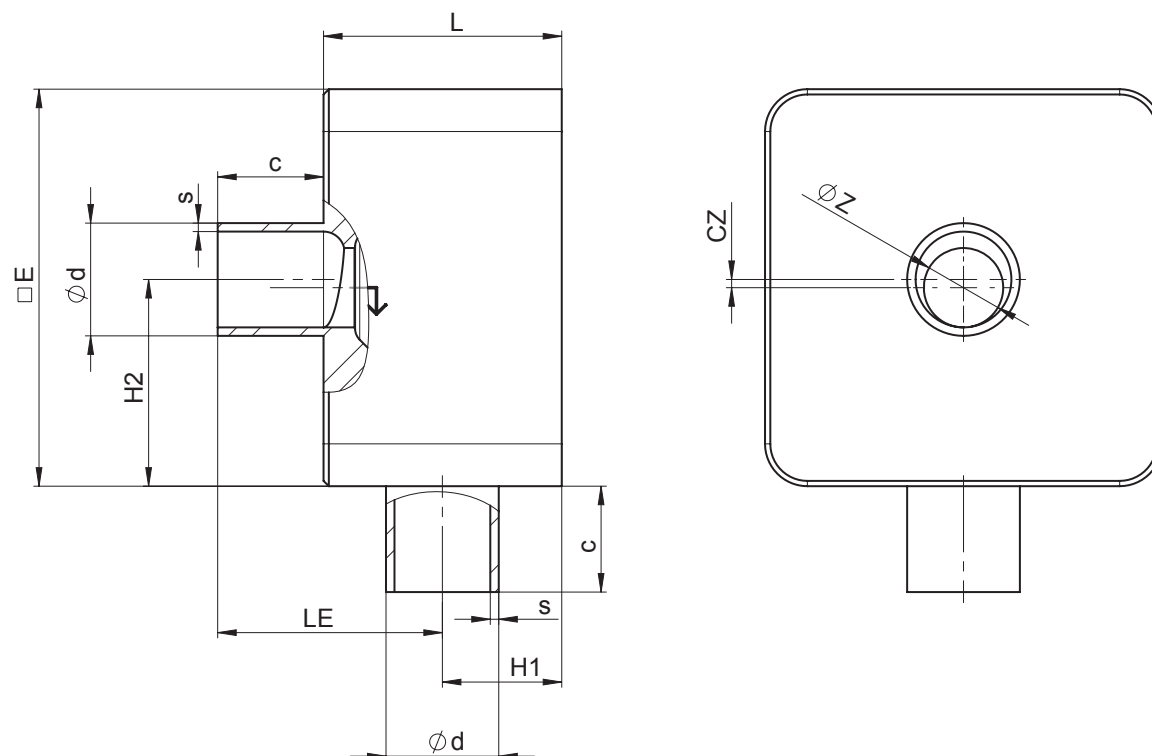8.2.2 Spigot without bypass code 17

AG	DN	Connection type code 17 ¹⁾										
		Seat size (code)	L	□E	c	Øz	LE	H1	H2	cz	Ød	s
2	8	A	45.0	75.0	20.0	2.0	47.5	17.5	40.5	3.0	10.0	1.0
		B	45.0	75.0	20.0	4.0	47.5	17.5	39.5	2.0	10.0	1.0
		C	45.0	75.0	20.0	6.0	47.5	17.5	38.5	1.0	10.0	1.0
	10	A	45.0	75.0	20.0	2.0	46.5	18.5	41.5	4.0	13.0	1.5
		B	45.0	75.0	20.0	4.0	46.5	18.5	40.5	3.0	13.0	1.5
		C	45.0	75.0	20.0	6.0	46.5	18.5	39.5	2.0	13.0	1.5
		D	45.0	75.0	20.0	8.0	46.5	18.5	38.5	1.0	13.0	1.5
	15	A	45.0	75.0	20.0	2.0	43.5	21.5	44.5	7.0	19.0	1.5
		B	45.0	75.0	20.0	4.0	43.5	21.5	43.5	6.0	19.0	1.5
		C	45.0	75.0	20.0	6.0	43.5	21.5	42.5	5.0	19.0	1.5
		D	45.0	75.0	20.0	8.0	43.5	21.5	41.5	4.0	19.0	1.5
		E	45.0	75.0	20.0	10.0	43.5	21.5	40.5	3.0	19.0	1.5
		G	45.0	75.0	20.0	15.0	43.5	21.5	38.0	0.5	19.0	1.5
3	20	H	55.0	95.0	25.0	20.0	56.5	23.5	47.5	0.0	23.0	1.5
	25	H	55.0	95.0	25.0	20.0	53.5	26.5	50.5	3.0	29.0	1.5
		J	55.0	95.0	25.0	25.0	53.5	26.5	48.0	0.5	29.0	1.5


Dimensions in mm

AG = actuator size

1) Connection type

Code 17: Spigot EN 10357 series A (formerly DIN 11850 series 2)/DIN 11866 series A


8.2.3 Spigot without bypass code 17

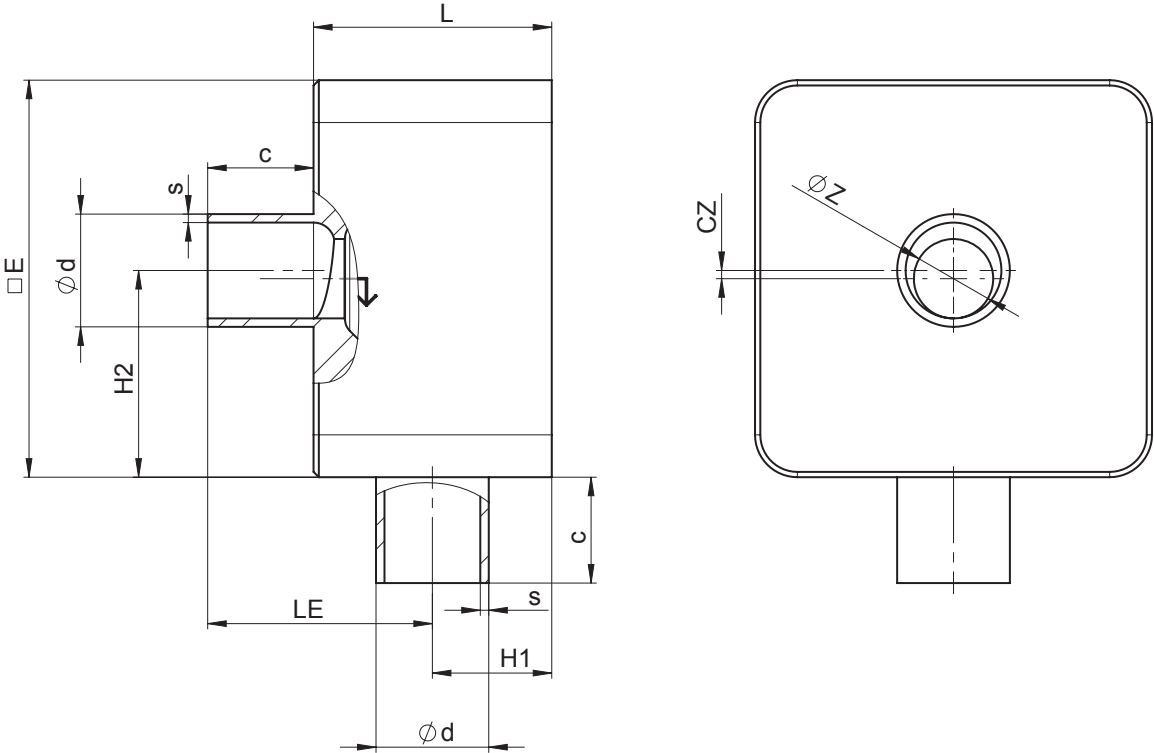

AG	DN	Connection type code 17 ¹⁾										
		Seat size (code)	L	□E	c	Øz	LE	H1	H2	cz	Ød	s
4	32	K	73.0	112.0	20.0	32.0	62.0	31.0	54.5	1.5	38.0	1.5
	40	K	73.0	112.0	20.0	32.0	60.4	32.6	53.0	3.0	41.0	1.5
		M	73.0	112.0	20.0	38.0	60.4	32.6	56.0	0.0	41.0	1.5
5	50	N	84.0	140.0	20.0	50.0	65.4	38.6	90.0	0.0	53.0	1.5

Dimensions in mm
AG = actuator size

1) **Connection type**
Code 17: Spigot EN 10357 series A (formerly DIN 11850 series 2)/DIN 11866 series A

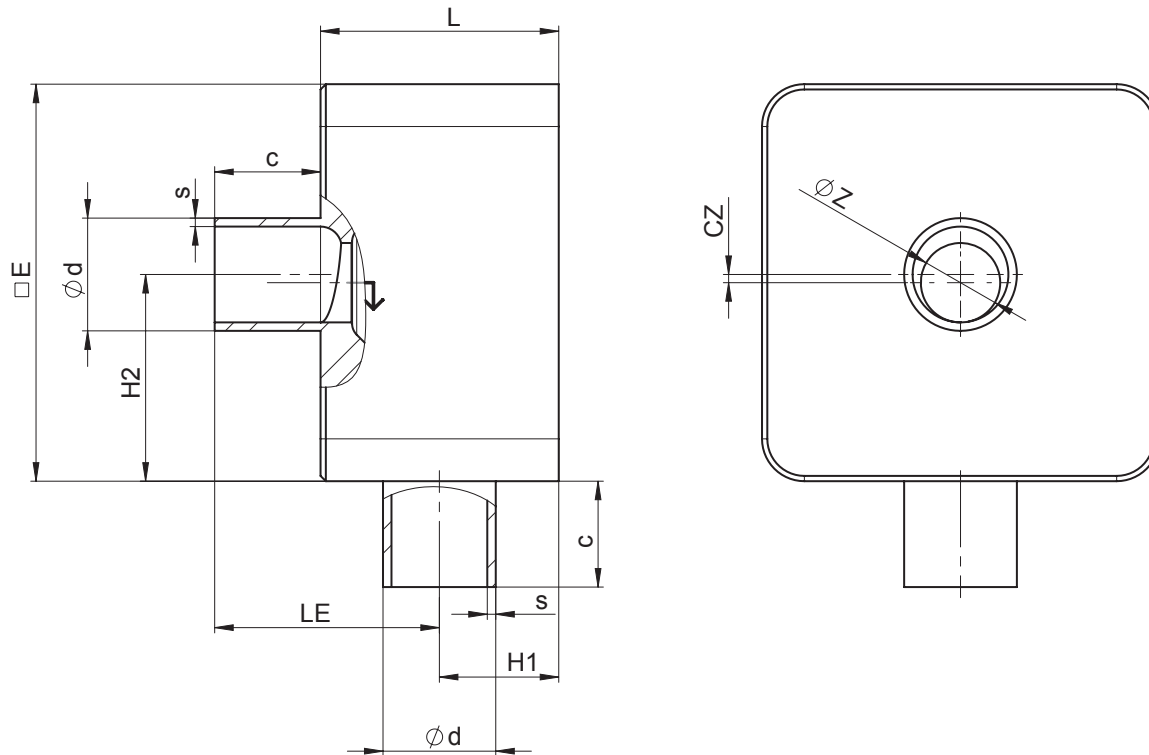8.2.4 Spigot without bypass code 59

AG	DN	Connection type code 59 ¹⁾										
		Seat size (code)	L	□E	c	Øz	LE	H1	H2	cz	Ød	s
2	15	A	45.0	75.0	20.0	2.0	46.8	18.2	41.20	3.70	12.70	1.65
		B	45.0	75.0	20.0	4.0	46.8	18.2	40.20	2.70	12.70	1.65
		C	45.0	75.0	20.0	6.0	46.8	18.2	39.20	1.70	12.70	1.65
		D	45.0	75.0	20.0	8.0	46.8	18.2	38.20	0.70	12.70	1.65
	20	A	45.0	75.0	20.0	2.0	48.6	21.4	44.38	6.88	19.05	1.65
		B	45.0	75.0	20.0	4.0	43.6	21.4	43.38	5.88	19.05	1.65
		C	45.0	75.0	20.0	6.0	43.6	21.4	42.38	4.88	19.05	1.65
		D	45.0	75.0	20.0	8.0	43.6	21.4	41.38	3.88	19.05	1.65
		E	45.0	75.0	20.0	10.0	43.6	21.4	40.38	2.88	19.05	1.65
		G	45.0	75.0	20.0	15.0	43.6	21.4	37.88	0.38	19.05	1.65
3	25	H	55.0	95.0	25.0	20.0	55.4	24.6	48.60	1.10	25.40	1.65


Dimensions in mm

AG = actuator size

1) Connection type

Code 59: Spigot ASME BPE / DIN 11866 series C

8.2.5 Spigot without bypass code 59

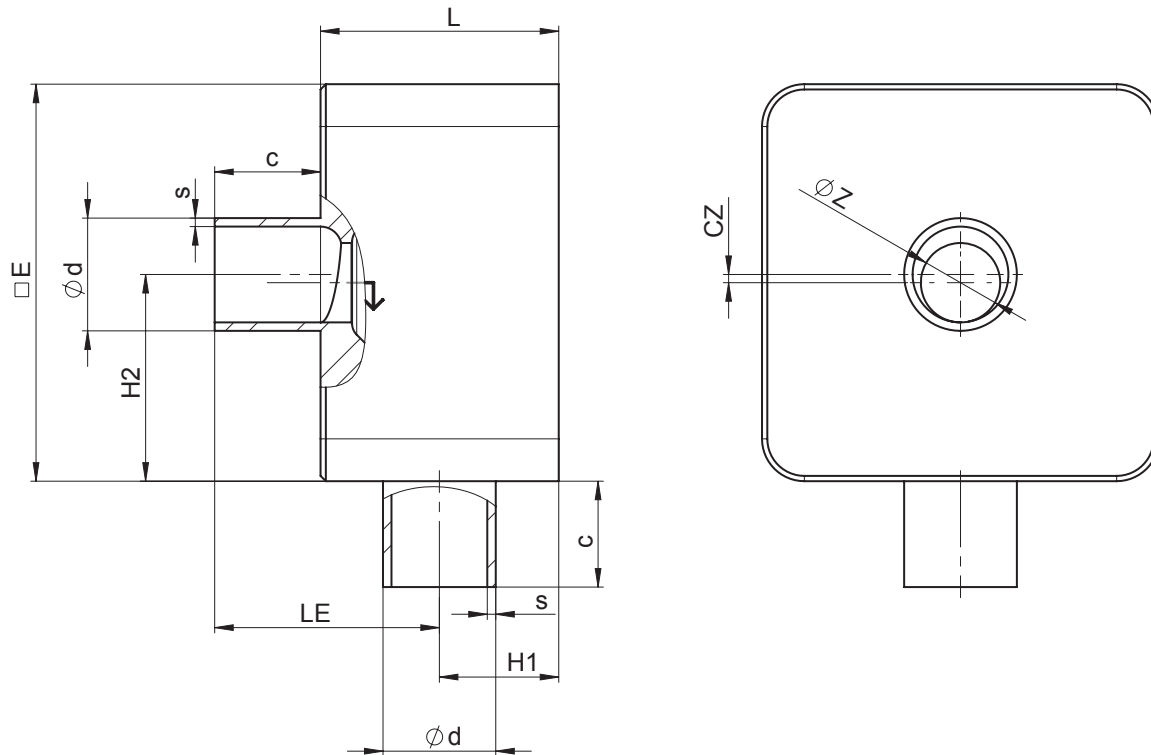


AG	DN	Connection type code 59 ¹⁾										
		Seat size (code)	L	□E	c	Øz	LE	H1	H2	cz	Ød	s
4	40	K	73.0	112.0	20.0	32.0	62.0	31.0	54.6	1.4	38.1	1.65
	50	K	73.0	112.0	20.0	32.0	55.6	37.4	48.25	7.75	50.8	1.65
		M	73.0	112.0	20.0	38.0	55.6	37.4	51.25	4.75	50.8	1.65
5	65	N	84.0	140.0	20.0	50.0	60.3	43.7	84.9	5.1	63.5	1.65

Dimensions in mm

AG = actuator size

1) Connection type

Code 59: Spigot ASME BPE / DIN 11866 series C

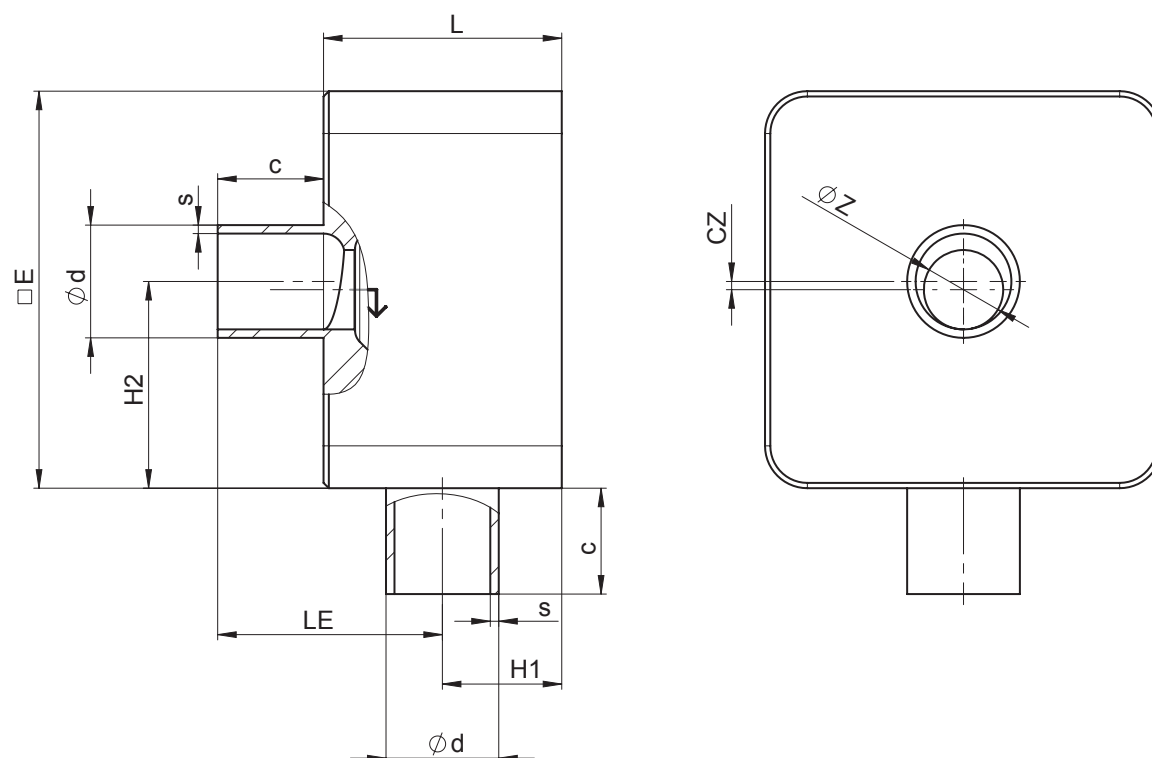8.2.6 Spigot without bypass code 60

AG	DN	Connection type code 60 ¹⁾										
		Seat size (code)	L	□E	c	Øz	LE	H1	H2	cz	Ød	s
2	8	A	45.0	75.0	20.0	2.0	46.3	18.7	41.65	4.15	13.5	1.6
		B	45.0	75.0	20.0	4.0	46.3	18.7	40.65	3.15	13.5	1.6
		C	45.0	75.0	20.0	6.0	46.3	18.7	39.65	2.15	13.5	1.6
	10	A	45.0	75.0	20.0	2.0	44.5	20.5	43.50	6.00	17.2	1.6
		B	45.0	75.0	20.0	4.0	44.5	20.5	42.50	5.00	17.2	1.6
		C	45.0	75.0	20.0	6.0	44.5	20.5	41.50	4.00	17.2	1.6
		D	45.0	75.0	20.0	8.0	44.5	20.5	40.50	3.00	17.2	1.6
	15	A	45.0	75.0	20.0	2.0	42.4	22.6	45.55	8.05	21.3	1.6
		B	45.0	75.0	20.0	4.0	42.4	22.6	44.55	7.05	21.3	1.6
		C	45.0	75.0	20.0	6.0	42.4	22.6	43.55	6.05	21.3	1.6
		D	45.0	75.0	20.0	8.0	42.4	22.6	42.55	5.05	21.3	1.6
		E	45.0	75.0	20.0	10.0	42.4	22.6	41.55	4.05	21.3	1.6
3	20	H	55.0	95.0	25.0	20.0	54.6	25.4	49.40	1.90	29.6	1.6
	25	H	55.0	95.0	25.0	20.0	54.6	28.4	52.40	4.90	33.7	2.0
		J	55.0	95.0	25.0	25.0	51.6	28.4	49.90	2.40	33.7	2.0


Dimensions in mm

AG = actuator size

1) Connection type

Code 60: Spigot ISO 1127/EN 10357 series C/DIN 11866 series B

8.2.7 Spigot without bypass code 60

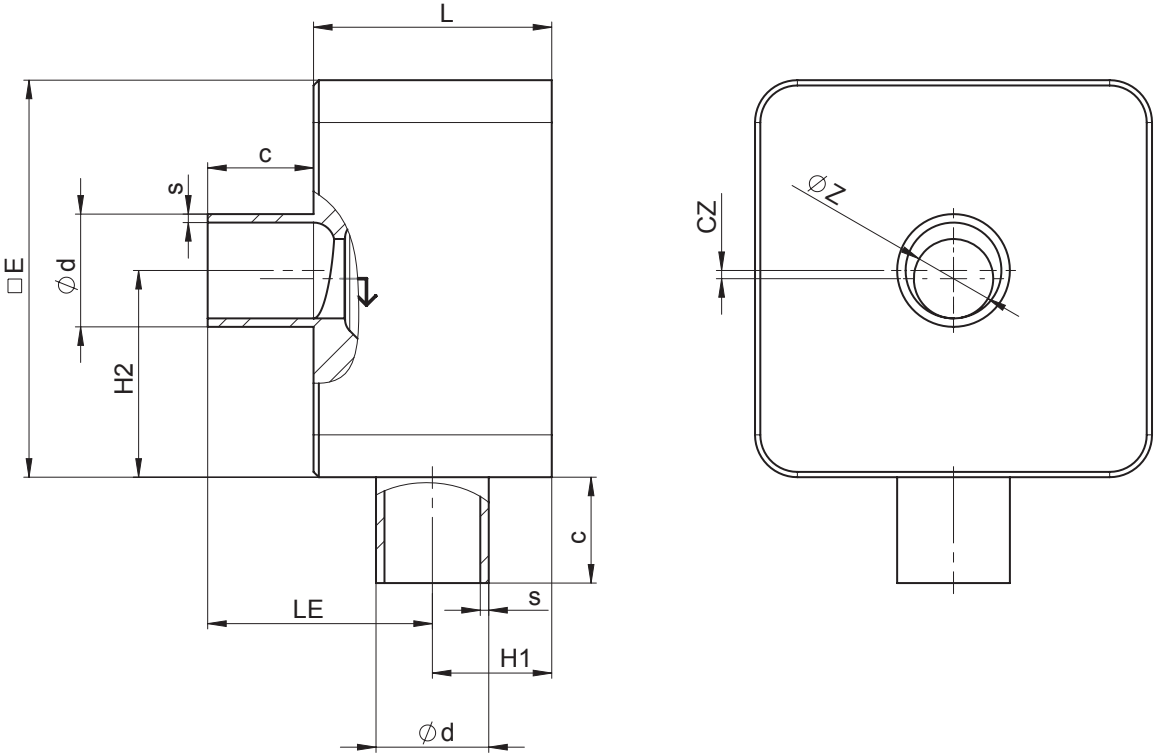


AG	DN	Connection type code 60 ¹⁾										
		Seat size (code)	L	□E	c	Øz	LE	H1	H2	cz	Ød	s
4	32	K	73.0	112.0	20.0	32.0	60.8	32.8	52.8	3.2	42.4	2.0
	40	K	73.0	112.0	20.0	32.0	57.2	35.8	49.85	6.15	48.3	2.0
		M	73.0	112.0	20.0	38.0	57.2	35.8	52.85	3.15	48.3	2.0
5	50	N	84.0	140.0	20.0	50.0	62.3	41.7	93.15	3.15	60.3	2.0

Dimensions in mm

AG = actuator size

1) Connection type

Code 60: Spigot ISO 1127/EN 10357 series C/DIN 11866 series B

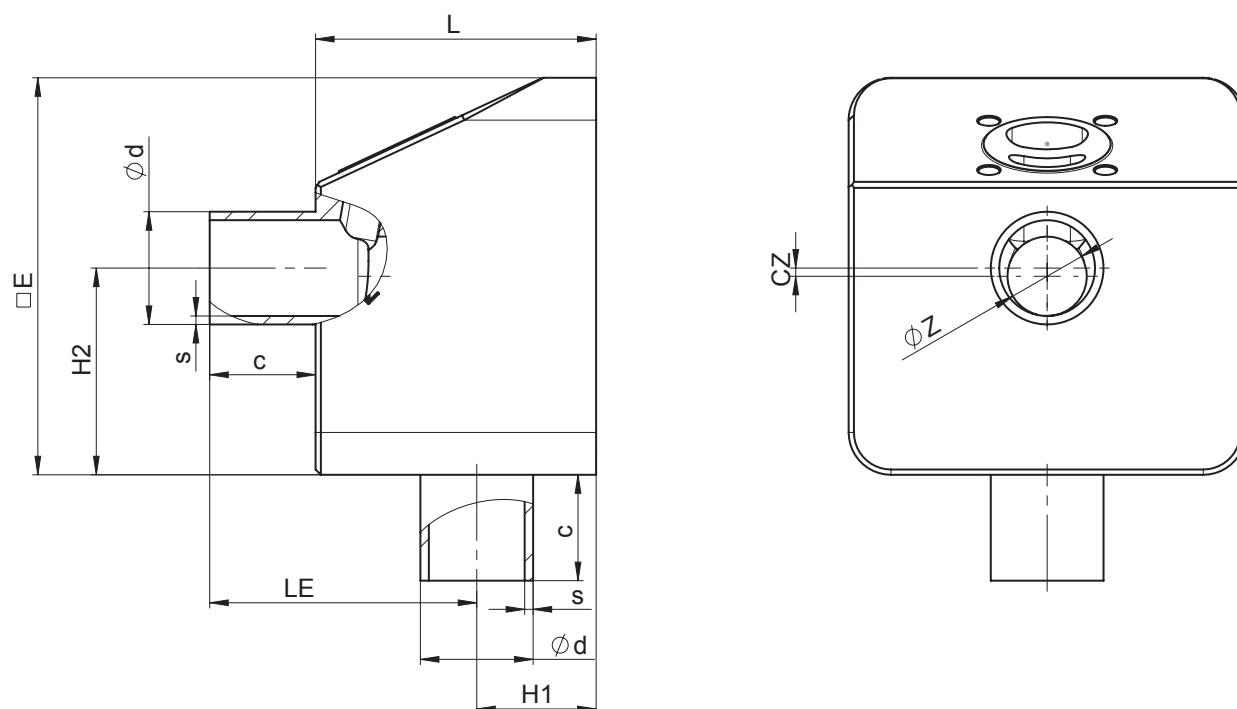8.2.8 Spigot with bypass code 0

AG	DN	Connection type code 0 ¹⁾										
		Seat size (code)	L	□E	c	Øz	LE	H1	H2	cz	Ød	s
2	15	A	53.0	75.0	20.0	2.0	52.0	21.0	44.0	6.5	18.0	1.5
		B	53.0	75.0	20.0	4.0	52.0	21.0	43.0	5.5	18.0	1.5
		C	53.0	75.0	20.0	6.0	52.0	21.0	42.0	4.5	18.0	1.5
		D	53.0	75.0	20.0	8.0	52.0	21.0	41.0	3.5	18.0	1.5
		E	53.0	75.0	20.0	10.0	52.0	21.0	40.0	2.5	18.0	1.5
		G	53.0	75.0	20.0	15.0	52.0	21.0	37.5	-	18.0	1.5


Dimensions in mm

AG = actuator size

1) **Connection type**

Code 0: Spigot DIN

8.2.9 Spigot with bypass code 17

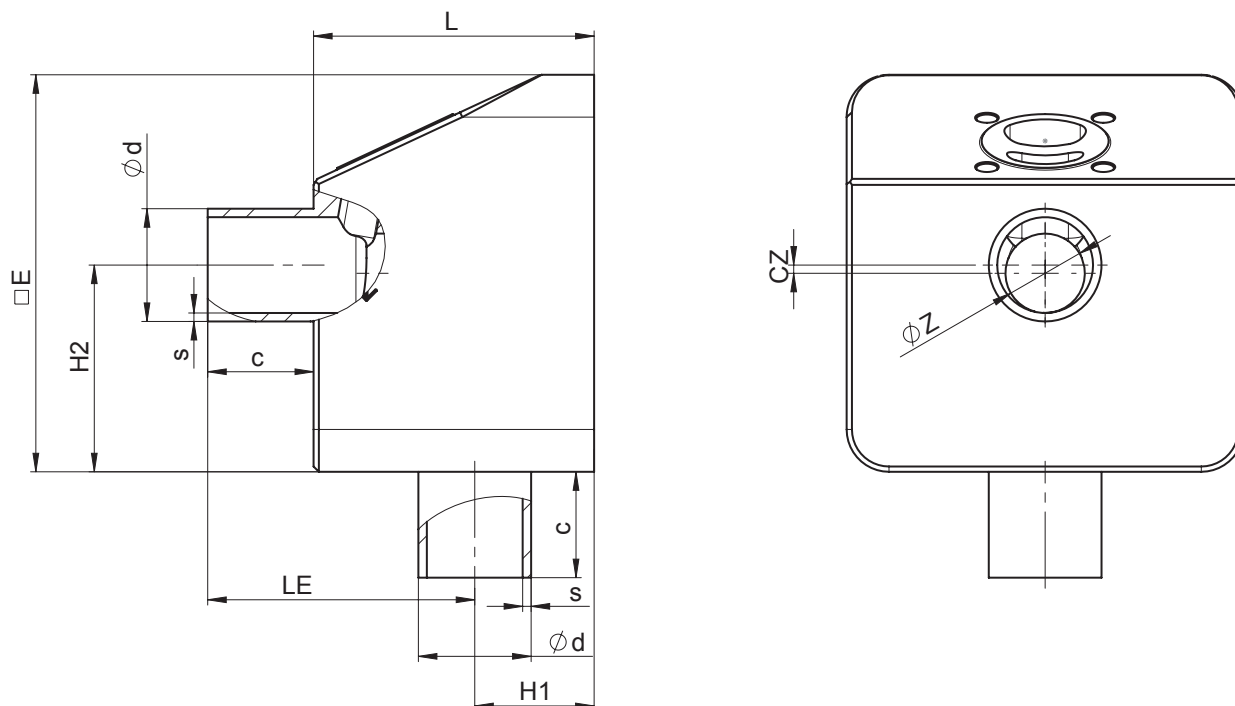


AG	DN	Connection type code 17 ¹⁾										
		Seat size (code)	L	□E	c	Øz	LE	H1	H2	cz	Ød	s
2	8	A	53.0	75.0	20.0	2.0	55.5	17.5	40.5	3.0	10.0	1.0
		B	53.0	75.0	20.0	4.0	55.5	17.5	39.5	2.0	10.0	1.0
		C	53.0	75.0	20.0	6.0	55.5	17.5	38.5	1.0	10.0	1.0
	10	A	53.0	75.0	20.0	2.0	54.5	18.5	41.5	4.0	13.0	1.5
		B	53.0	75.0	20.0	4.0	54.5	18.5	40.5	3.0	13.0	1.5
		C	53.0	75.0	20.0	6.0	54.5	18.5	39.5	2.0	13.0	1.5
		D	53.0	75.0	20.0	8.0	54.5	18.5	38.5	1.0	13.0	1.5
	15	A	53.0	75.0	20.0	2.0	51.5	21.5	44.5	7.0	19.0	1.5
		B	53.0	75.0	20.0	4.0	51.5	21.5	43.5	6.0	19.0	1.5
		C	53.0	75.0	20.0	6.0	51.5	21.5	42.5	5.0	19.0	1.5
		D	53.0	75.0	20.0	8.0	51.5	21.5	41.5	4.0	19.0	1.5
		E	53.0	75.0	20.0	10.0	51.5	21.5	40.5	3.0	19.0	1.5
		G	53.0	75.0	20.0	15.0	51.5	21.5	38.0	0.5	19.0	1.5

Dimensions in mm

AG = actuator size

1) Connection type

Code 17: Spigot EN 10357 series A (formerly DIN 11850 series 2)/DIN 11866 series A

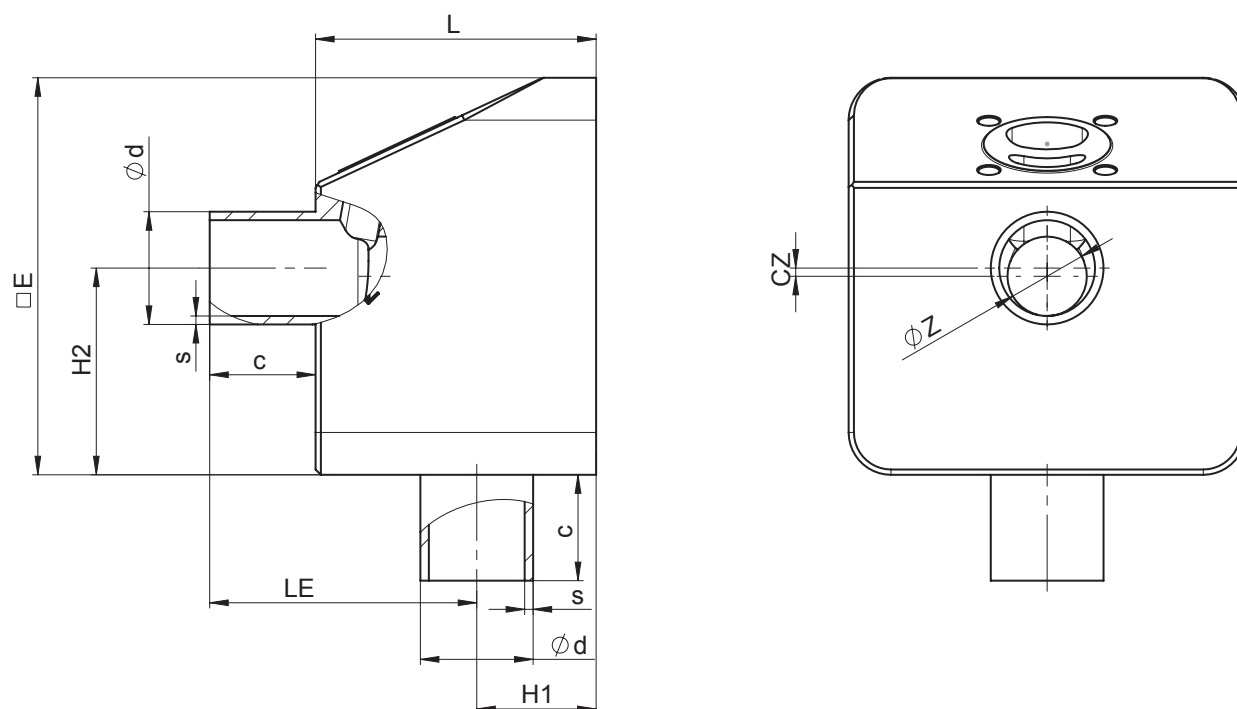8.2.10 Spigot with bypass code 59

AG	DN	Connection type code 59 ¹⁾										
		Seat size (code)	L	□E	c	Øz	LE	H1	H2	cz	Ød	s
2	15	A	53.0	75.0	20.0	2.0	54.8	18.2	41.20	3.70	12.70	1.65
		B	53.0	75.0	20.0	4.0	54.8	18.2	40.20	2.70	12.70	1.65
		C	53.0	75.0	20.0	6.0	54.8	18.2	39.20	1.70	12.70	1.65
		D	53.0	75.0	20.0	8.0	54.8	18.2	38.20	0.70	12.70	1.65
	20	A	53.0	75.0	20.0	2.0	51.6	21.4	44.38	3.70	12.70	1.65
		B	53.0	75.0	20.0	4.0	51.6	21.4	43.38	2.70	12.70	1.65
		C	53.0	75.0	20.0	6.0	51.6	21.4	42.38	1.70	12.70	1.65
		D	53.0	75.0	20.0	8.0	51.6	21.4	41.38	0.70	12.70	1.65
		E	53.0	75.0	20.0	10.0	51.6	21.4	40.38	2.88	19.05	1.65
		G	53.0	75.0	20.0	15.0	51.6	21.4	37.88	0.38	19.05	1.65


Dimensions in mm

AG = actuator size

1) **Connection type**

Code 59: Spigot ASME BPE / DIN 11866 series C

8.2.11 Spigot with bypass code 60

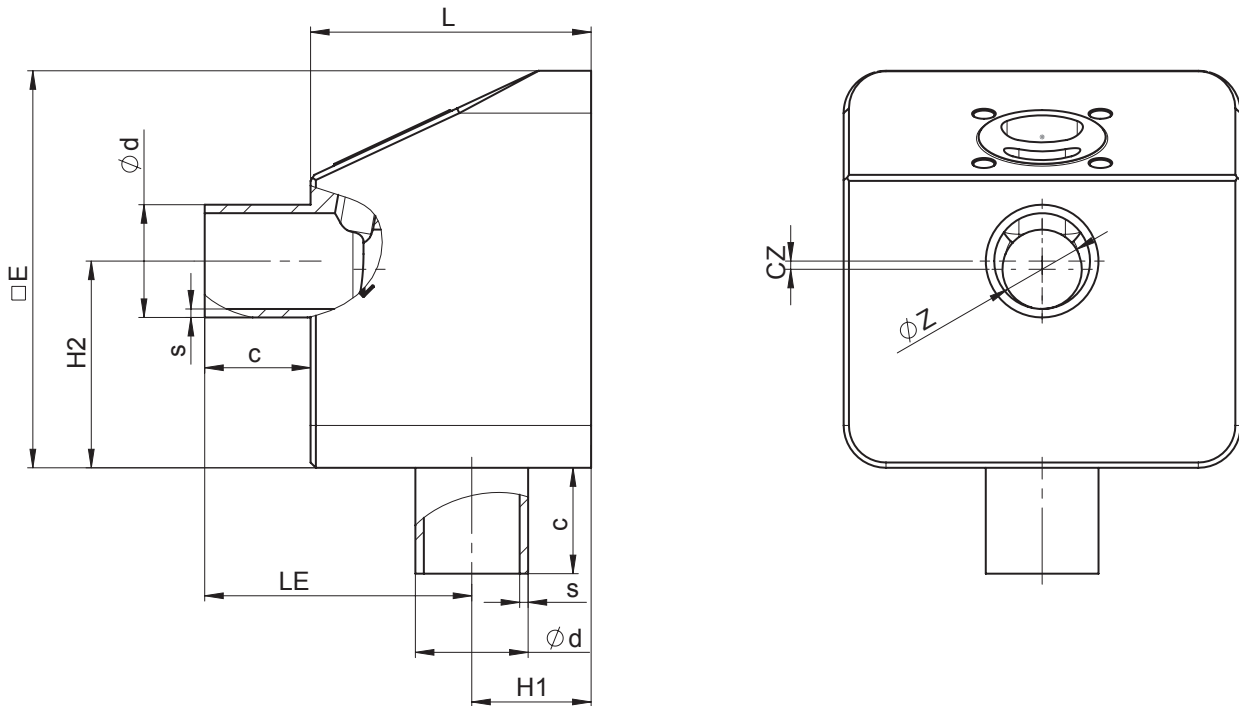


AG	DN	Connection type code 60 ¹⁾										
		Seat size (code)	L	□E	c	Øz	LE	H1	H2	cz	Ød	s
2	8	A	53.0	75.0	20.0	2.0	54.3	18.7	41.65	4.15	13.5	1.6
		B	53.0	75.0	20.0	4.0	54.3	18.7	40.65	3.15	13.5	1.6
		C	53.0	75.0	20.0	6.0	54.3	18.7	39.65	2.15	13.5	1.6
	10	A	53.0	75.0	20.0	2.0	52.5	20.7	43.50	6.00	17.2	1.6
		B	53.0	75.0	20.0	4.0	52.5	20.7	42.50	5.00	17.2	1.6
		C	53.0	75.0	20.0	6.0	52.5	20.5	41.50	4.00	17.2	1.6
		D	53.0	75.0	20.0	8.0	52.5	20.5	40.50	3.00	17.2	1.6
	15	A	53.0	75.0	20.0	2.0	50.4	22.6	45.55	8.05	21.3	1.6
		B	53.0	75.0	20.0	4.0	50.4	22.6	44.55	7.05	21.3	1.6
		C	53.0	75.0	20.0	6.0	50.4	22.6	43.55	6.05	21.3	1.6
		D	53.0	75.0	20.0	8.0	50.4	22.6	42.55	5.05	21.3	1.6
		E	53.0	75.0	20.0	10.0	50.4	22.6	41.55	4.05	21.3	1.6
		G	53.0	75.0	20.0	15.0	50.4	22.6	39.05	1.55	21.3	1.6

Dimensions in mm

AG = actuator size

1) Connection type

Code 60: Spigot ISO 1127/EN 10357 series C/DIN 11866 series B

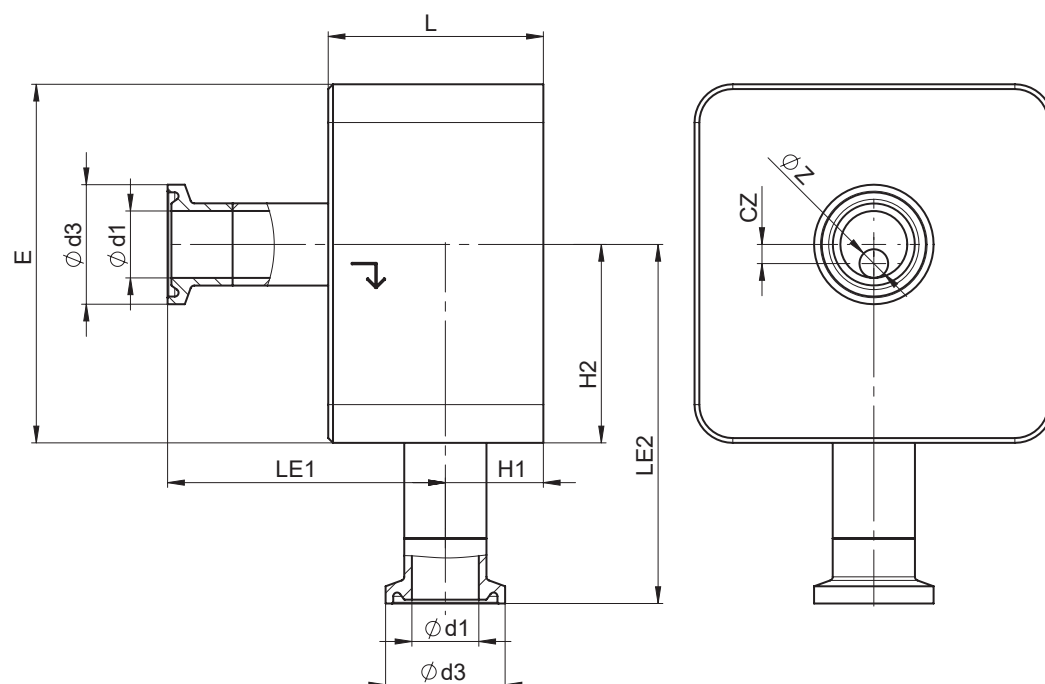8.2.12 Clamp without bypass code 82

AG	DN	Connection type code 82 ¹⁾										
		Seat size (code)	L	□E	Øz	LE1	LE2	H1	H2	cz	Ød1	Ød3
2	8	A	45.0	75.0	2.0	59.3	74.65	18.7	41.65	4.15	10.3	25.4
		B	45.0	75.0	4.0	59.3	73.65	18.7	40.65	3.15	10.3	25.4
		C	45.0	75.0	6.0	59.3	72.65	18.7	39.65	2.15	10.3	25.4
	10	A	45.0	75.0	2.0	57.5	76.50	20.5	43.50	6.00	14.0	25.4
		B	45.0	75.0	4.0	57.5	75.50	20.5	42.50	5.00	14.0	25.4
		C	45.0	75.0	6.0	57.5	74.50	20.5	41.50	4.00	14.0	25.4
		D	45.0	75.0	8.0	57.5	73.50	20.5	40.50	3.00	14.0	25.4
	15	A	45.0	75.0	2.0	55.4	78.55	22.6	45.55	8.05	18.1	50.5
		B	45.0	75.0	4.0	55.4	77.55	22.6	44.55	7.05	18.1	50.5
		C	45.0	75.0	6.0	55.4	76.55	22.6	43.55	6.05	18.1	50.5
		D	45.0	75.0	8.0	55.4	75.55	22.6	42.55	5.05	18.1	50.5
		E	45.0	75.0	10.0	55.4	74.55	22.6	41.55	4.05	18.1	50.5
		G	45.0	75.0	15.0	55.4	72.05	22.6	39.05	1.55	18.1	50.5
3	20	H	55.0	95.0	20.0	66.0	87.40	27.0	49.40	1.90	19.0	50.5
	25	H	55.0	95.0	20.0	62.6	90.40	30.4	52.40	4.90	25.0	50.5
		J	55.0	95.0	25.0	62.6	87.90	30.4	49.90	2.40	25.0	50.5


Dimensions in mm

AG = actuator size

1) Connection type

Code 82: Clamp DIN 32676 series B

8.2.13 Clamp without bypass code 82

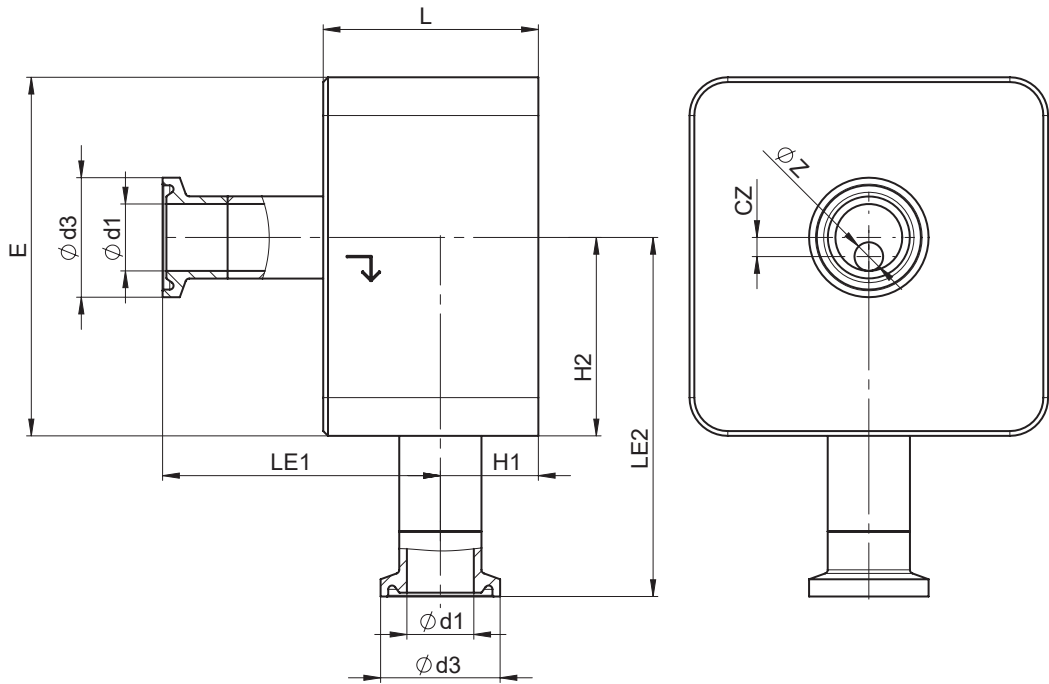


AG	DN	Connection type code 82 ¹⁾										
		Seat size (code)	L	□E	Øz	LE1	LE2	H1	H2	cz	Ød1	Ød3
4	32	K	73.0	112.0	32.0	73.8	85.8	32.8	52.8	3.2	38.4	64.0
	40	K	73.0	112.0	32.0	70.2	82.85	35.8	49.85	6.15	44.3	64.0
		M	73.0	112.0	38.0	70.2	85.85	35.8	52.85	3.15	44.3	64.0
5	50	N	84.0	140.0	50.0	75.3	126.15	41.7	93.15	3.15	56.3	77.5

Dimensions in mm

AG = actuator size

1) Connection type

Code 82: Clamp DIN 32676 series B

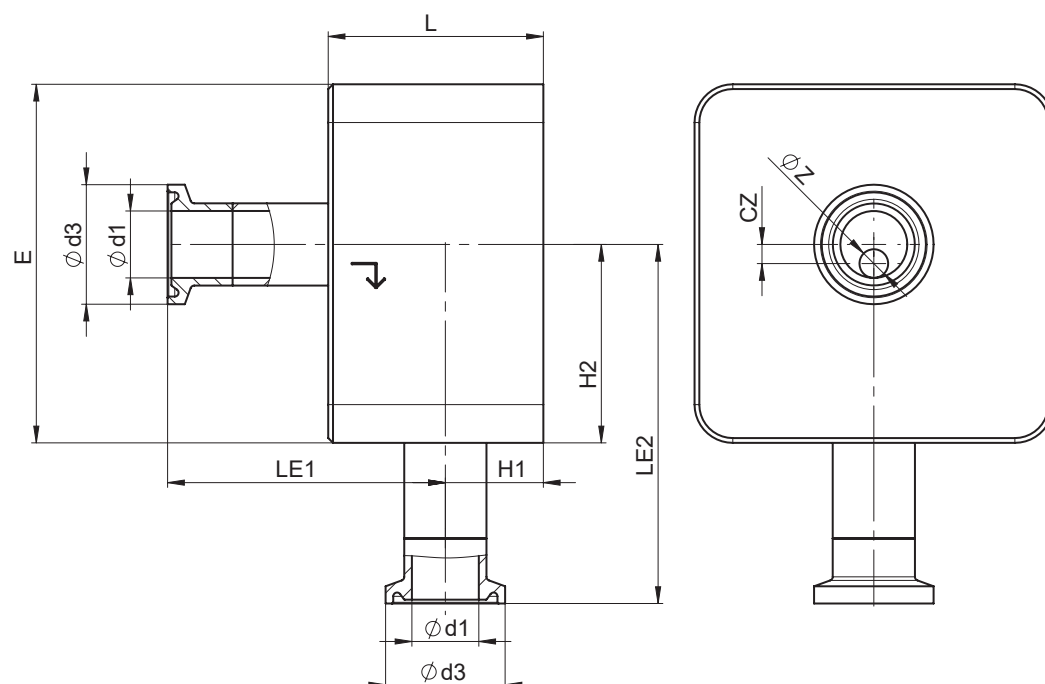8.2.14 Clamp without bypass code 86

AG	DN	Connection type code 86 ¹⁾										
		Seat size (code)	L	□E	Øz	LE1	LE2	H1	H2	cz	Ød1	Ød3
2	8	A	45.0	75.0	2.0	60.5	73.5	17.5	40.5	3.0	8.0	25.0
		B	45.0	75.0	4.0	60.5	72.5	17.5	39.5	2.0	8.0	25.0
		C	45.0	75.0	6.0	60.5	71.5	17.5	38.5	1.0	8.0	25.0
	10	A	45.0	75.0	2.0	59.5	74.5	18.5	41.5	4.0	10.0	34.0
		B	45.0	75.0	4.0	59.5	73.5	18.5	40.5	3.0	10.0	34.0
		C	45.0	75.0	6.0	59.5	72.5	18.5	39.5	2.0	10.0	34.0
		D	45.0	75.0	8.0	59.5	71.5	18.5	38.5	1.0	10.0	34.0
	15	A	45.0	75.0	2.0	56.5	77.5	21.5	44.5	7.0	16.0	34.0
		B	45.0	75.0	4.0	56.5	76.5	21.5	43.5	6.0	16.0	34.0
		C	45.0	75.0	6.0	56.5	75.5	21.5	42.5	5.0	16.0	34.0
		D	45.0	75.0	8.0	56.5	74.5	21.5	41.5	4.0	16.0	34.0
		E	45.0	75.0	10.0	56.5	73.5	21.5	40.5	3.0	16.0	34.0
		G	45.0	75.0	15.0	56.5	71.0	21.5	38.0	0.5	16.0	34.0
3	20	H	55.0	95.0	20.0	69.5	85.5	23.0	47.5	0.0	20.0	34.0
	25	H	55.0	95.0	20.0	65.0	88.0	28.1	50.0	2.5	26.0	50.5
		J	55.0	95.0	25.0	65.0	88.5	28.1	47.5	0.0	26.0	50.5


Dimensions in mm

AG = actuator size

1) Connection type

Code 86: Clamp DIN 32676 series A

8.2.15 Clamp without bypass code 86

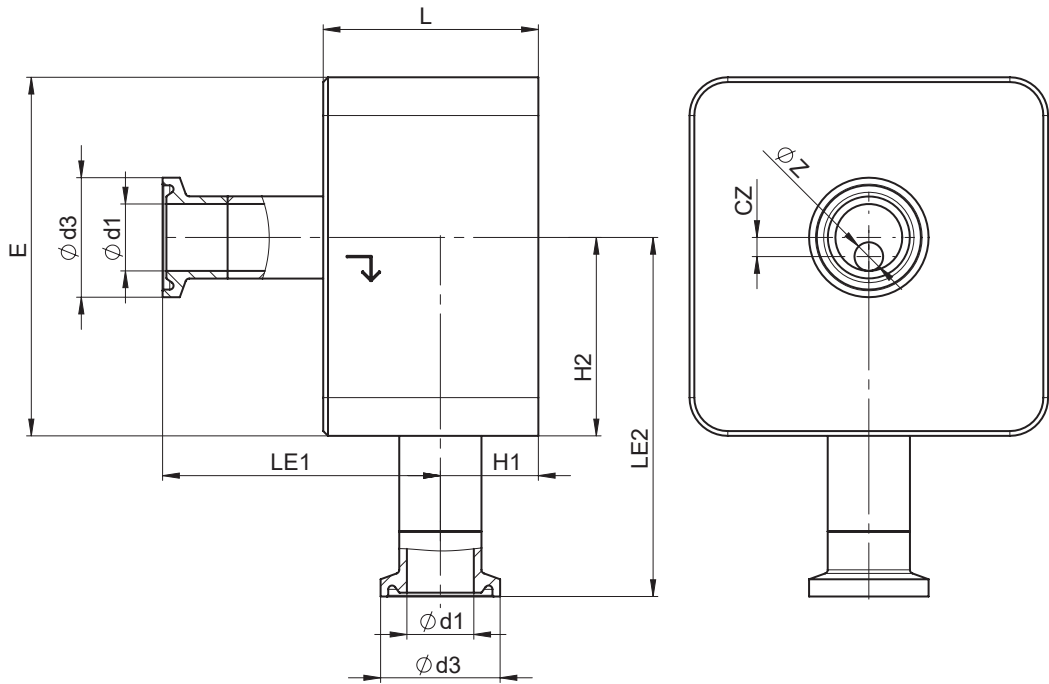


AG	DN	Connection type code 86 ¹⁾										
		Seat size (code)	L	□E	Øz	LE1	LE2	H1	H2	cz	Ød1	Ød3
4	32	K	73.0	112.0	32.0	75.0	87.5	31.0	54.5	1.5	32.0	50.5
	40	K	73.0	112.0	32.0	73.4	86.0	32.6	53.0	3.0	38.0	50.5
		M	73.0	112.0	38.0	73.4	89.0	32.6	56.0	0.0	38.0	50.5
5	50	N	84.0	140.0	50.0	78.4	123.0	38.6	90.0	0.0	50.0	64.0

Dimensions in mm

AG = actuator size

1) Connection type

Code 86: Clamp DIN 32676 series A

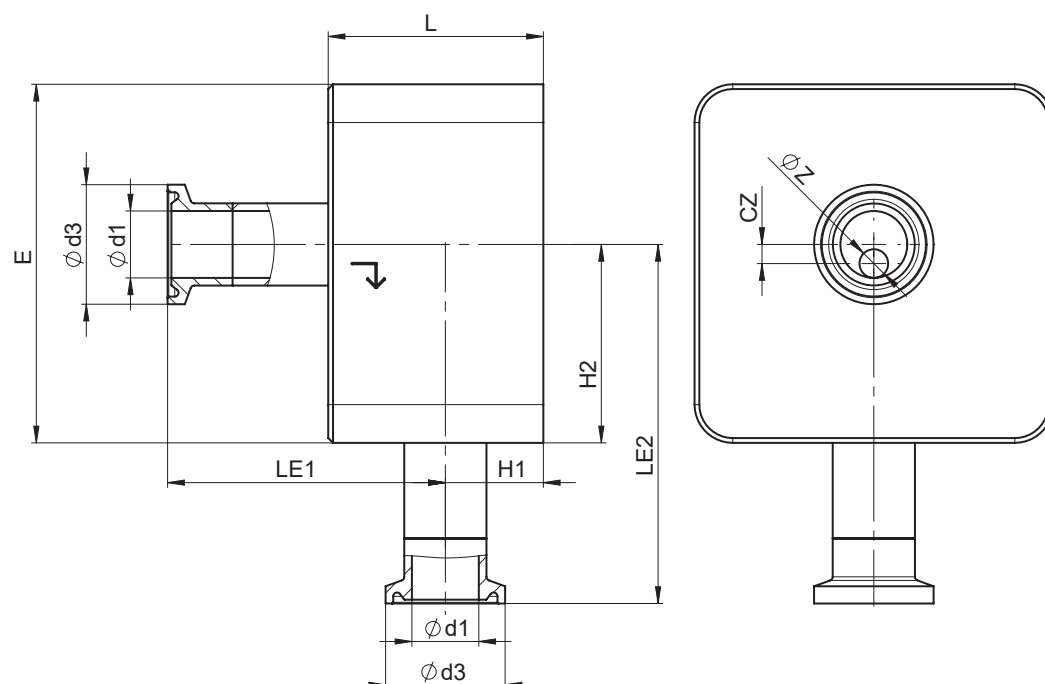8.2.16 Clamp without bypass code 88

AG	DN	Connection type code 88 ¹⁾										
		Seat size (code)	L	□E	Øz	LE1	LE2	H1	H2	cz	Ød1	Ød3
2	15	A	45.0	75.0	2.0	59.8	74.20	18.2	41.20	3.70	9.40	25.0
		B	45.0	75.0	4.0	59.8	73.20	18.2	40.20	2.70	9.40	25.0
		C	45.0	75.0	6.0	59.8	72.20	18.2	39.20	1.70	9.40	25.0
		D	45.0	75.0	8.0	59.8	71.20	18.2	38.20	0.70	9.40	25.0
	20	A	45.0	75.0	2.0	56.5	77.38	21.4	44.38	6.88	15.75	25.0
		B	45.0	75.0	4.0	56.5	76.38	21.4	43.38	5.88	15.75	25.0
		C	45.0	75.0	6.0	56.5	75.38	21.4	42.38	4.88	15.75	25.0
		D	45.0	75.0	8.0	56.5	74.38	21.4	41.38	3.88	15.75	25.0
		E	45.0	75.0	10.0	56.5	73.38	21.4	40.38	2.88	15.75	25.0
		G	45.0	75.0	15.0	56.5	70.88	21.4	37.88	0.38	15.75	25.0
3	25	H	55.0	95.0	20.0	66.8	87.60	26.3	48.60	1.10	22.10	50.5


Dimensions in mm

AG = actuator size

1) Connection type

Code 88: Clamp ASME BPE

8.2.17 Clamp without bypass code 88

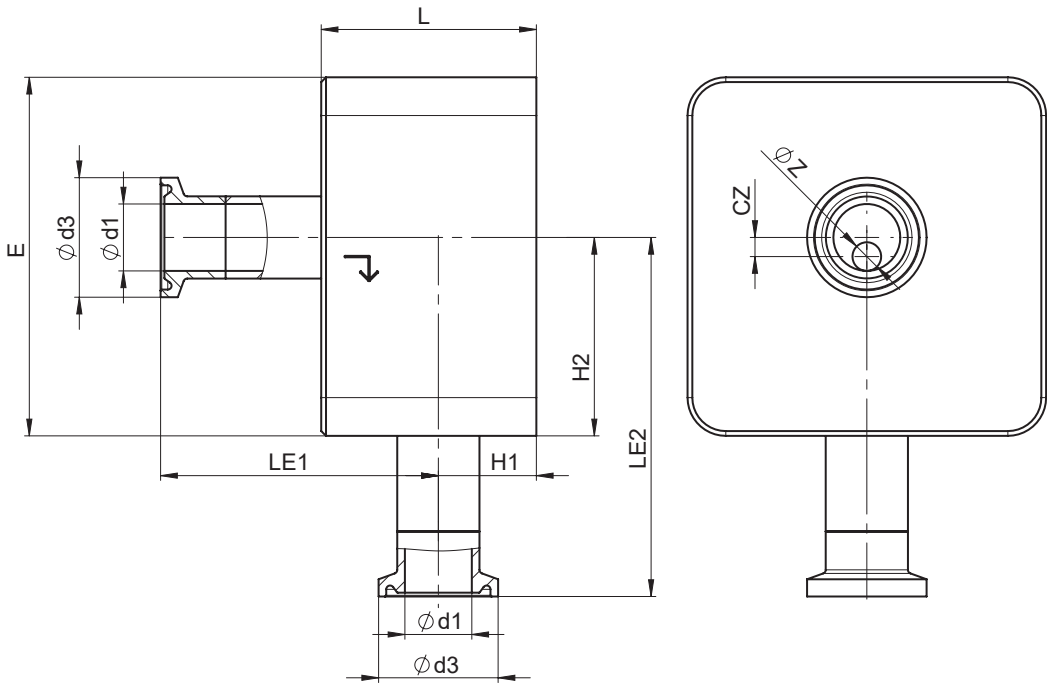


AG	DN	Connection type code 88 ¹⁾										
		Seat size (code)	L	□E	Øz	LE1	LE2	H1	H2	cz	Ød1	Ød3
4	40	K	73.0	112.0	32.0	75.1	87.6	31.0	54.6	1.4	34.8	50.5
	50	K	73.0	112.0	32.0	68.7	81.25	37.4	48.25	7.75	47.5	64.0
		M	73.0	112.0	38.0	68.7	84.25	37.4	51.25	4.75	47.5	64.0
5	65	N	84.0	140.0	50.0	73.1	117.6	43.7	84.9	5.1	60.2	77.5

Dimensions in mm

AG = actuator size

1) Connection type

Code 88: Clamp ASME BPE

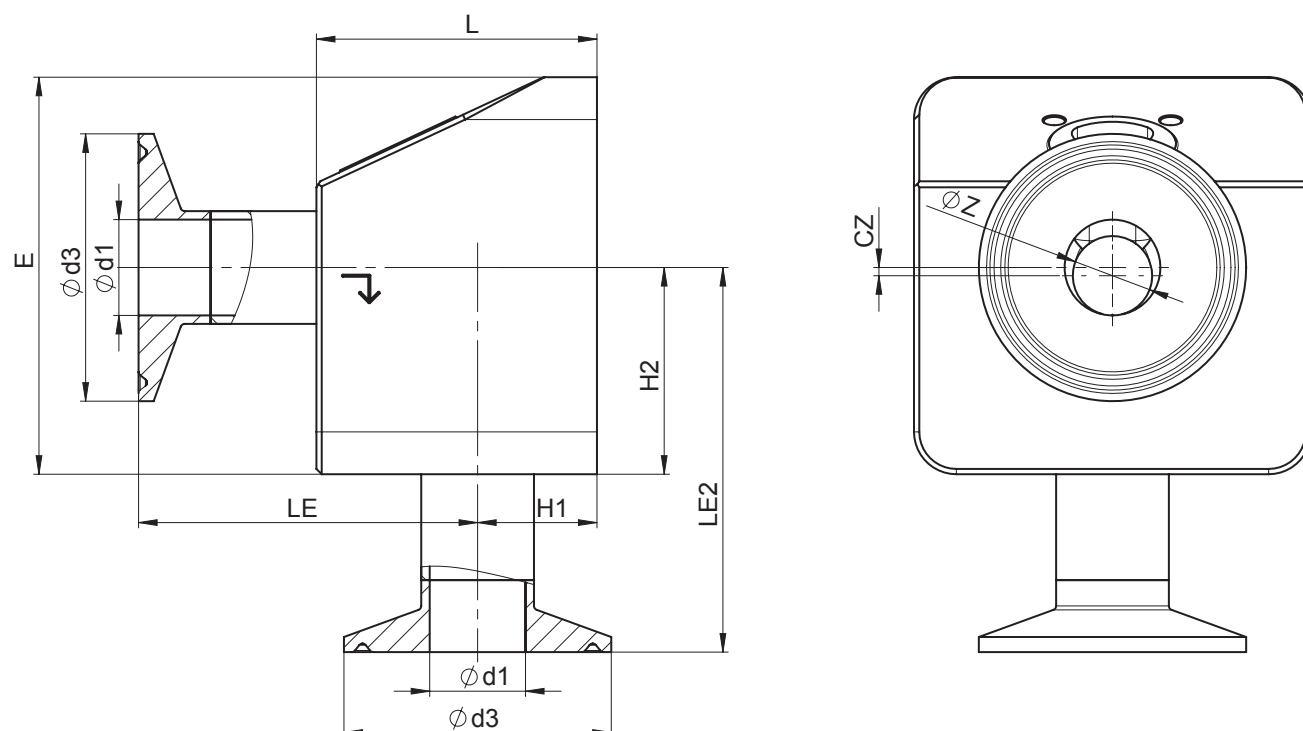8.2.18 Clamp with bypass code 82

AG	DN	Connection type code 82 ¹⁾										
		Seat size (code)	L	□E	Øz	LE1	LE2	H1	H2	cz	Ød1	Ød3
2	8	A	53.0	75.0	2.0	67.3	74.65	18.7	41.65	4.15	10.3	25.4
		B	53.0	75.0	4.0	67.3	73.65	18.7	40.65	3.15	10.3	25.4
		C	53.0	75.0	6.0	67.3	72.65	18.7	39.65	2.15	10.3	25.4
	10	A	53.0	75.0	2.0	65.5	76.50	20.5	43.50	6.00	14.0	25.4
		B	53.0	75.0	4.0	65.5	75.50	20.5	42.50	5.00	14.0	25.4
		C	53.0	75.0	6.0	65.5	74.50	20.5	41.5	4.00	14.0	25.4
		D	53.0	75.0	8.0	65.5	73.50	20.5	40.5	3.00	14.0	25.4
	15	A	53.0	75.0	2.0	63.4	78.55	22.6	45.55	8.05	18.1	50.5
		B	53.0	75.0	4.0	63.4	77.55	22.6	44.55	7.05	18.1	50.5
		C	53.0	75.0	6.0	63.4	76.55	22.6	43.55	6.05	18.1	50.5
		D	53.0	75.0	8.0	63.4	75.55	22.6	42.55	5.05	18.1	50.5
		E	53.0	75.0	10.0	63.4	74.55	22.6	41.55	4.05	18.1	50.5
		G	53.0	75.0	15.0	63.4	72.05	22.6	39.05	1.55	18.1	50.5


Dimensions in mm

AG = actuator size

1) Connection type

Code 82: Clamp DIN 32676 series B

8.2.19 Clamp with bypass code 86

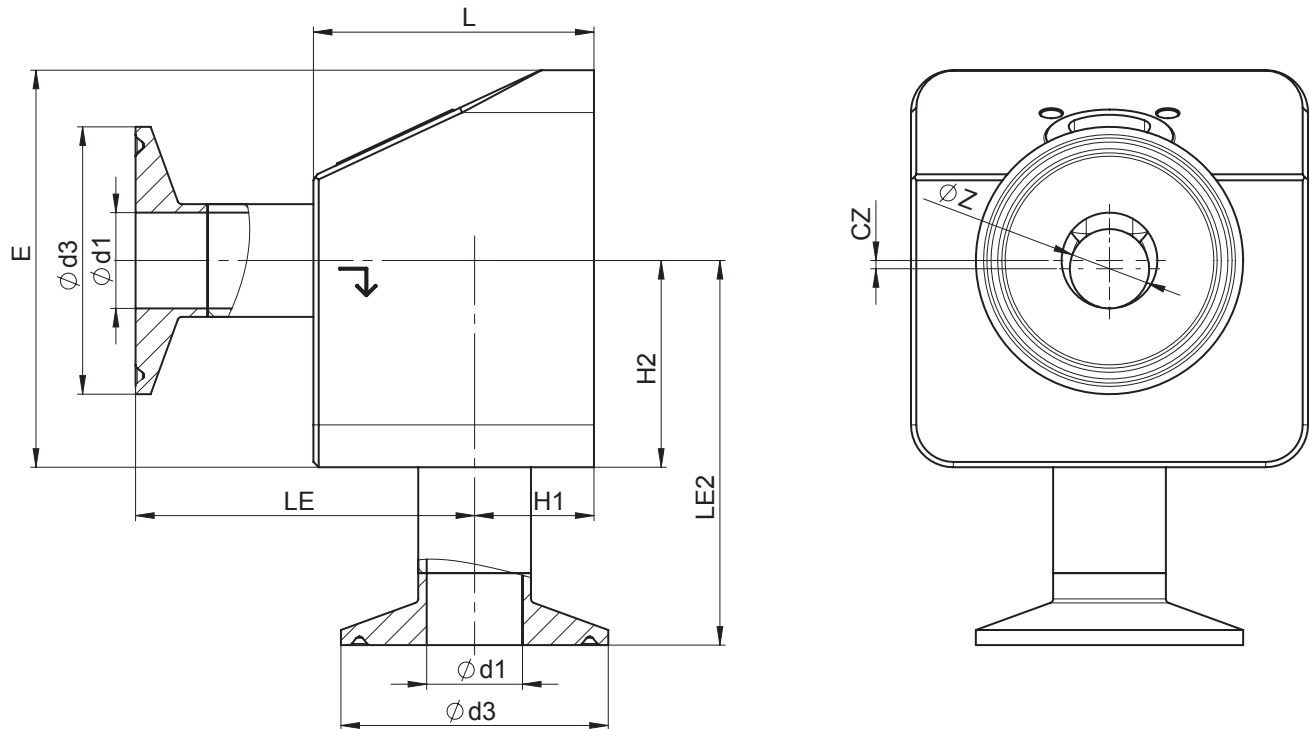


AG	DN	Connection type code 86 ¹⁾										
		Seat size (code)	L	□E	Øz	LE1	LE2	H1	H2	cz	Ød1	Ød3
2	8	A	53.0	75.0	2.0	68.5	73.5	17.5	40.5	3.0	8.0	25.0
		B	53.0	75.0	4.0	68.5	72.5	17.5	39.5	2.0	8.0	25.0
		C	53.0	75.0	6.0	68.5	71.5	17.5	38.5	1.0	8.0	25.0
	10	A	53.0	75.0	2.0	67.5	74.5	18.5	41.5	4.0	10.0	34.0
		B	53.0	75.0	4.0	67.5	73.5	18.5	40.5	3.0	10.0	34.0
		C	53.0	75.0	6.0	67.5	72.5	18.5	39.5	2.0	10.0	34.0
		D	53.0	75.0	8.0	67.5	71.5	18.5	38.5	1.0	10.0	34.0
	15	A	53.0	75.0	2.0	64.5	77.5	21.5	44.5	7.0	16.0	34.0
		B	53.0	75.0	4.0	64.5	76.5	21.5	43.5	6.0	16.0	34.0
		C	53.0	75.0	6.0	64.5	75.5	21.5	42.5	5.0	16.0	34.0
		D	53.0	75.0	8.0	64.5	74.5	21.5	41.5	4.0	16.0	34.0
		E	53.0	75.0	10.0	64.5	73.5	21.5	40.5	3.0	16.0	34.0
		G	53.0	75.0	15.0	64.5	71.0	21.5	38.0	0.5	16.0	34.0

Dimensions in mm

AG = actuator size

1) **Connection type**

Code 86: Clamp DIN 32676 series A

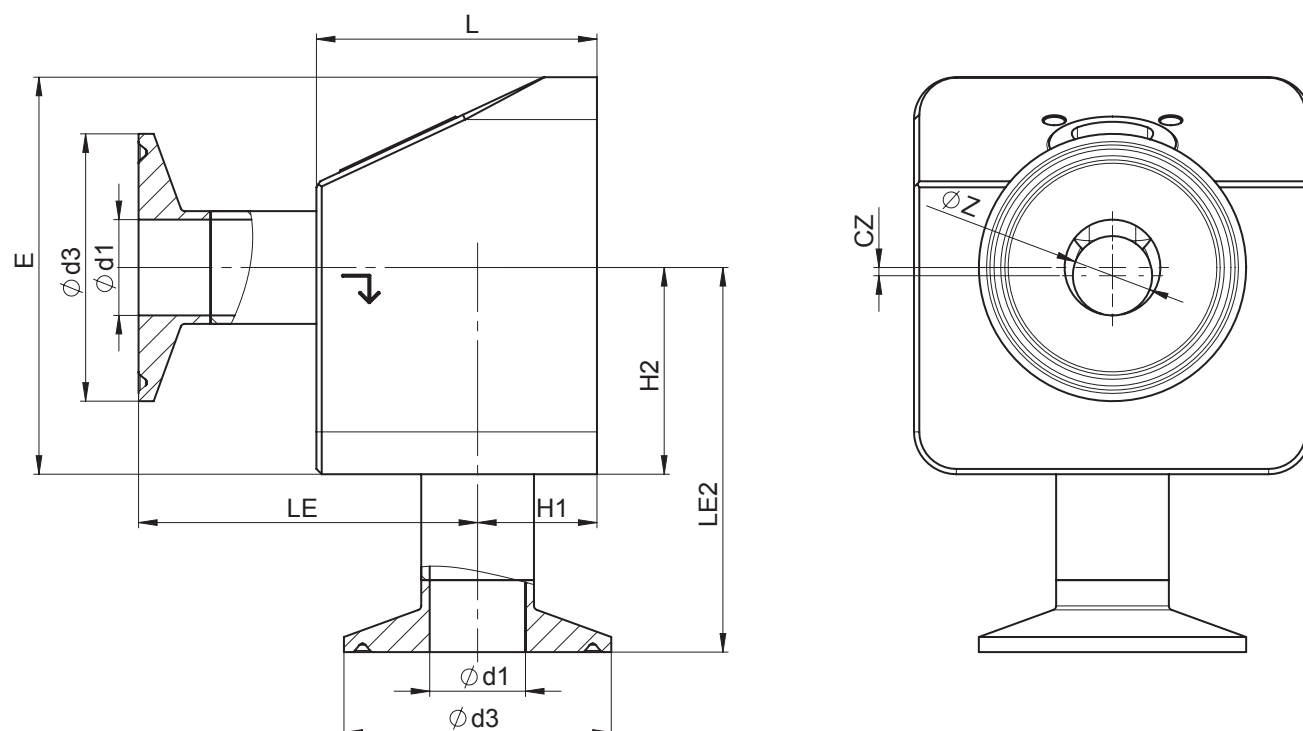8.2.20 Clamp with bypass code 88

AG	DN	Connection type code 88 ¹⁾										
		Seat size (code)	L	□E	Øz	LE1	LE2	H1	H2	cz	Ød1	Ød3
2	15	A	53.0	75.0	2.0	67.8	74.20	18.2	41.20	3.70	9.40	25.0
		B	53.0	75.0	4.0	67.8	73.20	18.2	40.20	2.70	9.40	25.0
		C	53.0	75.0	6.0	67.8	72.20	18.2	39.20	1.70	9.40	25.0
		D	53.0	75.0	8.0	67.8	71.20	18.2	38.20	0.70	9.40	25.0
	20	A	53.0	75.0	2.0	64.6	77.38	21.4	44.38	6.88	15.75	25.0
		B	53.0	75.0	4.0	64.6	76.38	21.4	43.38	5.88	15.75	25.0
		C	53.0	75.0	6.0	64.6	75.38	21.4	42.38	4.88	15.75	25.0
		D	53.0	75.0	8.0	64.6	74.38	21.4	41.38	3.88	15.75	25.0
		E	53.0	75.0	10.0	64.6	73.38	21.4	40.38	2.88	15.75	25.0
		G	53.0	75.0	15.0	64.6	70.88	21.4	37.88	0.38	15.75	25.0

Dimensions in mm

AG = actuator size

1) Connection type

Code 88: Clamp ASME BPE

9 Manufacturer's information

The controller required for valve operation is not included in the scope of delivery.

9.1 Delivery

- Check that all parts are present and check for any damage immediately upon receipt.

The product's performance is tested at the factory. The scope of delivery is apparent from the dispatch documents and the design from the order number.

9.2 Packaging

The product is packaged in a cardboard box which can be recycled as paper.

9.3 Transport

1. Only transport the product by suitable means. Do not drop. Handle carefully.
2. After the installation dispose of transport packaging material according to relevant local or national disposal regulations / environmental protection laws.

9.4 Storage

1. Store the product free from dust and moisture in its original packaging.
2. Avoid UV rays and direct sunlight.
3. Do not exceed the maximum storage temperature (see chapter "Technical data").
4. Do not store solvents, chemicals, acids, fuels or similar fluids in the same room as GEMÜ products and their spare parts.

10 Installation in piping


10.1 Installation location

⚠ CAUTION


- Do not apply external force to the valve.
- Choose the installation location so that the valve cannot be used as a foothold.
- Lay the pipeline so that the valve body is protected against transverse and bending forces, and also vibrations and tension.
- Only install the valve between matching aligned pipes.

NOTICE

- Install the actuator horizontally for optimized draining.
- The flow direction of the working medium is indicated by an arrow on the valve body.



in closed and open position
Actuator horizontal



in open position
Actuator horizontal or vertical

Control range

We recommend designing the valves in such a way that the control range is within an opening stroke of 20% to 90% of the control valve.

10.2 Preparing for installation

⚠ WARNING

The equipment is subject to pressure!

- Risk of severe injury or death
- Depressurize the plant.
- Completely drain the plant.

⚠ WARNING



Corrosive chemicals!

- Risk of caustic burns
- Wear appropriate protective gear.
- Completely drain the plant.

⚠ CAUTION



Hot plant components!

- Risk of burns
- Only work on plant that has cooled down.

⚠ CAUTION

Exceeding the maximum permissible pressure!

- Damage to the product
- Provide precautionary measures against exceeding the maximum permitted pressures caused by pressure surges (water hammer).

⚠ CAUTION

Use as step!

- Damage to the product
- Risk of slipping-off
- Choose the installation location so that the product cannot be used as a foothold.
- Do not use the product as a step or a foothold.

NOTICE**Suitability of the product!**

- The product must be appropriate for the piping system operating conditions (medium, medium concentration, temperature and pressure) and the prevailing ambient conditions.

NOTICE**Tools!**

- The tools required for installation and assembly are not included in the scope of delivery.
 - Use appropriate, functional and safe tools.
1. Ensure the product is suitable for the relevant application.
 2. Check the technical data of the product and the materials.
 3. Keep appropriate tools ready.
 4. Wear appropriate protective gear, as specified in the plant operator's guidelines.
 5. Observe appropriate regulations for connections.
 6. Have installation work carried out by trained personnel.
 7. Shut off plant or plant component.
 8. Secure plant or plant component against recommissioning.
 9. Depressurize the plant or plant component.
 10. Completely drain the plant (or plant component) and let it cool down until the temperature is below the media vaporization temperature and cannot cause scalding.
 11. Correctly decontaminate, rinse and ventilate the plant or plant component.
 12. Lay piping so that the product is protected against transverse and bending forces, and also from vibrations and tension.
 13. Only install the product between matching aligned pipes (see chapters below).
 14. Please note the flow direction (see chapter "Flow direction").
 15. Please note the installation position (see chapter "Installation position").

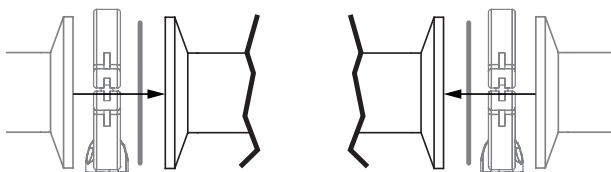
10.3 Installation with clamp connections

Fig. 7: Clamp connection

NOTICE**Gasket and clamp**

- The gasket and clamps for clamp connections are not included in the scope of delivery.
1. Keep ready gasket and clamp.
 2. Carry out preparation for installation (see chapter "Preparing for installation").
 3. Insert the corresponding gasket between the body of the product and the pipe connection.
 4. Connect the gasket between the body of the product and the pipe connection using clamps.
 5. Re-attach or reactivate all safety and protective devices.



10.4 Installation with butt weld spigots

Fig. 8: Butt weld spigots

1. Carry out preparation for installation (see chapter "Preparing for installation").
2. Remove the actuator before welding the valve into the plant (see chapter "Removing the actuator").
3. Adhere to good welding practices!
4. Weld the body of the product in the piping.
5. Allow butt weld spigots to cool down.
6. Mount the actuator on the valve body (see chapter "Mounting the actuator").
7. Re-attach or reactivate all safety and protective devices.
8. Flush the system.


11 Mounting

Mounting the actuator on the distance piece:

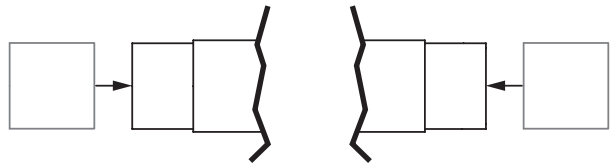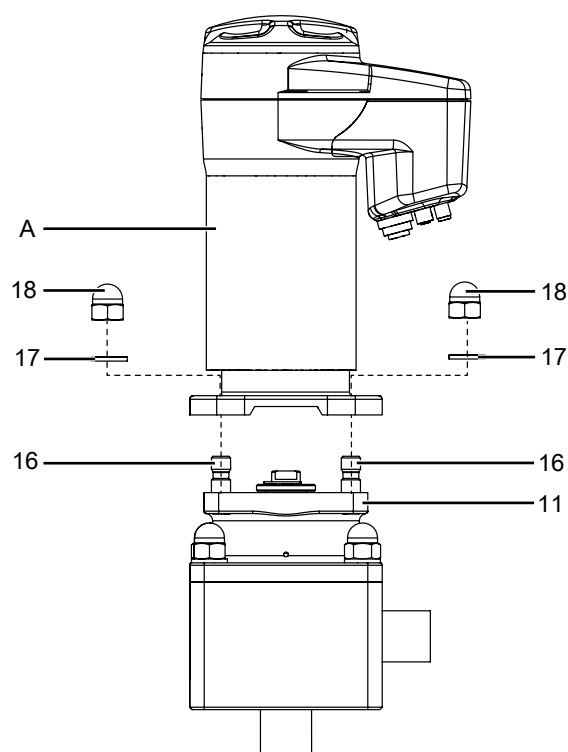


1. Move actuator **A** to the open position.
2. Place actuator **A** on distance piece **11**.
3. Place washers **17** and cap nuts **18** on stud bolts **16** and position by hand.
4. Tighten the cap nuts **18** diagonally.

Actuator size	Tightening torque
2	16-20 Nm
3	30-35 Nm
4	40 Nm
5	70 Nm




Mounting the actuator and the distance piece:

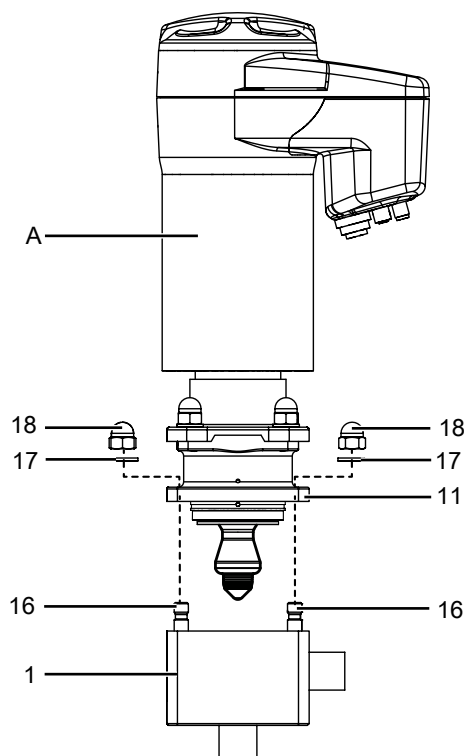

- ✓ **Actuator size 4/5:** Actuator **A** in open position.
- 5. Place actuator **A** and distance piece **11** on valve body **1**.
- 6. Place washers **17** and cap nuts **18** on stud bolts **16** and position by hand.
- 7. Tighten the cap nuts **18** diagonally.

Actuator size	Tightening torque
2	16-20 Nm
3	30-35 Nm
4	40 Nm
5	70 Nm



11.1 Mounting for option with a bypass valve

11.1.1 Mounting the diaphragm

NOTICE

- **Important:** Mount the correct diaphragm that suits the valve (suitable for medium, medium concentration, temperature and pressure). The diaphragm is a wearing part. Check the technical condition and function of the diaphragm valve before commissioning and during the whole term of use. Carry out checks regularly and determine the check intervals in accordance with the conditions of use and/or the regulatory codes and provisions applicable for this application.

NOTICE


- **Important:** Incorrectly mounted diaphragm may cause valve leakage / emission of medium. In this case remove the diaphragm, check the complete valve and diaphragm and reassemble again proceeding as described above.

Diaphragm size 8:

Compressor and actuator flange seen from below:



Push-fit diaphragm:

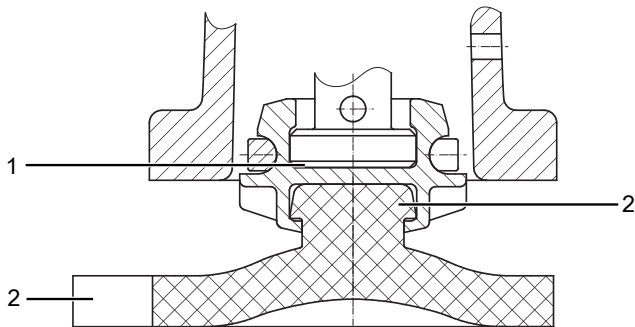

Item	Name
1	Recess of compressor
2	Diaphragm tab
3	Fastening spigot

1. Move the actuator to the closed position.
2. Place the diaphragm with the fastening spigot in an inclined position at the recess of the compressor and push it in.


NOTICE

- **Important:** Do not use greases or lubricants!

3. Align diaphragm tab with identifying manufacturer and material in parallel to compressor weir.

11.1.2 Mounting the actuator

1. Move the actuator to the open position.
2. Position the actuator with the mounted diaphragm on the valve body.
 - ⇒ Take care to align the compressor weir and valve body weir (diaphragm size 8).
3. Tighten the fastening elements by hand.
4. Move the actuator to the closed position.
5. Fully tighten the bolts with nuts diagonally



6. Ensure that the diaphragm is compressed evenly (approx. 10-15 %, visible by an even bulge to the outside).
7. Check tightness of completely assembled valve.

NOTICE

- **Important:** Diaphragms set in the course of time. After valve disassembly / assembly check that the bolts and nuts on the body are tight and retighten if necessary (at the very latest after the first sterilisation process).

12 Electrical connection**12.1 Electrical connection - eSyDrive****NOTICE****Appropriate cable socket / appropriate mating connector!**

- The appropriate cable socket and/or appropriate mating connector is included for X1, X3 and X4.
- The appropriate cable socket and/or appropriate mating connector is **not** included for X2.

NOTICE**Damage to unused plugs due to penetration of humidity!**

- Unused plugs must be covered with the protective caps supplied with the product to ensure IP protection.

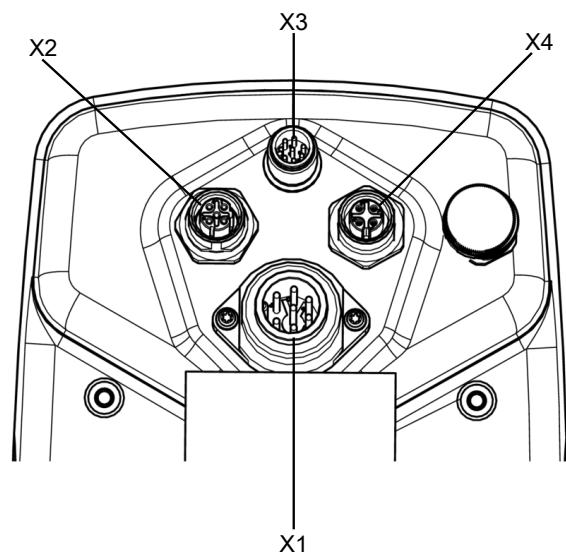



Fig. 9: Overview of electrical connections

12.1.1 Connection X1


7-pin plug, Binder, type 693

Pin	Signal name
Pin 1	Uv, 24 V DC supply voltage
Pin 2	Uv GND
Pin 3	Relay output K1, common
Pin 4	Relay output K1, make contact
Pin 5	Relay output K2, common
Pin 6	Relay output K2, make contact
Pin PE	Function earth

12.1.2 Connection X2

5-pin M12 built-in socket, D-coded

Pin	Signal name
Pin 1	Tx + (Ethernet)
Pin 2	Rx + (Ethernet)
Pin 3	Tx - (Ethernet)
Pin 4	Rx - (Ethernet)
Pin 5	Shield

12.1.3 Connection X3

8-pin M12 plug, A-coded

Pin	Signal name
Pin 1	W+ set value input
Pin 2	W – set value input
Pin 3	X + actual value output
Pin 4	GND (actual value output, digital input 1 – 3, error message output)
Pin 5	Error message output 24 V DC
Pin 6	Digital input 3
Pin 7	Digital input 1
Pin 8	Digital input 2

12.1.4 Connection X4


4-pin M12 built-in socket, A-coded

Pin	Signal name
Pin 1	UV, 24 V DC actual value supply
Pin 2	n.c.
Pin 3	GND (actual value supply, actual value input)
Pin 4	X+, process actual value input
Pin 5	n.c.

12.1.5 Connecting the product electrically

1. Protect the electrical connections from direct contact with rain water.
2. Lay the cables and pipework so that neither condensate nor rain water can get into the plug unions.
3. Check that all plug cable glands and fittings are mechanically secured.
⇒ The cable must be held firmly on all sides.
4. Check whether the actuator cover/manual override is closed and undamaged.
5. Correctly close the actuator cover/manual override again immediately after use.
6. Correctly close the product again after replacing the diaphragm.

12.1.6 Connection diagram

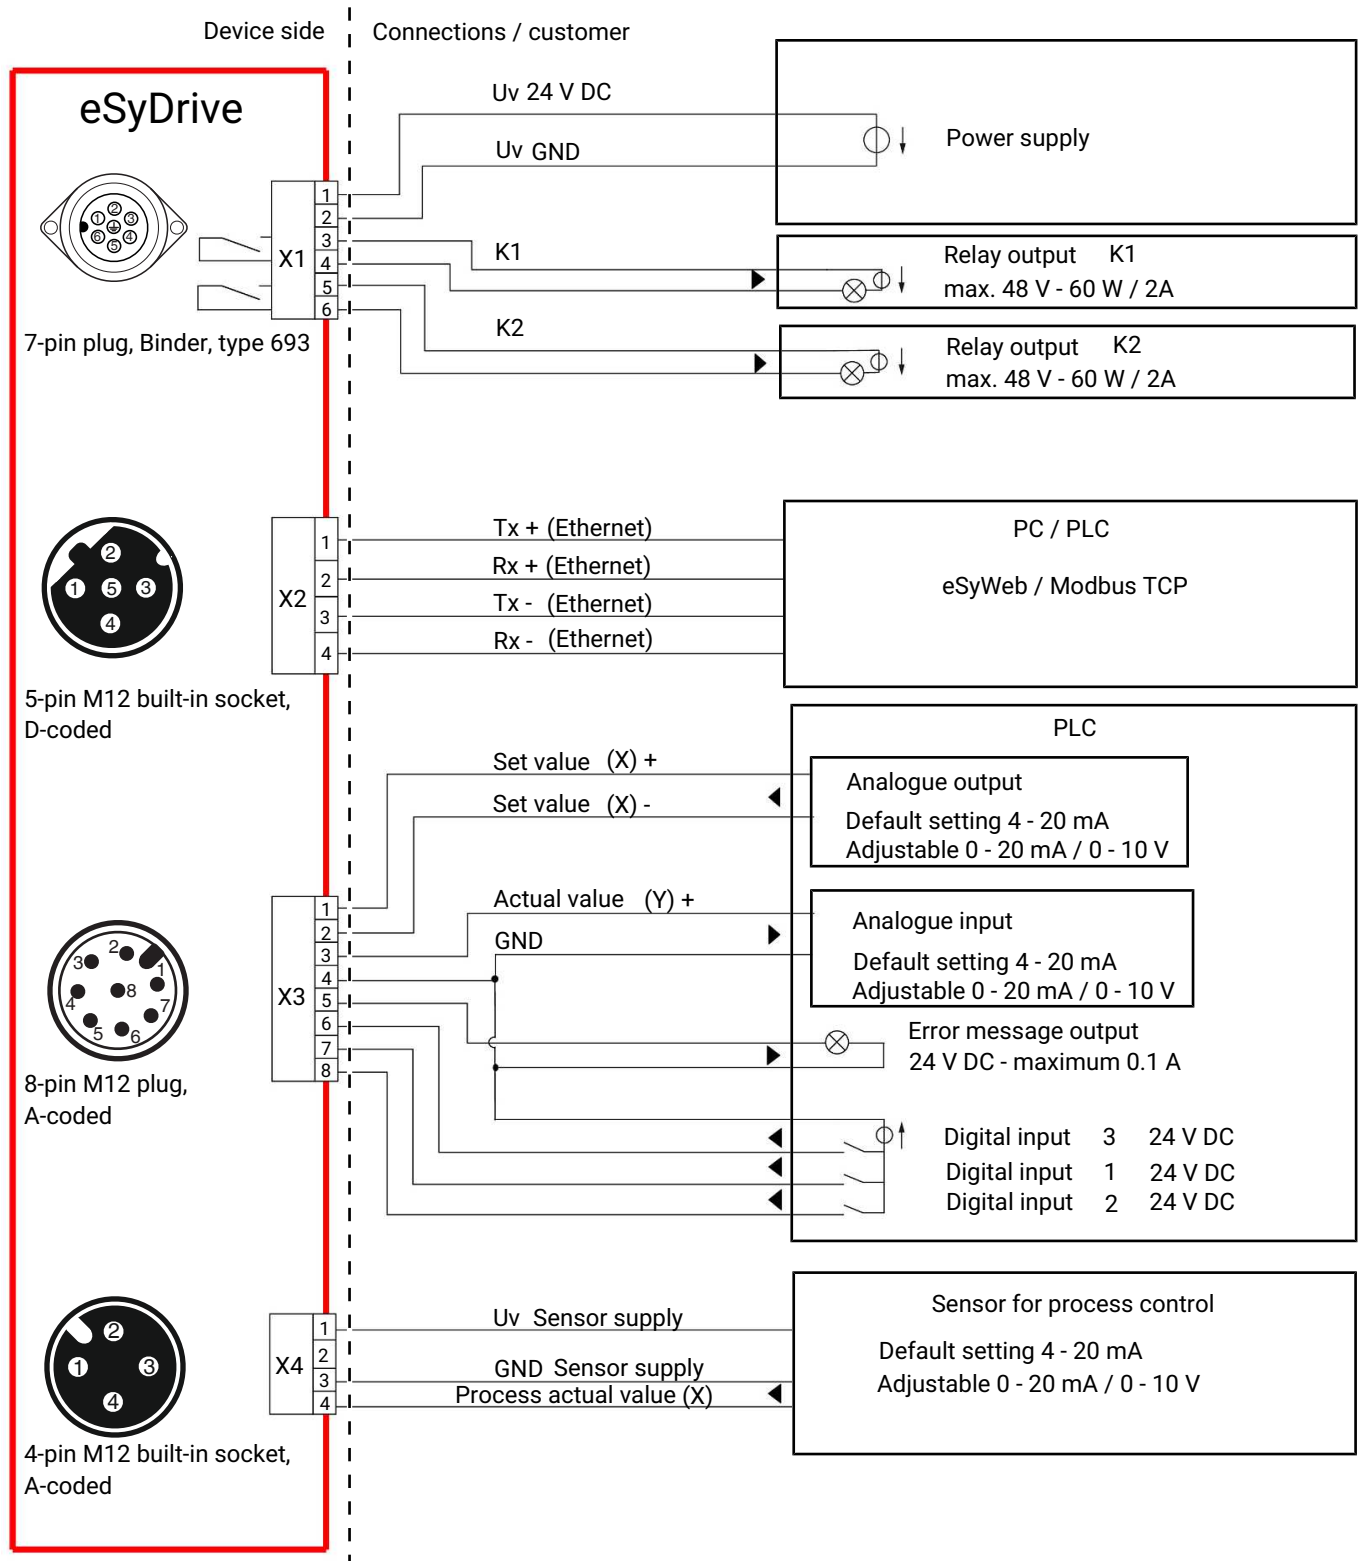

13 Commissioning

13.1 Commissioning on the device

1. Ensure that the "ON-Site" DIP switch 8 is not in the "ON" position (see "Buttons for on-site control", page 6).
2. Press and hold down the "INIT/CLOSE" button **10** for at least 8 s.
 - ⇒ Initialization of the actuator begins.
3. Green and orange LEDs flash alternately.
 - ⇒ Initialization is completed.
- ⇒ Commissioning is completed.

13.2 Commissioning via the eSy-Web web interface


- See separate eSy-Web operating instructions.

13.3 Commissioning via digital input

- ✓ The function of input 3 is set to init.
1. Apply 24 V DC signal briefly (max. 2 s) to connection X3 pin 6 (reference GND connection X3 pin 4).
 - ⇒ Initialization of the actuator begins.
 2. Green and orange LEDs flash alternately.
 - ⇒ Initialization is completed.
 - ⇒ Commissioning is completed.

14 Error messages

14.1 LED error messages

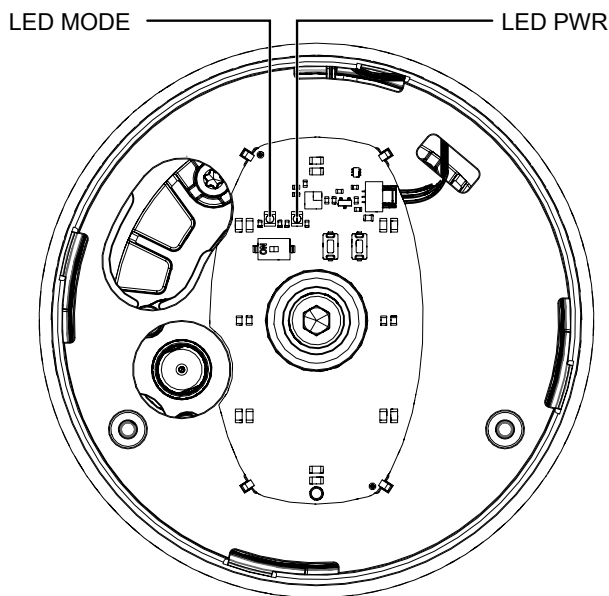

The user checks the following conditions directly on-site at the valve using LED MODE and LED PWR:

Function	High visibility LED	
	green	orange
Error / Error display		

Function	LED MODE		LED PWR	
	yellow	blue	green	red
Undervoltage (no error display of the high visibility LED)				
Internal error				
	alternating			alternating
Calibration faulty				
	simultaneously			simultaneously
Initialization failure				
Temperature error (overtemperature)				
Set value error (< 4 mA, > 20 mA)				
Actual value error (< 4 mA, > 20 mA)				

Fig. 10: Position of the status LEDs

14.2 Troubleshooting

Error	Error cause	Troubleshooting
Working medium escaping from leak detection hole	Plug diaphragm faulty	Check plug diaphragm for potential damage, replace plug diaphragm if necessary
The product does not open or does not open fully	Actuator faulty	Replace actuator cartridge, replace actuator if necessary
	Plug diaphragm incorrectly mounted	Remove actuator, check plug diaphragm mounting, replace plug diaphragm if necessary
The product is leaking downstream (does not close or does not close fully)	Operating pressure too high	Operate the product with operating pressure specified in datasheet
	Plug diaphragm incorrectly mounted	Remove actuator, check plug diaphragm mounting, correct if necessary
	Foreign matter between plug diaphragm and valve seat	Remove actuator, remove foreign matter, check plug diaphragm and valve body for damage and replace if necessary
	Plug diaphragm faulty	Check plug diaphragm for potential damage, replace plug diaphragm if necessary
The product is leaking in the passage (does not close or does not close completely).	Valve body leaking or damaged	Carry out initialisation, check valve body for damage, replace valve body if necessary.
The product is leaking between actuator and valve body	Plug diaphragm incorrectly mounted	Remove actuator, check plug diaphragm mounting, correct if necessary
	Bolting between valve body and actuator loose	Tighten bolting between valve body and actuator
	Plug diaphragm faulty	Check plug diaphragm for potential damage, replace plug diaphragm if necessary
	Actuator/valve body damaged	Replace actuator/valve body
Connection between valve body and piping leaking	Incorrect installation	Check installation of valve body in piping
	Sealing material faulty	Replace sealing material
Valve body leaking	Valve body leaking or corroded	Check valve body for damage, replace valve body if necessary
Valve does not open/close or does not open/close fully	Voltage is not connected	Connect voltage
	Cable ends incorrectly wired	Wire cable ends correctly

15 Inspection and maintenance

NOTICE

Exceptional maintenance work!

- Damage to the GEMÜ product
- Any maintenance work and repairs not described in these operating instructions must not be performed without consulting the manufacturer first.

The operator must carry out regular visual examination of the GEMÜ products dependent on the operating conditions and the potential danger in order to prevent leakage and damage. The product also must be disassembled and checked for wear in the corresponding intervals.

1. Have servicing and maintenance work performed by trained personnel.
2. Wear appropriate protective gear as specified in plant operator's guidelines.
3. Shut off plant or plant component.
4. Secure the plant or plant component against recommissioning.
5. Depressurize the plant or plant component.
6. Actuate GEMÜ products which are always in the same position four times a year.

15.1 Replacing the actuator

15.1.1 Remove the actuator from the distance piece.

⚠ CAUTION



Danger - high voltage!

- Electric shock.
- Before performing any work on the GEMÜ product switch off power and protect circuit from being switched on again.

⚠ WARNING

The equipment is subject to pressure!

- Risk of severe injury or death
- Depressurize the plant.
- Completely drain the plant.

⚠ CAUTION



Hot plant components!

- Risk of burns
- Only work on plant that has cooled down.

⚠ WARNING



Corrosive chemicals!

- Risk of caustic burns
- Wear appropriate protective gear.
- Completely drain the plant.

⚠ CAUTION

Use of incorrect spare parts!

- Damage to the GEMÜ product
- Manufacturer liability and guarantee will be void
- Use only genuine parts from GEMÜ.

NOTICE

Important:

- After disassembly, clean all parts of contamination. Take care not to damage the parts in the process. Afterwards, check parts for potential damage. If parts are damaged, replace them.


⚠ CAUTION

Valve is no longer functioning correctly

- Damaged parts are reused.
- Remove and clean all parts, check for damage and replace if necessary.

NOTICE

- The piping need not be drained when replacing the actuator, as the valve spindle is sealed by the plug diaphragm.

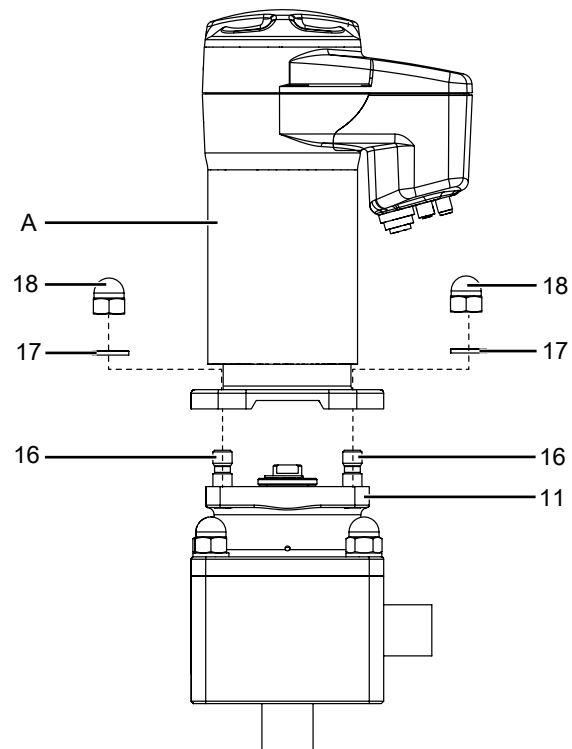


1. Move the actuator **A** to the open position.
2. Undo the cap nuts **18** from the stud bolts **16**.
3. Remove the washers **17**.
4. Remove the actuator **A** from the distance piece **11**.

15.1.2 Mounting the actuator on the distance piece

1. Move actuator **A** to the open position.
2. Place actuator **A** on distance piece **11**.
3. Place washers **17** and cap nuts **18** on stud bolts **16** and position by hand.
4. Tighten the cap nuts **18** diagonally.

Actuator size	Tightening torque
2	16-20 Nm
3	30-35 Nm
4	40 Nm
5	70 Nm

**15.1.3 Removing the actuator with the distance piece****⚠ CAUTION****Danger - high voltage!**

- ▶ Electric shock.
- Before performing any work on the GEMÜ product switch off power and protect circuit from being switched on again.

⚠ WARNING**The equipment is subject to pressure!**

- ▶ Risk of severe injury or death
- Depressurize the plant.
- Completely drain the plant.

⚠ CAUTION**Hot plant components!**

- ▶ Risk of burns
- Only work on plant that has cooled down.

⚠ WARNING**Corrosive chemicals!**


- ▶ Risk of caustic burns
- Wear appropriate protective gear.
- Completely drain the plant.

⚠ CAUTION**Use of incorrect spare parts!**

- ▶ Damage to the GEMÜ product
- ▶ Manufacturer liability and guarantee will be void
- Use only genuine parts from GEMÜ.

⚠ CAUTION**Valve is no longer functioning correctly**

- ▶ Damaged parts are reused.
- Remove and clean all parts, check for damage and replace if necessary.

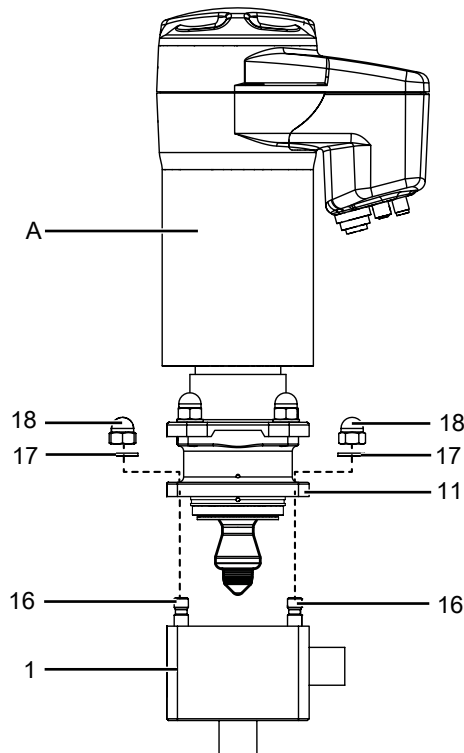


1. Undo the cap nuts **18** from the stud bolts **16**.
2. Remove the washers **17**.
3. Remove the actuator **A**, including the distance piece **11**, from the valve body **1**.
⇒ Do not damage the sealing surface!

15.1.4 Mounting the actuator with the distance piece

- ✓ **Actuator size 4/5:** Actuator **A** in open position.


1. Place actuator **A** and distance piece **11** on valve body **1**.
2. Place washers **17** and cap nuts **18** on stud bolts **16** and position by hand.
3. Tighten the cap nuts **18** diagonally.

Actuator size	Tightening torque
2	16-20 Nm
3	30-35 Nm
4	40 Nm
5	70 Nm





15.2 Replacing the regulating cone


15.2.1 Removing the regulating cone

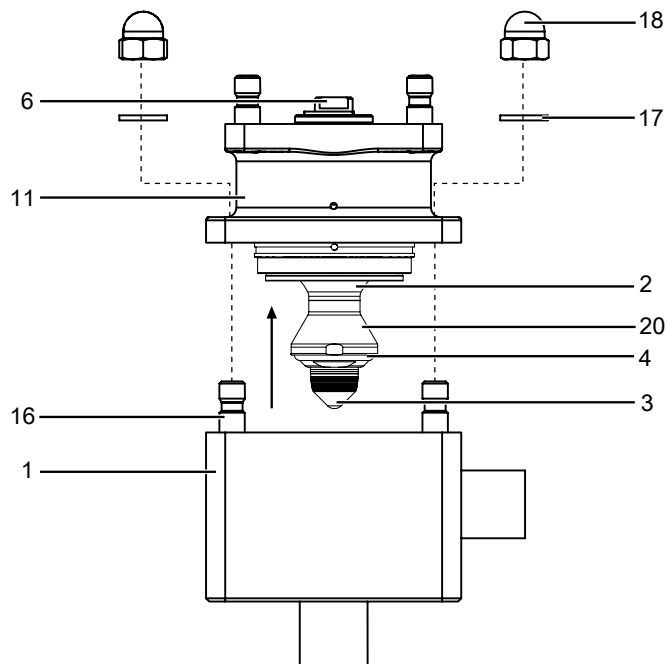


1. Remove the actuator (see chapter "Removing the actuator from the distance piece").
2. Undo the cap nuts **18** from the stud bolts **16**.
3. Remove the washers **17**.
4. Remove the valve body **1** from the distance piece **11**.
⇒ Do not damage the sealing surfaces!

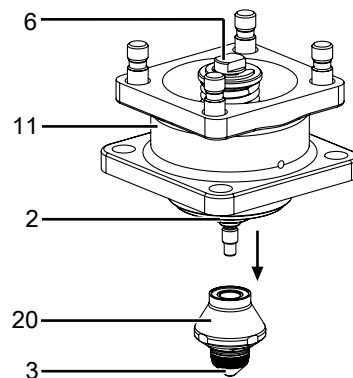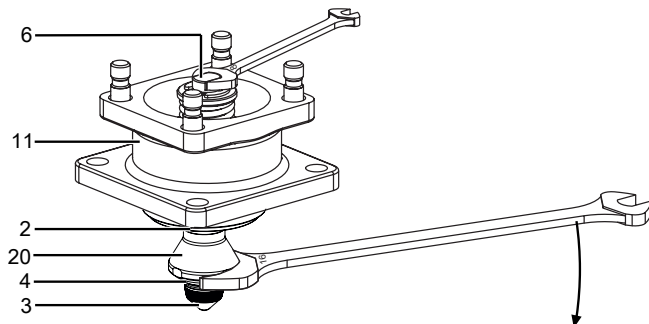

5. Position a **WAF 8** open-end wrench on the wrench surface of the valve spindle **6** (do not damage the spindle surfaces in the process).
6. Simultaneously, position a **WAF 16** open-end wrench on the support ring **20**. By counterholding both open-end wrenches, carefully release the support ring **20** with the regulating cone **3** from the valve spindle **6**.

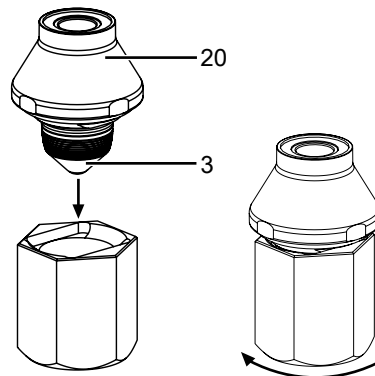


7. Hold the support ring **20** in place and release the regulating cone **3** using the assembly tool. Do not damage the regulating cone surface in the process.

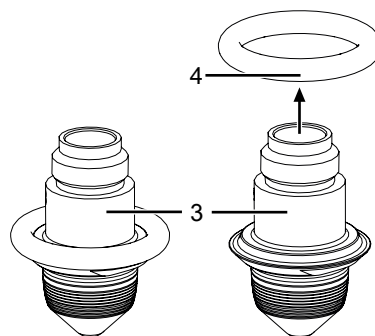


8. Remove the O-ring **4** from the regulating cone **3**.
9. Carefully remove the solvent cement from the thread on the regulating cone **3** (e.g. using a stainless steel brush).
⇒ Do not damage the regulating cone surface in the process.


15.2.2 Mounting the regulating cone

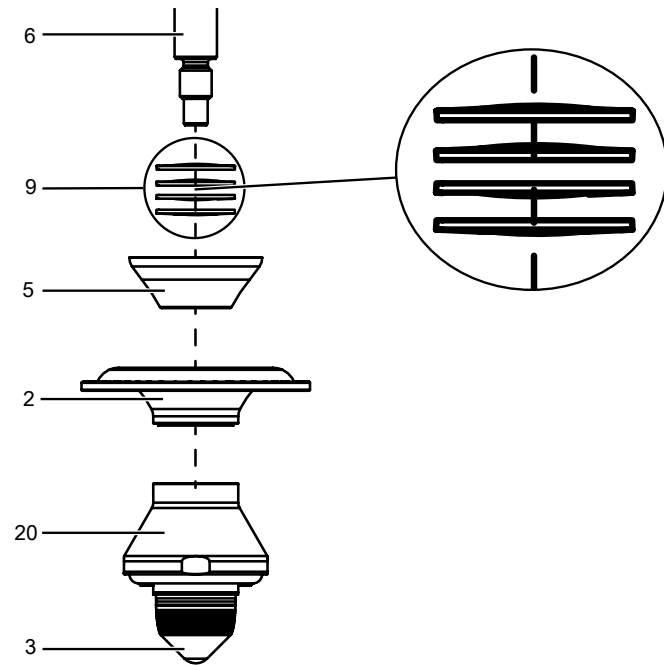


If when removing the regulating cone **3** the plug diaphragm **2**, the adjustable insert **5** and the spring washers **9** are loosened, these must be placed back in the correct position before mounting the regulating cone **3**!

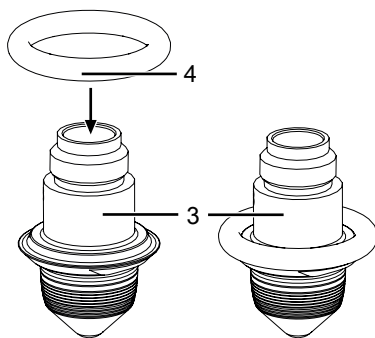

1. Mount the O-ring **4** on the regulating cone **3**.

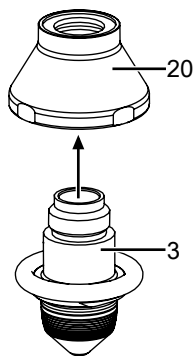


2. Wet the thread of the regulating cone **3** with suitable thread locking compound (e.g. WEICONLOCK AN 301-65).
3. Screw the regulating cone **3** into the support ring **20** until it is hand tight.

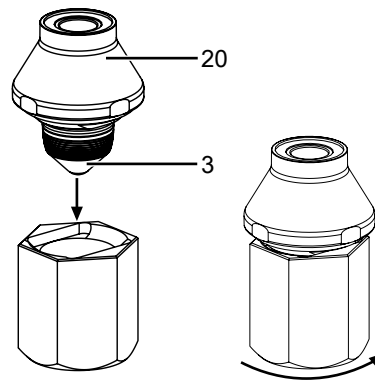


4. Hold the support ring **20** in place and secure the regulating cone **3** using the assembly tool and hand-tighten it.

⇒ Do not damage the regulating cone surface in the process.

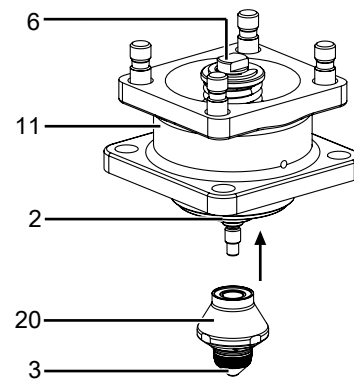

5. Screw the support ring **20** to the valve spindle **6** and hand-tighten it.


⇒ Where necessary, wet the thread of the valve spindle **6** with suitable thread locking compound (e.g. WEICON-LOCK AN 301-65).

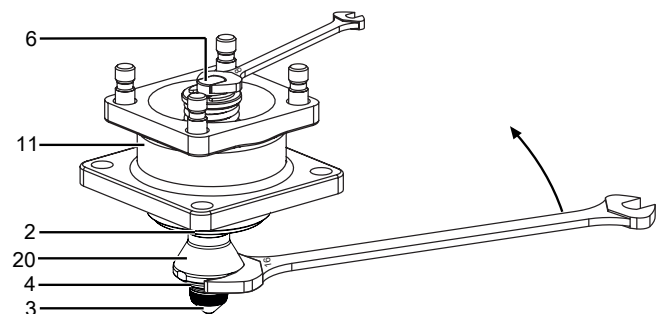

6. Position a **WAF 16** open-end wrench on the regulating cone **3**. Simultaneously, position a **WAF 8** open-end wrench on the wrench surface of the valve spindle **6**. By counterholding both open-end wrenches, carefully bolt the support ring **20** with the regulating cone **3** to the valve spindle **6** (tightening torque: 7-9 Nm).
7. Place the distance piece **11** onto the valve body **1**.
8. Place washers **17** and cap nuts **18** on stud bolts **16** and position by hand.
9. Tighten the cap nuts **18** diagonally.

Actuator size	Tightening torque
2	16-20 Nm
3	30-35 Nm

Actuator size	Tightening torque
4	40 Nm
5	70 Nm



15.3 Replacing the plug diaphragm (code 4)


15.3.1 Removing the plug diaphragm

⚠ CAUTION

Use of incorrect spare parts!

- Damage to the GEMÜ product
- Manufacturer liability and guarantee will be void
- Use only genuine parts from GEMÜ.


1. Remove the support ring **20** and the regulating cone **3** (see chapter "Removing the regulating cone").

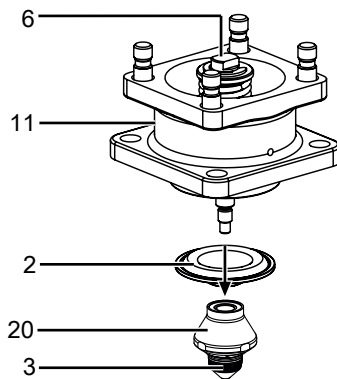

2. Remove the plug diaphragm **2** from the valve spindle **6**.
3. Clean all parts and check them for potential damage.
⇒ Do not scratch or damage parts during cleaning!
4. Replace damaged parts (only use genuine parts from GEMÜ).

15.3.2 Mounting the plug diaphragm

1. Position plug diaphragm **2** at distance piece **11** via valve spindle **6**

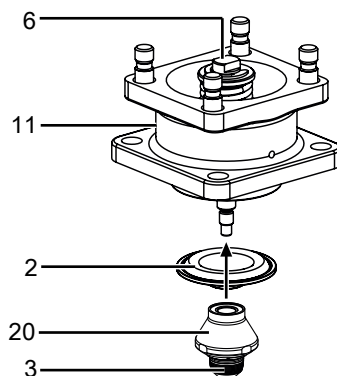

⇒ Where necessary, wet the thread of the valve spindle **6** with suitable thread locking compound (e.g. WEICON-LOCK AN 301-65).

2. Mount the support ring **20** and the regulating cone **3** (see chapter "Mounting the regulating cone").


15.4 Replacing the plug diaphragm (code 5)

15.4.1 Removing the plug diaphragm


⚠ CAUTION

Use of incorrect spare parts!

- Damage to the GEMÜ product
- Manufacturer liability and guarantee will be void
- Use only genuine parts from GEMÜ.

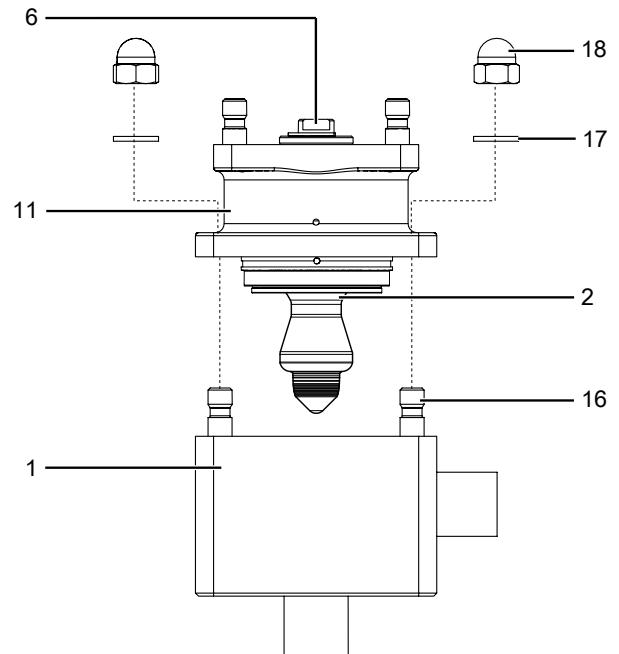


1. Remove the actuator (see chapter "Removing the actuator from the distance piece").
2. Undo the cap nuts **18** from the stud bolts **16**.
3. Remove the washers **17**.
4. Remove the valve body **1** from the distance piece **11**.
⇒ Do not damage the sealing surfaces!

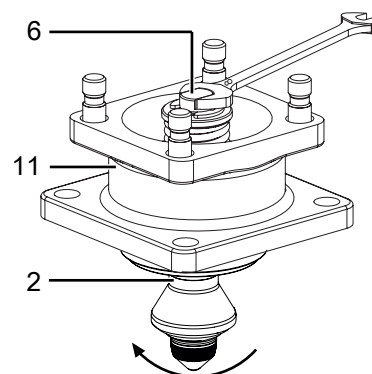


5. Position a **WAF 8** open-end wrench on the wrench surface of the valve spindle **6** (do not damage the spindle surfaces in the process).
6. Undo the plug diaphragm **2**.

15.4.2 Mounting the plug diaphragm

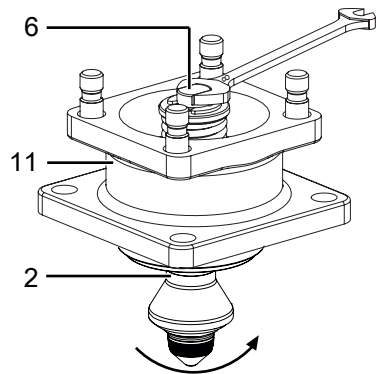

- ✓ **Actuator size 4/5:** Press valve spindle **6** downwards to screw in the plug diaphragm **2** completely.
1. Screw the plug diaphragm **2** to the valve spindle **6** and hand-tighten it.
 2. Place the distance piece **11** onto the valve body **1**.
 3. Place washers **17** and cap nuts **18** on stud bolts **16** and position by hand.
 4. Tighten the cap nuts **18** diagonally.


Actuator size	Tightening torque
2	16-20 Nm
3	30-35 Nm
4	40 Nm
5	70 Nm



15.5 Replacing the bypass valve actuator

15.5.1 Removing the actuator

1. Move the actuator to the open position.
2. Loosen fastening elements between the valve body and the actuator diagonally and remove them.



3. Remove the actuator from the valve body.
4. Move the actuator to the closed position.

NOTICE

Important:

- After disassembly, clean all parts of contamination. Take care not to damage the parts in the process. Afterwards, check parts for potential damage. If parts are damaged, replace them.

15.5.2 Removing the diaphragm

NOTICE

- Before removing the diaphragm, remove the actuator, see previous chapter "Removing the actuator").

1. Pull out the diaphragm (diaphragm size 8).

NOTICE

Important:

- After disassembly, clean all parts of contamination. Take care not to damage the parts in the process. Afterwards, check parts for potential damage. If parts are damaged, replace them.

2. Use only genuine parts from GEMÜ.

15.5.3 Mounting the diaphragm

NOTICE


- **Important:** Mount the correct diaphragm that suits the valve (suitable for medium, medium concentration, temperature and pressure). The diaphragm is a wearing part. Check the technical condition and function of the diaphragm valve before commissioning and during the whole term of use. Carry out checks regularly and determine the check intervals in accordance with the conditions of use and/or the regulatory codes and provisions applicable for this application.

NOTICE


- **Important:** Incorrectly mounted diaphragm may cause valve leakage / emission of medium. In this case remove the diaphragm, check the complete valve and diaphragm and reassemble again proceeding as described above.

Diaphragm size 8:

Compressor and actuator flange seen from below:

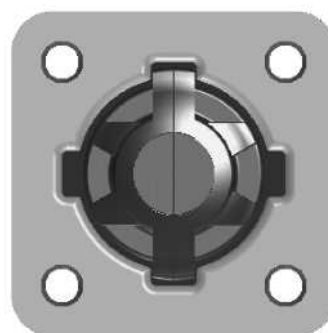

Push-fit diaphragm:

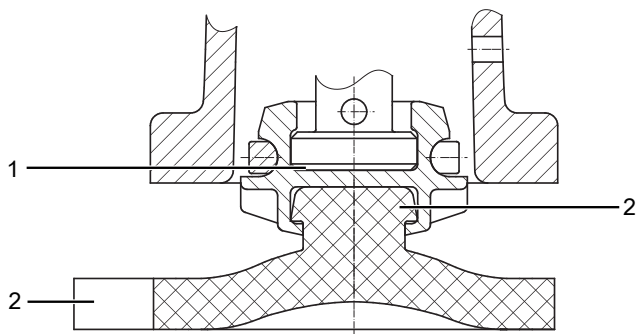

Item	Name
1	Recess of compressor
2	Diaphragm tab
3	Fastening spigot

1. Move the actuator to the closed position.
2. Place the diaphragm with the fastening spigot in an inclined position at the recess of the compressor and push it in.


NOTICE

► **Important:** Do not use greases or lubricants!

3. Align diaphragm tab with identifying manufacturer and material in parallel to compressor weir.

15.5.4 Mounting the actuator

1. Move the actuator to the open position.
2. Position the actuator with the mounted diaphragm on the valve body.
 - ⇒ Take care to align the compressor weir and valve body weir (diaphragm size 8).
3. Tighten the fastening elements by hand.
4. Move the actuator to the closed position.
5. Fully tighten the bolts with nuts diagonally




6. Ensure that the diaphragm is compressed evenly (approx. 10-15 %, visible by an even bulge to the outside).
7. Check tightness of completely assembled valve.

NOTICE

► **Important:** Diaphragms set in the course of time. After valve disassembly / assembly check that the bolts and nuts on the body are tight and retighten if necessary (at the very latest after the first sterilisation process).


15.6 Cleaning the product

- Clean the product with a damp cloth.
- Do **not** clean the product with a high pressure cleaning device.

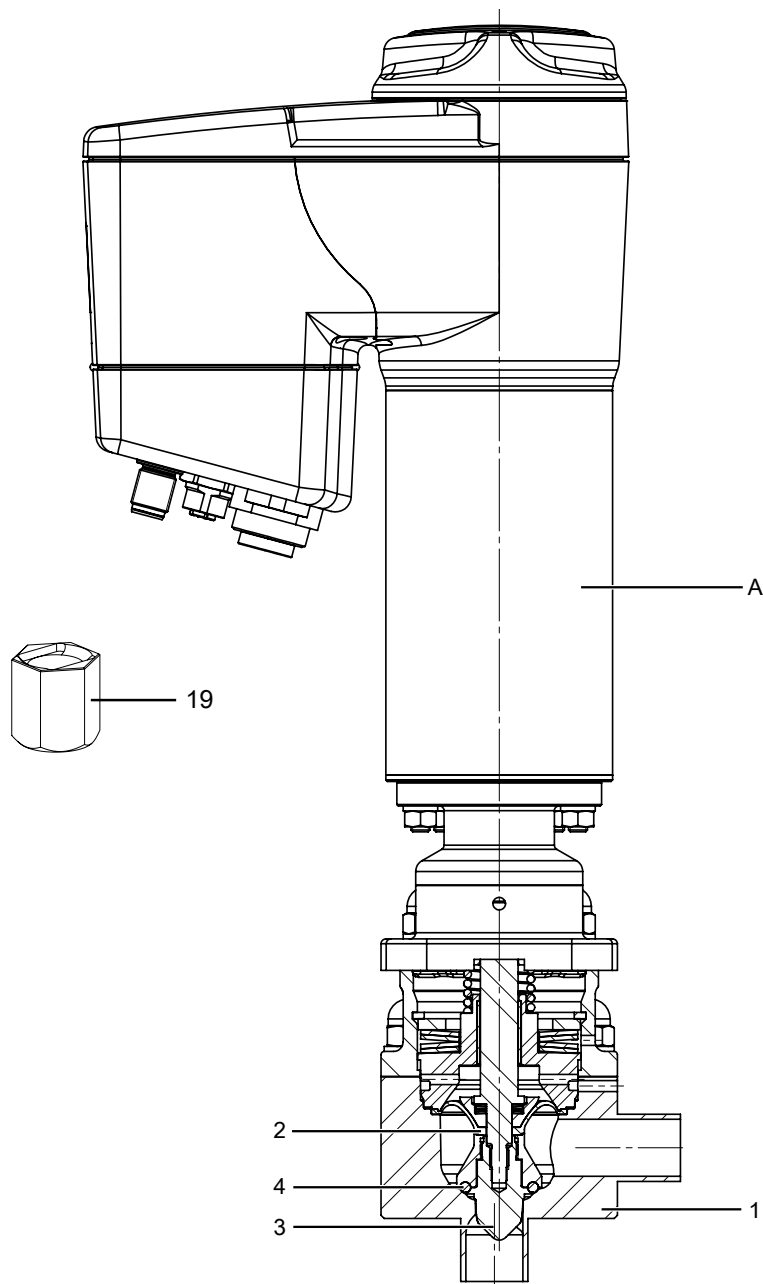15.7 Spare parts**15.7.1 Seal material code 4, 43, 45, 47**

Item	Name	Order description
A	Actuator	9567
1	Valve body	K567
2	Plug diaphragm	567 SVS...
4	O-ring	
2	Plug diaphragm	567 SVM...
4	O-ring	
19	Assembly tool	
2	Plug diaphragm	567 SRK 4...
3	Regulating cone	
4	O-ring	
19	Assembly tool	
	Set of screws (88491207)	567 S30E 41 2

15.7.2 Seal material code 5, 55

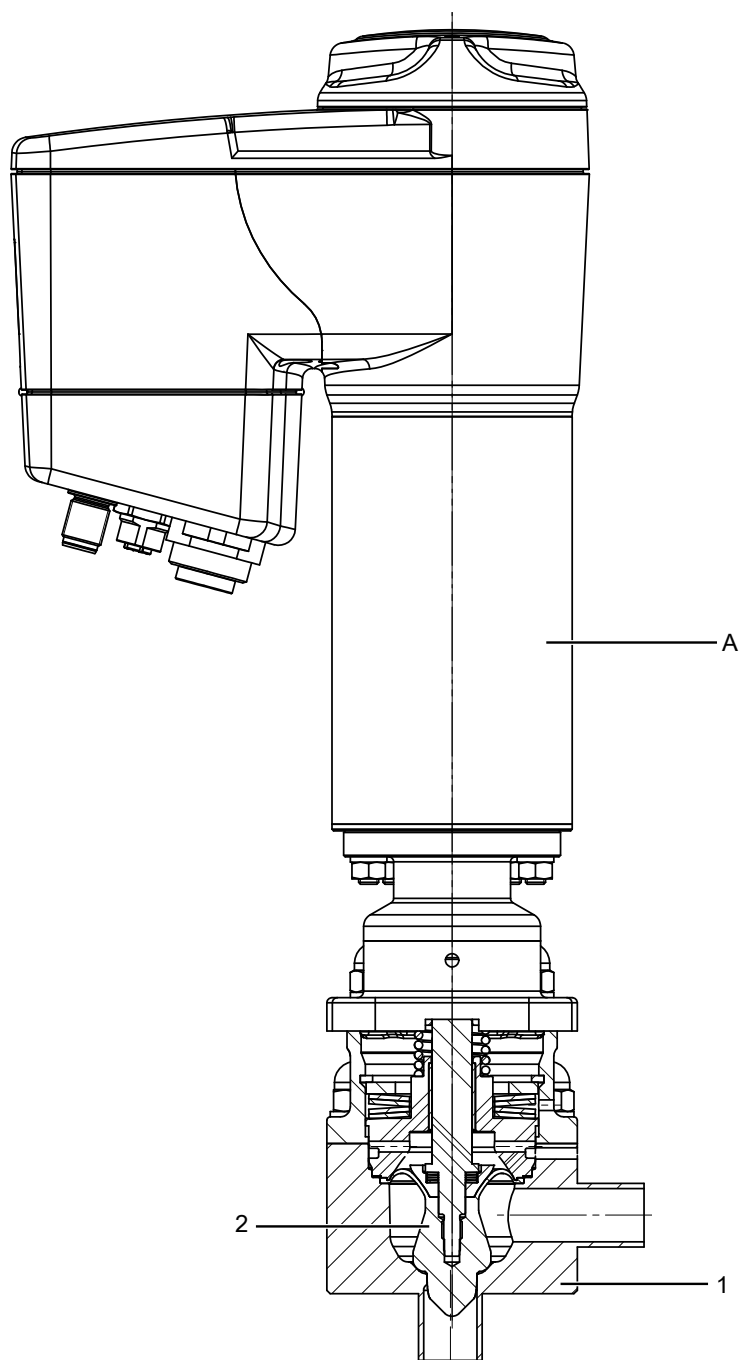

Item	Name	Order description
A	Actuator	9567
1	Valve body	K567
2	Plug diaphragm with regulating cone	567 SRK 5...
	Set of screws (88491207)	567 S30E 41 2

16 Removal from piping

1. Remove the clamp or screw connections in reverse order to installation.
2. Remove welded or solvent cemented connections using a suitable cutting tool.
3. Observe the safety information and accident prevention regulations.

17 Disposal

1. Pay attention to adhered residual material and gas diffusion from penetrated media.
2. Dispose of all parts in accordance with the disposal regulations/environmental protection laws.

18 Returns

Legal regulations for the protection of the environment and personnel require that the completed and signed return delivery note is included with the dispatch documents. Returned goods can be processed only when this note is completed. If no return delivery note is included with the product, GEMÜ cannot process credits or repair work but will dispose of the goods at the operator's expense.

1. Clean the product.
2. Request a return delivery note from GEMÜ.
3. Complete the return delivery note.
4. Send the product with a completed return delivery note to GEMÜ.

19 Declaration of Incorporation according to 2006/42/EC (Machinery Directive)

Declaration of Incorporation

according to the EC Machinery Directive 2006/42/EC, Annex II, 1.B for partly completed machinery

We, the company
GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG
Fritz-Müller-Strasse 6-8
74653 Ingelfingen-Criesbach, Germany

declare that the following product

Make: GEMÜ Pneumatically operated angle seat globe valve

Commercial name: GEMÜ 567

meets the following essential requirements of the Machinery Directive 2006/42/EC:

1.1.2, 1.1.3, 1.1.5, 1.3.2, 1.3.3, 1.3.4, 1.5.1, 1.5.2

We also declare that the specific technical documentation has been compiled in accordance with part B of Annex VII.

The manufacturer or his authorised representative undertake to transmit, in response to a reasoned request by the national authorities, relevant information on the partly completed machinery. This transmission takes place:

Electronically

Authorised documentation officer
GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG
Fritz-Müller-Straße 6-8
74653 Ingelfingen, Germany

This does not affect the industrial property rights!

Important note! The partly completed machinery may be put into service only if it was determined, where appropriate, that the machinery into which the partly completed machinery is to be installed meets the provisions of this Directive.

2023-11-23



Joachim Brien
Head of BU Industry

20 Declaration of conformity according to 2014/68/EU (Pressure Equipment Directive)

EU Declaration of Conformity

in accordance with 2014/68/EU (Pressure Equipment Directive)

We, the company

GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG
Fritz-Müller-Strasse 6-8
74653 Ingelfingen-Criesbach, Germany

declare that the product listed below complies with the safety requirements of the Pressure Equipment Directive 2014/68/EU.

Note for products with a nominal size \leq DN 25:

The products are developed and produced according to GEMÜ process instructions and quality standards which comply with the requirements of ISO 9001 and ISO 14001.

According to Article 4, Paragraph 3 of the Pressure Equipment Directive 2014/68/EU these products must not be identified by a CE-label.

Description of the pressure equipment:	GEMÜ 567
Notified body:	TÜV Rheinland Industrie Service GmbH
Number:	0035
Certificate no.:	01 202 926/Q-02 0036
Conformity assessment procedure:	Module H1
Technical standard used:	AD 2000

2023-11-23



Joachim Brien
Head of BU Industry

21 Declaration of conformity according to 2014/30/EU (EMC Directive)

EU Declaration of Conformity

in accordance with 2014/30/EU (EMC Directive)

We, the company

GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG
Fritz-Müller-Strasse 6-8
74653 Ingelfingen-Criesbach, Germany

declare that the product listed below complies with the safety requirements of the EMC Directive 2014/30/EU.

Description of the product: GEMÜ 567

Applied technical standards:

Interference resistance:

- DIN EN 61326-1 (industrial processes)

Interference emission:

- DIN EN 61800-3

2023-11-23



Joachim Brien
Head of BU Industry



GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG
Fritz-Müller-Straße 6-8, 74653 Ingelfingen-Criesbach, Germany
Phone +49 (0) 7940 1230 · info@gemue.de
www.gemu-group.com

Subject to alteration

12.2023 | 88600422