

GEMÜ 543 eSyStep

Positioner (Code S0)

Motorized angle seat globe valve

EN

Operating instructions



All rights including copyrights or industrial property rights are expressly reserved.

Keep the document for future reference.

© GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG
24.11.2025

Contents

1 General information	4
1.1 Information	4
1.2 Symbols used	4
1.3 LED symbols	4
1.4 Definition of terms	4
1.5 Warning notes	4
2 Safety information	5
3 Product description	5
3.1 Construction	5
3.2 LED displays	6
3.3 Description	6
3.4 Function	7
4 GEMÜ CONEXO	7
5 Correct use	7
6 Order data	8
7 Technical data	10
8 Electrical connection	18
9 Dimensions	22
10 Manufacturer's information	34
10.1 Delivery	34
10.2 Packaging	34
10.3 Transport	34
10.4 Storage	34
11 Installation in piping	34
11.1 Preparing for installation	34
11.2 Installation position	35
11.3 Installation with butt weld spigots	35
11.4 Installation with threaded sockets	35
11.5 Installation with threaded spigots	35
11.6 Installation with flanged connection	35
11.7 Installation with clamp connections	36
12 Specific data IO-Link (pin 6)	37
12.1 Operation on IO-Link	37
12.2 Process data	40
12.3 Parameter overview	41
12.4 Parameter	46
12.5 Events	64
13 Operation	66
13.1 Initialization	66
13.2 Manual override	66
14 Inspection and maintenance	67
15 Troubleshooting	69
16 Removal from piping	71
17 Disposal	71
18 Returns	71
19 EU Declaration of Incorporation according to the EC Machinery Directive 2006/42/EC, Annex II B ...	72
20 EU Declaration of Conformity in accordance with 2014/68/EU (Pressure Equipment Directive)	73
21 EU Declaration of Conformity in accordance with 2014/30/EU (EMC Directive)	74
22 EU Declaration of Conformity in accordance with 2011/65/EU (RoHS Directive)	75

1 General information

1.1 Information

- The descriptions and instructions apply to the standard versions. For special versions not described in this document the basic information contained herein applies in combination with any additional special documentation.
- Correct installation, operation, maintenance and repair work ensure faultless operation of the product.
- Should there be any doubts or misunderstandings, the German version is the authoritative document.
- Contact us at the address on the last page for staff training information.

1.2 Symbols used

The following symbols are used in this document:

Symbol	Meaning
●	Tasks to be performed
►	Response(s) to tasks
–	Lists

1.3 LED symbols

The following LED symbols are used in the documentation:

Symbol	LED conditions
○	Off
●	Lit (on)
⦿	Flashing

1.4 Definition of terms

Working medium

The medium that flows through the GEMÜ product.

Diaphragm size

Uniform seat size of GEMÜ diaphragm valves for different nominal sizes.

1.5 Warning notes

Wherever possible, warning notes are organized according to the following scheme:

SIGNAL WORD	
Possible symbol for the specific danger	Type and source of the danger ►Possible consequences in case of non-compliance ●Measures for avoiding danger

Warning notes are always labelled with a signal word and sometimes also with a symbol for the specific danger.

The following signal words and danger levels are used:

 DANGER	
	Imminent danger! ► Non-observance can cause death or severe injury

 WARNING	
	Potentially dangerous situation! ► Non-observance can cause death or severe injury

 CAUTION	
	Potentially dangerous situation! ► Non-observance can cause moderate to light injury

NOTICE	
	Potentially dangerous situation! ► Non-observance can cause damage to property

The following symbols for the specific dangers can be used within a warning note:

Symbol	Meaning
	Danger of explosion!
	The equipment is subject to pressure!
	Corrosive chemicals!
	Hot plant components!
	Maximum permissible pressure exceeded!
	Incorrect combination of actuator and valve body!

2 Safety information

The safety information in this document refers only to an individual product. Potentially dangerous conditions can arise in combination with other plant components, which need to be considered on the basis of a risk analysis. The operator is responsible for the production of the risk analysis and for compliance with the resulting precautionary measures and regional safety regulations.

The document contains fundamental safety information that must be observed during commissioning, operation and maintenance. Non-compliance with these instructions may cause:

- Personal hazard due to electrical, mechanical and chemical effects
- Hazard to nearby equipment
- Failure of important functions
- Hazard to the environment due to the leakage of dangerous materials

The safety information does not take into account:

- Unexpected incidents and events, which may occur during installation, operation and maintenance
- Local safety regulations which must be adhered to by the operator and by any additional installation personnel

Prior to commissioning:

1. Transport and store the product correctly.
2. Do not paint the bolts and plastic parts of the product.
3. Carry out installation and commissioning using trained personnel.
4. Provide adequate training for installation and operating personnel.
5. Ensure that the contents of the document have been fully understood by the responsible personnel.
6. Define the areas of responsibility.
7. Observe the safety data sheets.
8. Observe the safety regulations for the media used.

During operation:


9. Keep this document available at the place of use.
10. Observe the safety information.
11. Operate the product in accordance with this document.
12. Operate the product in accordance with the specifications.
13. Maintain the product correctly.
14. Do not carry out any maintenance work and repairs not described in this document without consulting the manufacturer first.

In cases of uncertainty:

15. Consult the nearest GEMÜ sales office.

3 Product description


3.1 Construction

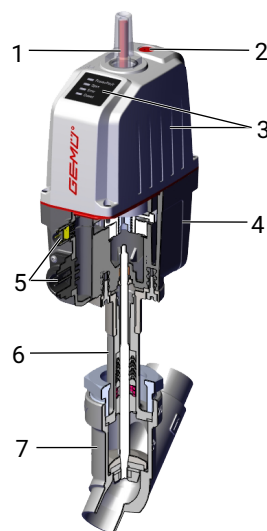

Item	Name	Materials
1	Optical position indicator	PA 12
2	Manual override	
3	Actuator top with LED display	Reinforced polyamide
4	Actuator base	Reinforced polyamide
5	Electrical connections	
6	Distance piece with leak detection hole	1.4305 / 1.4408
7	Valve body	1.4435 investment casting 1.4408 (investment casting) 1.4435 (F316L) forged body, cast bronze

3.2 LED displays

3.2.1 Status LEDs



standard. The self-locking actuator holds its position in a stable manner when idle and in the event of power supply failure.

LED	Colour		Function
	Standard	Inversed ¹⁾	
Power/fault	green	green	Operating indication/ communication status
	red	red	
Open	orange	green	Process valve in OPEN position
Error	red	red	Error
Closed	green	orange	Process valve in CLOSED position

1) Inversed representation of the OPEN and CLOSED LEDs, adjustable via IO-Link

3.2.2 LED conditions

Status process valve	Power/ fault	Open	Error	Closed
OPEN position	●	●	○	○
CLOSED position	●	○	○	●
Position unknown	●	○	○	○
IO-Link communication	☀	○	○	○
Initialization	●	☀	○	☀
		Open and Closed flash alternately		

LED conditions					
●	lit (on)	☀	flashes	○	off

3.3 Description

The GEMÜ 543 eSyStep is an electrically operated 2/2-way angle seat globe valve. The eSyStep electric actuator is available as On/Off actuator or with integrated positioner. The valve spindle is sealed by a self-adjusting gland packing providing low-maintenance and reliable valve spindle sealing even after a long service life. A wiper ring fitted in front of the gland packing protects the seal against contamination and damage. An integral optical and electrical position indicator is

3.4 Function

The product controls or regulates (depending on version) a flowing medium by being closed or opened by a motorized actuator.

The product is equipped as standard with a mechanical position indicator as well as an electrical position and status indicator.

The product is not intended for use in potentially explosive areas.

- Use the product in accordance with the technical data.


4 GEMÜ CONEXO

Order with CONEXO

GEMÜ CONEXO must be ordered separately with the ordering option "CONEXO" (see order data).

For electronic identification purposes, each replaceable component contained in the product is equipped with an RFID chip (1). Where you can find the RFID chip differs from product to product.

The CONEXO pen helps read out information stored in these RFID chips. The CONEXO app or CONEXO portal is required to view this information.

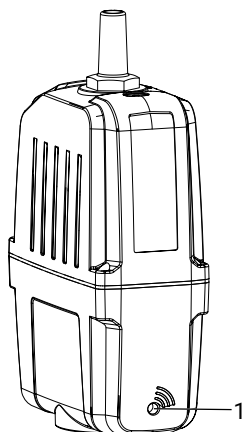

Actuator RFID chip

5 Correct use

DANGER



Danger of explosion!

- Risk of death or severe injury
- Do **not** use the product in potentially explosive zones.

WARNING

Improper use of the product!

- Risk of severe injury or death
- Manufacturer liability and guarantee will be void.
- Only use the product in accordance with the operating conditions specified in the contract documentation and in this document.

The product is designed for installation in piping systems and for controlling a working medium.

6 Order data

The order data provide an overview of standard configurations.

Please check the availability before ordering. Other configurations available on request.

Order codes

1 Type	Code
Angle seat globe valve, motorized, eSyStep	543
2 DN	Code
DN 15	15
DN 20	20
DN 25	25
DN 32	32
DN 40	40
DN 50	50
3 Housing configuration	Code
2/2-way body	D
Angle valve body	E
4 Connection type	Code
Spigot	
Spigot DIN	0
Spigot DIN EN 10357 series B (2014 issue; formerly DIN 11850 series 1)	16
Spigot EN 10357 series A/DIN 11866 series A, formerly DIN 11850 series 2	17
Spigot SMS 3008	37
Spigot ASME BPE/DIN EN 10357 series C (from 2022 issue)/DIN 11866 series C	59
Spigot ISO 1127/DIN EN 10357 series C (2014 issue)/DIN 11866 series B	60
Threaded connection	
Threaded socket DIN ISO 228	1
Threaded socket Rc ISO 7-1, EN 10226-2, JIS B 0203, BS 21, end-to-end dimension ETE DIN 3202-4 series M8	3C
Threaded socket NPT, end-to-end dimension ETE DIN 3202-4 series M8	3D
Threaded spigot DIN ISO 228	9
Flange	
Flange EN 1092, PN 25, form B, face-to-face dimension FTF EN 558 series 1, ISO 5752, basic series 1	10
Flange EN 1092, PN 25, form B	13
Flange ANSI Class 150 RF	47
Clamp	
Clamp ASME BPE, face-to-face dimension FTF ASME BPE	80
Clamp DIN 32676 series B, face-to-face dimension FTF EN 558 series 1	82
Clamp DIN 32676 series A, face-to-face dimension FTF EN 558 series 1	86
Clamp ASME BPE, for pipe ASME BPE, face-to-face dimension FTF EN 558 series 1	88

5 Valve body material	Code
Investment casting material	
1.4435, investment casting	34
1.4408, investment casting	37
1.4435, investment casting	C2
Forged material	
1.4435 (F316L), forged body	40
6 Seat seal	Code
PTFE	5
PTFE, glass fibre reinforced	5G
1.4404	10
7 Voltage/Frequency	Code
24 V DC	C1
8 Control module	Code
Positioner	S0
Positioner, configured for emergency power supply module (NC)	S5
Positioner configured for emergency power supply module (NO)	S6
9 Regulating cone	Code
Without	
Please find the number of the optional regulating cone (R-No.) for the linear or equal-percentage modified regulating cone in the Kv value table.	R....
10 Type of design	Code
Without	
Ra ≤ 0.6 µm (25 µinch) for media wetted surfaces, in accordance with ASME BPE SF2 and SF3, mechanically polished internal	1903
Ra ≤ 0.8 µm (30 µinch) for media wetted surfaces, in accordance with DIN 11866 H3, mechanically polished internal	1904
Ra ≤ 0.4 µm (15 µinch) for media wetted surfaces, in accordance with DIN 11866 H4, ASME BPE SF1, mechanically polished internal	1909
PTFE-PTFE spindle seal	2013
11 Actuator version	Code
Actuator size 0	0A
Actuator size 1	1A
12 Special version	Code
Without	
Special version for oxygen, (max. temperature 60 °C; max. operating pressure 10 bar), media wetted seal materials and auxiliary materials with BAM testing	S

13 CONEXO	Code
Without	

13 CONEXO	Code
Integrated RFID chip for electronic identification and traceability	C

Order example

Ordering option	Code	Description
1 Type	543	Angle seat globe valve, motorized, eSyStep
2 DN	25	DN 25
3 Housing configuration	D	2/2-way body
4 Connection type	1	Threaded socket DIN ISO 228
5 Valve body material	37	1.4408, investment casting
6 Seat seal	5	PTFE
7 Voltage/Frequency	C1	24 V DC
8 Control module	S0	Positioner
9 Regulating cone	R....	Please find the number of the optional regulating cone (R-No.) for the linear or equal-percentage modified regulating cone in the Kv value table.
10 Type of design		Without
11 Actuator version	0A	Actuator size 0
12 Special version		Without
13 CONEXO		Without

7 Technical data

7.1 Medium

Working medium: Corrosive, inert, gaseous and liquid media which have no negative impact on the physical and chemical properties of the body and seal material.

Max. permissible viscosity: 600 mm²/s
Other versions for lower / higher temperatures and higher viscosities on request.

7.2 Temperature

Media temperature: -40 – 180 °C
For material code 37 (and 34 only with 3.2. certificate) + K-no. 2013: -40 to 180 °C

Ambient temperature: 0 – 60 °C
depending on version and/or operating parameters (see chapter Duty cycle and service life)

7.3 Pressure

Operating pressure:

DN	Actuator version 0A	Actuator version 0E	Actuator version 1A	
			Open/Close valve (code A0)	Control valve (code S0)
6	-	25	-	-
8		25	-	-
10	-	25	-	-
15	15	25	25	25
20	10	-	25	15
25	6	-	23	10
32	-	-	15	6.5
40	-	-	9	4
50	-	-	6	1

Pressures in bar

All pressures are gauge pressures.

For max. operating pressures the pressure / temperature correlation must be observed.

Higher operating pressures on request

Leakage rate:

Control valve

Seat seal	Standard	Test procedure	Leakage rate	Test medium
Metal	DIN EN 60534-4	1	IV	Air
PTFE, FKM, EPDM	DIN EN 60534-4	1	VI	Air

Pressure/temperature correlation:

Connection types code	Material code	Max. allowable operating pressures in bar at temperature in °C			
		RT	100	150	200
1, 9, 17, 37, 60, 63, 3C, 3D	37	25.0	23.8	21.4	18.9
0, 16, 17, 37, 59, 60, 65	34	25.0	24.5	22.4	20.3
13 (DN 15 - 50)	34	25.0	23.6	21.5	19.8
80, 88 (DN 15 - 40)	34	25.0	21.2	19.3**	-
80, 88 (DN 50 - 80)	34	16.0	16.0	16.0**	-
82 (DN 15 - 32)	34	25.0	21.2	19.3**	-
82 (DN 40 - 65)	34	16.0	16.0	16.0**	-
86 (DN 15 - 40)	34	25.0	21.2	19.3**	-
86 (DN 50 - 65)	34	16.0	16.0	16.0**	-
47 (DN 15 - 50)	34	15.9	13.3	12.0	11.1
17, 59, 60	C2	25.0	21.2	19.3	17.9

* max. temperature 140 °C

Kv values:

DN	Butt weld spigot DIN 11866	Threaded socket DIN ISO 228
6	-	-
8	2.2	-
10	4.5	4.5
15	5.5	5.4
20	11.7	10.0
25	20.5	15.2
32	33.0	23.0
40	51.0	41.0
50	61.0	68.0

Kv values in m³/h

Kv values determined in accordance with DIN EN 60534. The Kv value specifications refer to the largest actuator for the respective nominal size. The Kv values for other product configurations (e.g. other connections or body materials) may differ.

Standard regulating cone (DIN)

DN	Kv values	Operating pressure	Actuator version	linear	equal percentage
15	5.0	15.0	0A	RS400	RS420
	5.0	25.0	1A	RS401	RS421
20	10.0	10.0	0A	RS402	RS422
	10.0	15.0	1A	RS403	RS423
25	15.0	6.0	0A	RS404	RS424
	15.0	10.0	1A	RS405	RS425
32	24.0	6.5	1A	RS406	RS426
40	38.0	4.0	1A	RS407	RS427
50	50.0	1.0	1A	RS409	RS429

Pressures in bar

Kv values in m³/h

Standard regulating cone (ANSI)

DN	Kv values	Operating pressure	Actuator version	linear	equal percentage
15	2.7	15.0	0A	RS440	RS460
	2.7	25.0	1A	RS441	RS461
20	6.3	10.0	0A	RS442	RS462
	6.3	15.0	1A	RS443	RS463
25	13.3	6.0	0A	RS444	RS464
	13.3	10.0	1A	RS445	RS465
40	35.6	4.0	1A	RS446	RS466
50	50.0	1.0	1A	RS448	RS468

Pressures in bar

Kv values in m³/h

Kv values:

Standard regulating cone with reduced seat
Valve body material 1.4435 (code 34, C2), 1.4408 (code 37)

DN	Operating pressure [bar]		Kv values	Seat seal code	R-Number	
	0A	1A			linear	equal-percentage
15	25	-	0.1	10	RA205	RA409
	25	-	0.16	10	RB213	RA410
	25	-	0.25	10	RB214	RB409
	25	-	0.4	10	RB215	RB410
	25	-	0.63	10	RC209	RC410
	25	-	1	10	RC210	RC411
	25	-	1.6	5, 5G	RD211	RD411
	25 ¹⁾	-	2.5	5, 5G	RE213	RE413
20	25	-	1.6	5, 5G	RD212	RD412
	25	-	2.5	5, 5G	RE214	RE414
	25	-	4	5, 5G	RF215	RF415
	15 ¹⁾	-	6.3	5, 5G	RG217	RG417
25	25	-	2.5	5, 5G	RE215	RE415
	25	-	4	5, 5G	RF216	RF416
	15	-	6.3	5, 5G	RG218	RG418
	10 ¹⁾	-	10	5, 5G	RH217	RH417
32	25.0	-	4	5, 5G	RF217	RF417
	15.0	-	6.3	5, 5G	RG219	RG419
	10.0	-	10	5, 5G	RH218	RH418
	6.0	-	16	5, 5G	RJ213	RJ413
40	15.0	-	6.3	5, 5G	RG220	RG420
	10.0	-	10	5, 5G	RH219	RH419
	6.0	-	16	5, 5G	RJ214	RJ414
	-	6.5	25	5, 5G	RK209	RK409
50	10.0	-	10	5, 5G	RH220	RH420
	6.0	-	16	5, 5G	RJ215	RJ415
	-	6.5	25	5, 5G	RK210	RK410
	-	4.0	40	5, 5G	RM205	RM405

1) not for connection codes 37, 59, 80, 88

Kv values in m³/h

Kv values determined in accordance with DIN EN 60534. The Kv value specifications refer to the largest actuator for the respective nominal size. The Kv values for other product configurations (e.g. other connections or body materials) may differ.

7.4 Product compliance**Machinery Directive:** 2006/42/EC**Pressure Equipment Directive:** 2014/68/EU

Food: Regulation (EC) No. 1935/2004*
 Regulation (EC) No. 10/2011*
 FDA*
 * depending on version and/or operating parameters

EMC Directive: 2014/30/EU**RoHS Directive:** 2011/65/EU**7.5 Mechanical data****Protection class:** IP 65 acc. to EN 60529**Actuating speed:** Max. 3 mm/s

Weight: **Actuator**
 Actuator size 0 (code 0A) 0.95 kg
 Actuator size 1 (code 1A) 1.88 kg

Valve body

DN	Spigot K514	Threaded socket	Threaded spigot	Flange K514	Clamp
Connection types code					
	0, 16, 17, 37, 59, 60	1, 3D, 3C	9	8, 10, 13, 47	80, 82, 86, 88
6	0.12	-	0.14	-	-
8	0.12	0.25	0.12	-	-
10	0.12	0.25	0.14	-	-
15	0.16	0.25	0.14	-	-
10	0.25	0.25	-	-	-
15	0.24	0.35	0.31	1.80	0.37
20	0.50	0.35	0.50	2.50	0.63
25	0.50	0.35	0.65	3.10	0.63
32	0.90	0.75	1.00	4.60	1.08
40	1.10	0.98	1.30	5.10	1.28
50	1.80	1.70	1.80	7.20	2.07


Weights in kg

Mechanical environmental conditions: Class 4M8 acc. to EN 60721-3-4:1998**Vibration:** 5g acc. to IEC 60068-2-6 Test Fc**Shock:** 25g acc. to 60068-2-27 Test Ea

7.6 Actuator duty cycle and service life

Service life: **Control operation** - Class C according to EN 15714-2 (1,800,000 starts and 1200 starts per hour).
Open/Close duty - At least 500,000 switching cycles at room temperature and permissible duty cycle.

Duty cycle: Control module Positioner (code S0, S5, S6), Open/Close duty

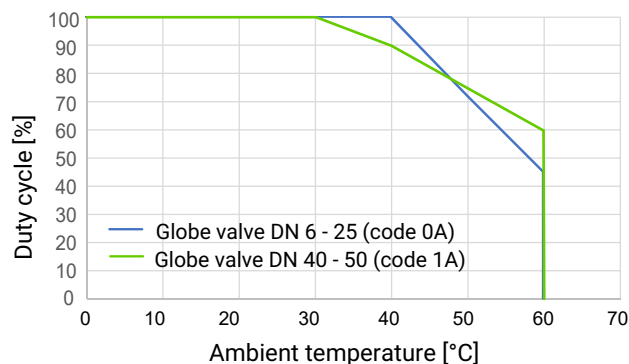

Control module positioner (code S0, S5, S6), control operation - class C acc. to EN 15714-2

- DN 6 - 25 (code 0A) up to 50 °C ambient temperature
- DN 40 - 50 (code 1A) up to 30 °C ambient temperature

NOTICE

- The specified characteristics and values apply to the default setting.
- With reduced forces, higher duty cycles and/or higher ambient temperatures are possible. At higher force settings the duty cycle and/or ambient temperature is reduced.
- IO-Link: Index 0x90 - Subindex 2 - Force

7.7 Electrical data

Supply voltage U_v : 24 V DC $\pm$ 10%

Rating: Actuator size 0 (code 0A) 20 W
 Actuator size 1 (code 1A) 60 W

Operation: Stepper motor, self-locking

Reverse polarity protection: Yes

7.7.1 Analogue input signals – Control module Positioner (code S0, S5, S6)

7.7.1.1 Set value

Input signal: 0/4 - 20 mA; 0 - 10 V (function selectable via IO-Link)

Input type: passive

Input resistance: 250 Ω

Accuracy/linearity: $\leq \pm 0.3\%$ of full flow

Temperature drift: $\leq \pm 0.1\%$ / 10°K

Resolution: 12 bit

Reverse polarity protection: Yes (up to $\pm$ 24 V DC)

7.7.2 Digital input signals

Inputs:	Function selectable via IO-Link (see table Overview of available functions – Input and output signals)
Input voltage:	24 V DC
Logic level "1":	> 15.3 V DC
Logic level "0":	< 5.8 V DC
Input current:	typically < 0.5 mA

7.7.3 Analogue output signals – Control module Positioner (code S0, S5, S6)

7.7.3.1 Actual value

Output signal:	0/4 - 20 mA; 0 - 10 V (function selectable via IO-Link)
Output type:	Active
Accuracy:	$\leq \pm 1\%$ of full flow
Temperature drift:	$\leq \pm 0.1\% / 10^\circ\text{K}$
Load resistor:	$\leq 750\text{ k}\Omega$
Resolution:	12 bit
Short-circuit proof:	Yes

7.7.4 Digital output signals

Outputs:	Function selectable via IO-Link (see table Overview of available functions – Input and output signals)
Type of contact:	Push-Pull
Switching voltage:	Power supply U_v
Switching current:	$\leq 140\text{ mA}$
Short-circuit proof:	Yes

7.7.5 Communication

Interface:	IO-Link
Function:	Parameterization/process data
Transmission rate:	38400 baud
Frame type in Operate:	2.V (eSyStep positioner, code S0, S5, S6), PDout 3Byte; PDin 3 Byte; OnRequestData 2 Byte
Min. cycle time:	20 ms (eSyStep positioner, code S0, S5, S6)
Vendor-ID:	401
Device-ID:	1906801 (eSyStep position controller code S0, S5, S6), 1906802 (eSyStep position controller code S0, S5, S6) from software version V1.0.3.3 (from Nov 2024)

Product-ID:	eSyStep Positioner (code S0, S5, S6)
ISDU support:	Yes
SIO operation:	Yes
IO-Link specification:	V1.1

IODD files can be downloaded via <https://ioddfinder.io-link.com/> or www.gemu-group.com.

7.7.6 Behaviour in the event of an error

Function:	In the event of an error the valve moves to the error position. Notes: Moving to the error position is only possible with full power supply. This behaviour is not a safety position. The valve must be operated with a GEMÜ 1571 emergency power supply module (see accessories) to ensure the function in case of voltage loss.
Error position:	Closed, open or hold (adjustable via IO-Link).


8 Electrical connection

NOTICE

Appropriate cable socket/appropriate mating connector


- The appropriate connectors are included for X1 and X2.

8.1 Position of the connectors

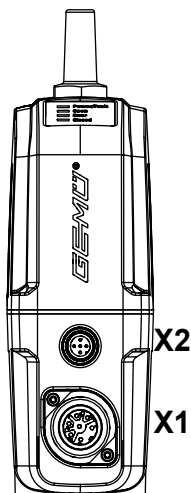


8.2 Electrical connection

8.2.1 Connection X1



7-pin plug, Binder, type 693

Pin	Signal name
1	Uv, 24 V DC supply voltage
2	GND
3	Digital input 1
4	Digital input 2
5	Digital input/output
6	Digital output, IO-Link
7	n.c.

8.2.2 Connection X2 (only for positioner design)

5-pin M12 plug, A-coded

Pin	Signal name
1	I+/U+, set value input
2	I-/U-, set value input
3	I+/U+, actual value output
4	I-/U-, actual value output
5	n.c.

8.3 Overview of available functions – Input and output signals**NOTICE**


- The factory default setting "Configured for emergency power supply module" is reset to default settings when a reset is carried out.

NOTICE

- When the digital inputs for OPEN and CLOSE are activated simultaneously, the defined error position is approached.


	Function	Tube replacement function A	Control module S0	Control module S5, S6
		Factory preconfiguration for tube replacement function	Default settings	Factory default setting "Configured for emergency power supply module"
Digital input 1	Off / Open / Closed / Safe/On / Initialization	Initialization	Initialization	Initialization
Digital input 2	Off / Open / Closed / Safe/On / Initialization	Tube replacement function (Open Total)	Off	Safe/On
Digital input/output	Open / Closed / Error / Error and warning / Initialization	Error	Error	Error
Digital output	Open / Closed / Error / Error and warning	Closed	Closed	Closed
Analogue input	4–20 mA/0–20 mA/0–10 V	4–20 mA	4–20 mA	4–20 mA
Analogue output	4–20 mA/0–20 mA/0–10 V	4–20 mA	4–20 mA	4–20 mA

8.4 Connection diagram

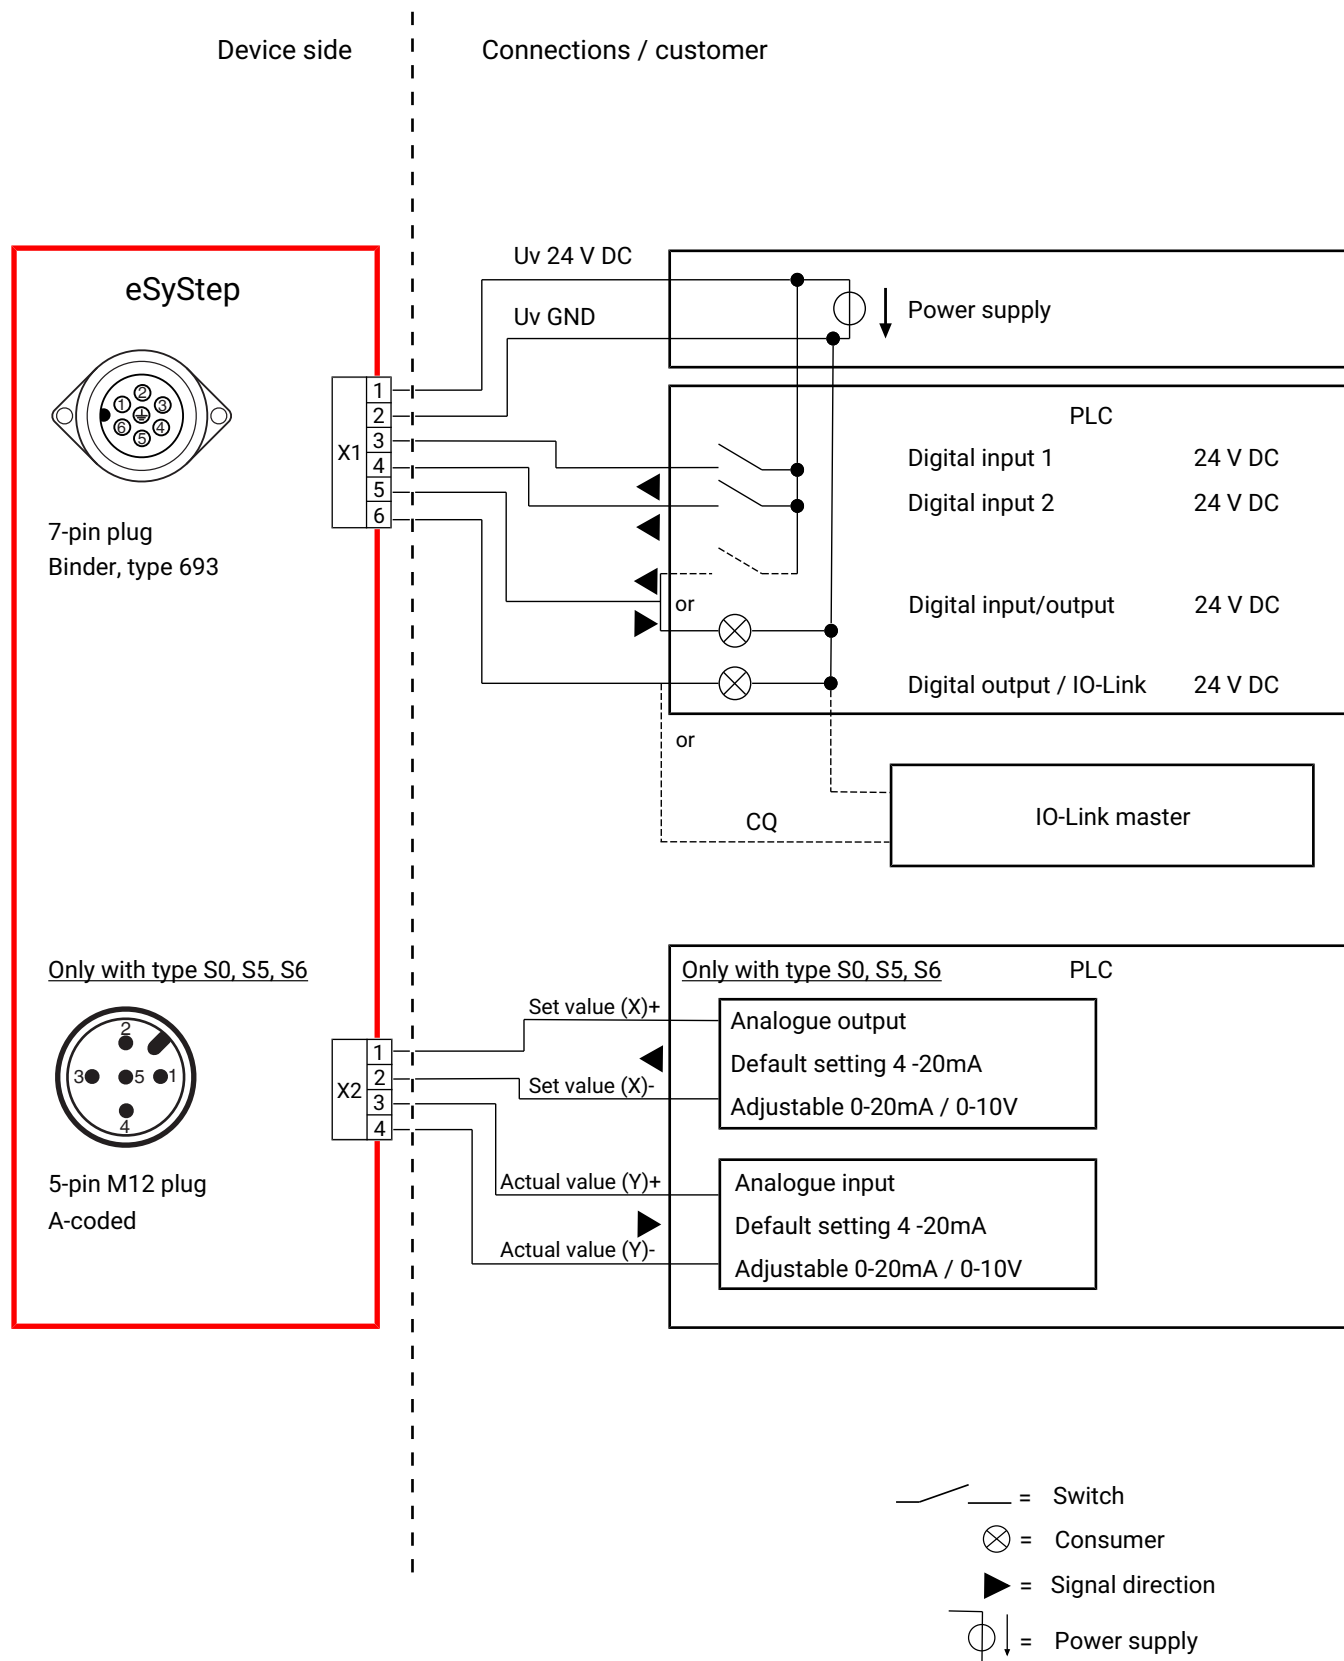

9 Dimensions


9.1 Installation and actuator dimensions - Valve with 2/2-way body

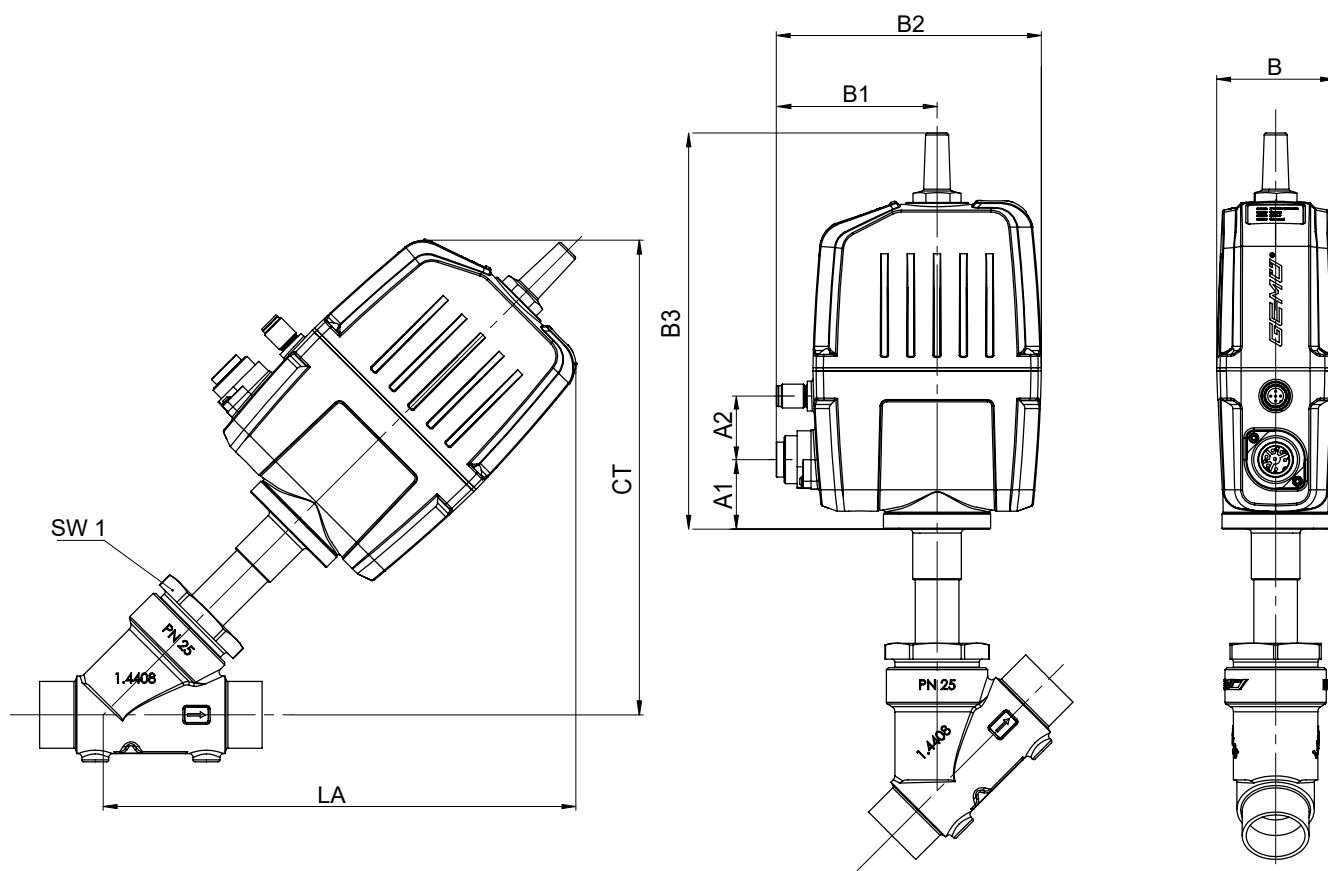

DN	Actuator version	SW1	A1	A2	B	B1	B2	B3	CT	LA
6	0A	24	33.2	32.0	59.4	81.0	133.5	200.5	210.0	209.2
8	0A	24	33.2	32.0	59.4	81.0	133.5	200.5	210.0	209.2
10	0A	24	33.2	32.0	59.4	81.0	133.5	200.5	210.2	209.2
15	0A	36	33.2	32.0	59.4	81.0	133.5	200.5	228.8	227.8
	1A		70.0	32.5	70.0	82.0	150.0	252.0	254.7	260.8
20	0A	41	33.2	32.0	59.4	81.0	133.5	200.5	234.2	233.1
	1A		70.0	32.5	70.0	82.0	150.0	252.0	260.0	266.1
25	0A	46	33.2	32.0	59.4	81.0	133.5	200.5	239.1	238.1
	1A		70.0	32.5	70.0	82.0	150.0	252.0	265.0	271.1
32	1A	55	70.0	32.5	70.0	82.0	150.0	252.0	271.5	277.6
40	1A	60	70.0	32.5	70.0	82.0	150.0	252.0	278.5	284.6
50	1A	75	70.0	32.5	70.0	82.0	150.0	252.0	288.4	294.5

Dimensions in mm

9.2 Installation dimensions - Valve with angle valve body

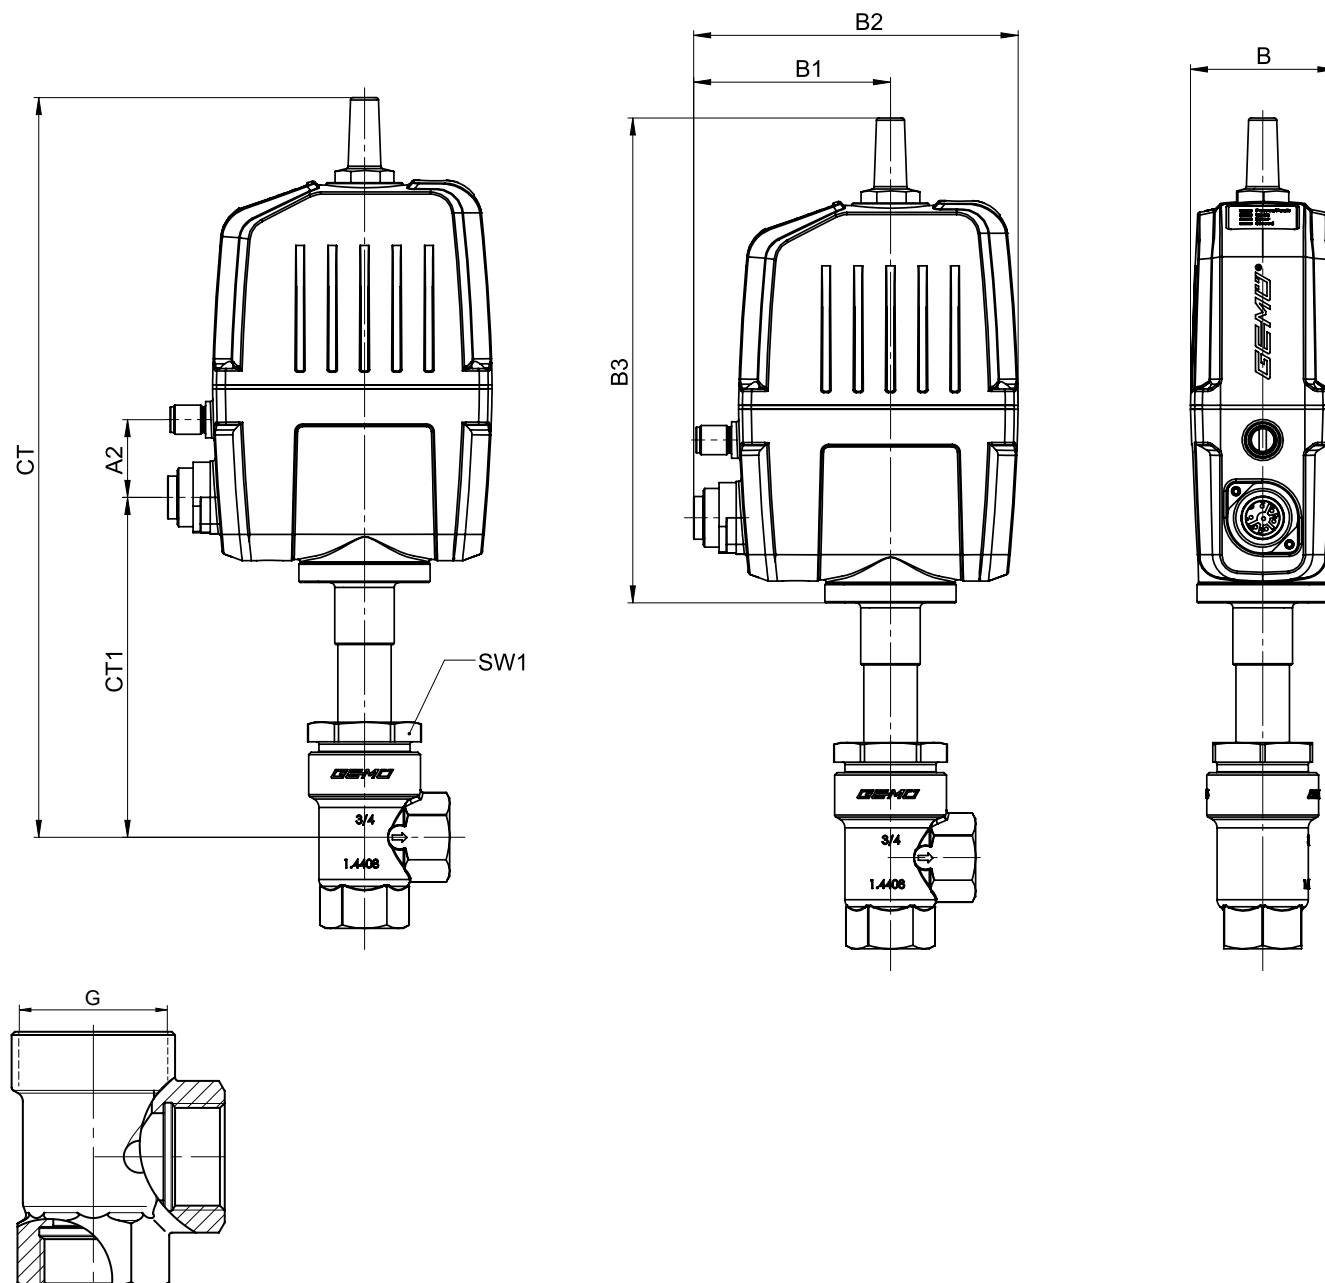


DN	Actuator version	SW1	G	A2	B	B1	B2	B3	CT	CT1
15	0A	36	M35x1.5	32.0	59.4	81.0	133.5	200.5	300.8	136.3
	1A	36	M35x1.5	32.5	70.0	82.0	150.0	252.0	350.8	218.8
20	0A	41	M40x1.5	32.0	59.4	81.0	133.5	200.5	304.3	139.8
	1A	41	M40x1.5	32.5	70.0	82.0	150.0	252.0	354.3	222.3
25	0A	46	M45x1.5	32.0	59.4	81.0	133.5	200.5	308.3	143.8
	1A	46	M45x1.5	32.5	70.0	82.0	150.0	252.0	358.3	226.3
32	1A	55	M52x1.5	32.5	70.0	82.0	150.0	252.0	360.1	228.1
40	1A	60	M60x2.0	32.5	70.0	82.0	150.0	252.0	365.5	233.5
50	1A	75	M72x2.0	32.5	70.0	82.0	150.0	252.0	370.5	238.5

Dimensions in mm

9.3 Body dimensions

9.3.1 Spigot DIN/EN/ISO/ASME/SMS (code 0, 16, 17, 37, 59, 60), actuator size 0A, 1A

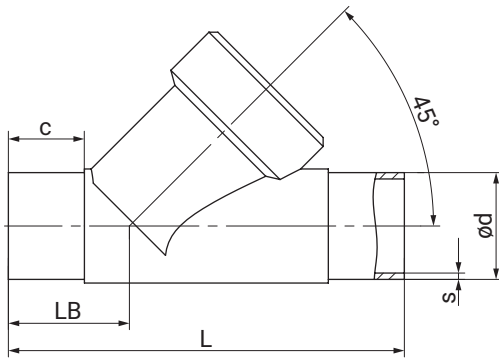

Connection type spigot DIN/EN/ISO (code 0, 16, 17, 60)¹⁾, investment casting material (code 34)²⁾

DN	NPS	c (min)				ød				L	LB	s			
		Connection type										Connection type			
		0	16	17	60	0	16	17	60			0	16	17	60
10	3/8"	-	20.0	20.0	20.0	-	12.0	13.0	17.2	105.0	35.5	-	1.0	1.5	1.6
15	1/2"	20.0	20.0	20.0	20.0	18.0	18.0	19.0	21.3	105.0	35.5	1.5	1.0	1.5	1.6
20	3/4"	25.0	25.0	25.0	25.0	22.0	22.0	23.0	26.9	120.0	39.0	1.5	1.0	1.5	1.6
25	1"	24.5	24.5	24.5	24.5	28.0	28.0	29.0	33.7	125.0	38.5	1.5	1.0	1.5	2.0
32	1¼"	-	26.0	27.0	29.0	-	34.0	35.0	42.4	155.0	48.0	-	1.0	1.5	2.0
40	1½"	24.0	24.0	24.0	43.7	40.0	40.0	41.0	48.3	160.0	47.0	1.5	1.0	1.5	2.0
50	2"	29.0	29.0	29.0	29.0	52.0	52.0	53.0	60.3	180.0	48.0	1.5	1.0	1.5	2.0

Connection type spigot ASME/SMS (code 37, 59)¹⁾, investment casting material (code 34)²⁾

DN	NPS	c (min)		ød		L	LB	s	
		Connection type						Connection type	
		37	59	37	59			37	59
15	1/2"	-	20	-	12.70	105.0	35.5	-	1.65
20	3/4"	-	25	-	19.05	120.0	39.0	-	1.65
25	1"	24.5	24.5	25.0	25.40	125.0	38.5	1.2	1.65
40	1½"	24	24	38.0	38.10	160.0	47.0	1.2	1.65
50	2"	29	29	51.0	50.80	180.0	48.0	1.2	1.65

Dimensions in mm

1) Connection type

Code 0: Spigot DIN

Code 16: Spigot DIN EN 10357 series B (2014 issue; formerly DIN 11850 series 1)

Code 17: Spigot EN 10357 series A/DIN 11866 series A, formerly DIN 11850 series 2

Code 37: Spigot SMS 3008


Code 59: Spigot ASME BPE/DIN EN 10357 series C (from 2022 issue)/DIN 11866 series C

Code 60: Spigot ISO 1127/DIN EN 10357 series C (2014 issue)/DIN 11866 series B

2) Valve body material

Code 34: 1.4435, investment casting

9.3.2 Spigot EN/ISO (code 17, 60), actuator size 0A, 1A

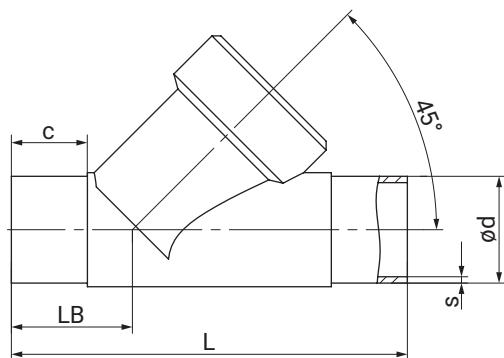

Connection type spigot EN/ISO (code 17, 60)¹⁾, investment casting material (code 37)²⁾

DN	NPS	c (min)		ød		L	LB	s	
		Connection type						Connection type	
		17	60	17	60			17	60
15	1/2"	18	18	19.0	21.3	100.0	33.0	1.5	1.6
20	3/4"	18	18	23.0	26.9	108.0	33.0	1.5	1.6
25	1"	18	18	29.0	33.7	112.0	32.0	1.5	2.0
32	1¼"	18	18	35.0	42.4	137.0	39.0	1.5	2.0
40	1½"	19	18	41.0	48.3	146.0	40.0	1.5	2.0
50	2"	20	20	53.0	60.3	160.0	38.0	1.5	2.0

Dimensions in mm

1) Connection type


Code 17: Spigot EN 10357 series A/DIN 11866 series A, formerly DIN 11850 series 2

Code 60: Spigot ISO 1127/DIN EN 10357 series C (2014 issue)/DIN 11866 series B

2) Valve body material

Code 37: 1.4408, investment casting

9.3.3 Spigot EN/ISO/ASME (code 17, 59, 60), actuator size 0A, 1A

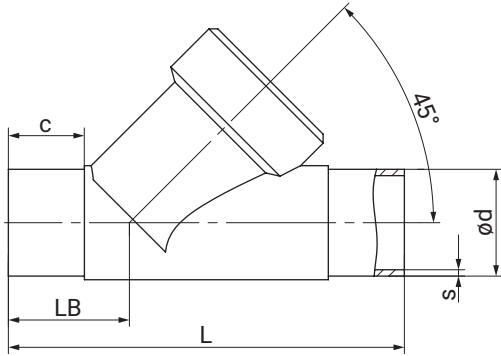

Connection type spigot EN/ISO/ASME (code 17, 59, 60)¹⁾, investment casting material (code C2)²⁾

DN	NPS	c (min)			ød			L	LB	s		
		Connection type								Connection type		
		17	59	60	17	59	60			17	59	60
8	1/4"	-	-	20	-	-	13.5	80.0	35.5	-	-	1.6
10	3/8"	20	-	20	13.0	-	17.2	100.0	35.5	1.5	-	1.6
15	1/2"	20	15	20	19.0	12.70	21.3	105.0	35.5	1.5	1.65	1.6
20	3/4"	25	25	25	23.0	19.05	26.9	120.0	39.0	1.5	1.65	1.6
25	1"	24	24	24	29.0	25.40	33.7	125.0	39.5	1.5	1.65	2.0
32	1¼"	27	-	26.1	35.0	-	42.4	155.0	48.0	1.5	-	2.0
40	1½"	24	23	28.9	41.0	38.10	48.3	160.0	47.0	1.5	1.65	2.0
50	2"	28.23	28.23	48	53.0	50.80	60.3	180.0	48.0	1.5	1.65	2.0

Dimensions in mm

1) **Connection type**

Code 17: Spigot EN 10357 series A/DIN 11866 series A, formerly DIN 11850 series 2


Code 59: Spigot ASME BPE/DIN EN 10357 series C (from 2022 issue)/DIN 11866 series C

Code 60: Spigot ISO 1127/DIN EN 10357 series C (2014 issue)/DIN 11866 series B

2) **Valve body material**

Code C2: 1.4435, investment casting

9.3.4 Threaded socket DIN/Rc/NPT body configuration D (code 1, 3C, 3D), actuator size 0A, 1A

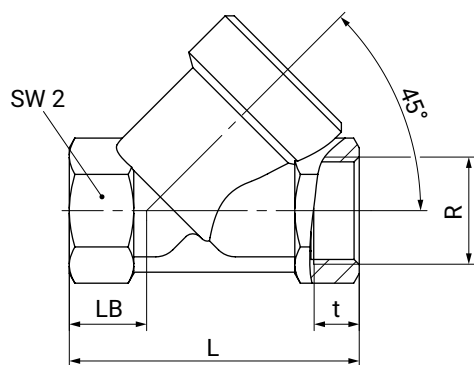

Connection type threaded socket DIN (code 1)¹⁾, investment casting material (code 37)²⁾

DN	NPS	L	LB	R	SW2	t
10	3/8"	65.0	16.5	G 3/8	27	11.4
15	1/2"	65.0	16.5	G 1/2	27	15.0
20	3/4"	75.0	17.5	G 3/4	32	16.3
25	1"	90.0	24.0	G 1	41	19.1
32	1 1/4"	110.0	33.0	G 1 1/4	50	21.4
40	1 1/2"	120.0	30.0	G 1 1/2	55	21.4
50	2"	150.0	40.0	G 2	70	25.7

Connection type threaded socket Rc/NPT (code 3C, 3D)¹⁾, investment casting material (code 37)²⁾

DN	NPS	L	LB	R		SW2	t	
				Connection type			Connection type	
				3C	3D		3C	3D
15	1/2"	65.0	16.5	Rc 1/2	1/2" NPT	27	15.0	13.6
20	3/4"	75.0	17.5	Rc 3/4	3/4" NPT	32	16.3	14.1
25	1"	90.0	24.0	Rc 1	1" NPT	41	19.1	17.0
32	1¼"	110.0	33.0	Rc 1¼	1¼" NPT	50	21.4	17.5
40	1½"	120.0	30.0	Rc 1½	1½" NPT	55	21.4	17.3
50	2"	150.0	40.0	Rc 2	2" NPT	70	25.7	17.8

Dimensions in mm

1) Connection type

Code 1: Threaded socket DIN ISO 228


Code 3C: Threaded socket Rc ISO 7-1, EN 10226-2, JIS B 0203, BS 21, end-to-end dimension ETE DIN 3202-4 series M8

Code 3D: Threaded socket NPT, end-to-end dimension ETE DIN 3202-4 series M8

2) Valve body material

Code 37: 1.4408, investment casting

9.3.5 Threaded socket DIN/NPT body configuration E (code 1, 3D), actuator size 0A, 1A

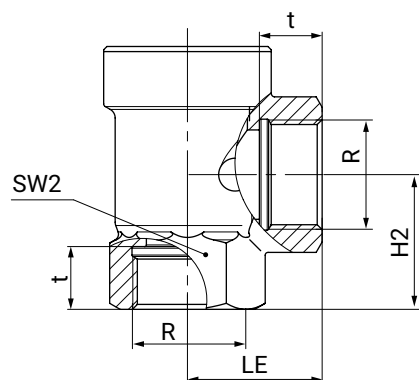

Connection type threaded socket DIN/NPT (code 1, 3D)¹⁾, investment casting material (code 37)²⁾

DN	NPS	H2	LE	SW2	R		t	
					Connection type		Connection type	
					1	3D	1	3D
15	1/2"	30.0	30.0	27	G 1/2	1/2" NPT	15.0	13.6
20	3/4"	37.5	35.0	32	G 3/4	3/4 " NPT	16.3	14.1
25	1"	41.0	41.0	41	G 1	1" NPT	19.1	17.0
32	1¼"	48.0	50.0	50	G 1¼	1¼" NPT	21.4	17.5
40	1½"	55.0	50.0	55	G 1½	1½" NPT	21.4	17.3
50	2"	62.0	60.0	70	G 2	2" NPT	25.7	17.8

Dimensions in mm

1) Connection type


Code 1: Threaded socket DIN ISO 228

Code 3D: Threaded socket NPT, end-to-end dimension ETE DIN 3202-4 series M8

2) Valve body material

Code 37: 1.4408, investment casting

9.3.6 Threaded spigot DIN (code 9), actuator size 0A, 1A

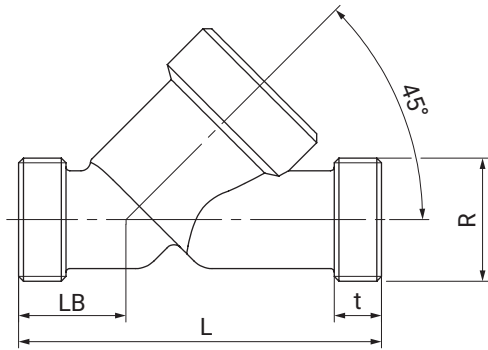


Connection type threaded spigot DIN (code 9)¹⁾, investment casting material (code 37)²⁾

DN	L	LB	R	t
15	90.0	25.0	G 3/4	12.0
20	110.0	30.0	G 1	15.0
25	118.0	30.0	G 1¼	15.0
32	130.0	38.0	G 1½	13.0
40	140.0	35.0	G 1¾	13.0
50	175.0	50.0	G 2¾	15.0

Dimensions in mm

- 1) **Connection type**
Code 9: Threaded spigot DIN ISO 228
- 2) **Valve body material**
Code 37: 1.4408, investment casting

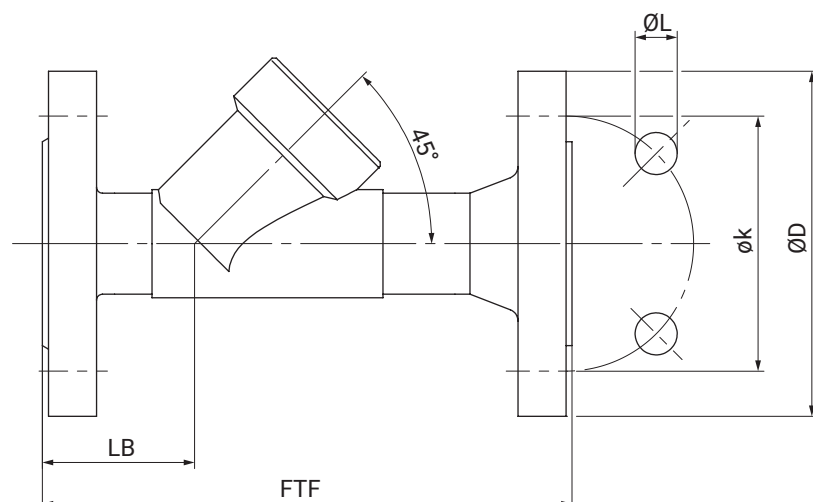9.3.7 Flange EN (code 10), actuator size 0A, 1A**Connection type flange EN (code 10)¹⁾, investment casting material (code 37)²⁾**

DN	NPS	ø D	FTF	ø k	ø L	LB	n
15	1/2"	95.0	130.0	65.0	14.0	33.0	4
20	3/4"	105.0	150.0	75.0	14.0	45.0	4
25	1"	115.0	160.0	85.0	14.0	44.0	4
32	1¼"	140.0	180.0	100.0	18.0	51.0	4
40	1½"	150.0	200.0	110.0	18.0	52.0	4
50	2"	165.0	230.0	125.0	18.0	50.0	4

Dimensions in mm

n = number of bolts


1) Connection type

Code 10: Flange EN 1092, PN 25, form B, face-to-face dimension FTF EN 558 series 1, ISO 5752, basic series 1

2) Valve body material

Code 37: 1.4408, investment casting

9.3.8 Flange, special length EN/ANSI (code 13, 47), actuator size 0A, 1A

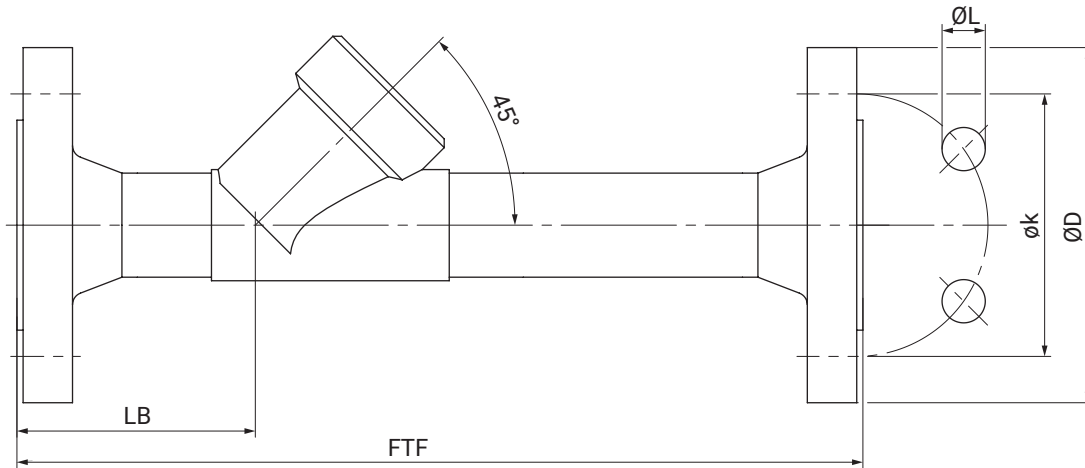

Connection type flange, special length EN/ANSI (code 13, 47)¹⁾, investment casting material (code 34)²⁾

DN	NPS	ØD		FTF	øk		ØL		LB	n
		Connection type			Connection type		Connection type			
		13	47		13	47	13	47		
15	1/2"	95.0	89.0	210.0	65.0	60.5	14.0	15.7	72.0	4
20	3/4"	105.0	98.6	280.0	75.0	69.8	14.0	15.7	78.0	4
25	1"	115.0	108.0	280.0	85.0	79.2	14.0	15.7	77.0	4
32	1¼"	140.0	117.3	310.0	100.0	88.9	18.0	15.7	89.0	4
40	1½"	150.0	127.0	320.0	110.0	98.6	18.0	15.7	91.0	4
50	2"	165.0	152.4	330.0	125.0	120.7	18.0	19.1	95.0	4

Dimensions in mm

n = number of bolts


1) **Connection type**

Code 13: Flange EN 1092, PN 25, form B

Code 47: Flange ANSI Class 150 RF

2) **Valve body material**

Code 34: 1.4435, investment casting

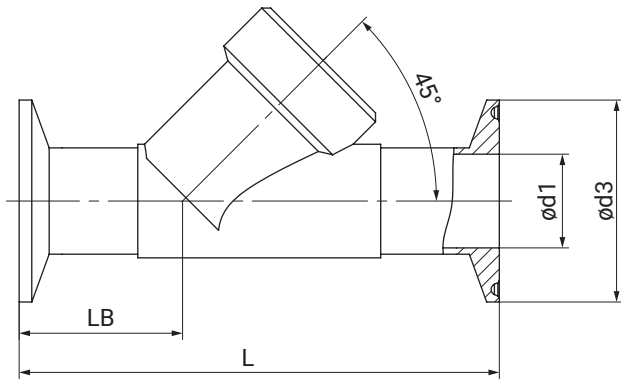9.3.9 Clamp DIN/ASME (code 80, 82, 86, 88), actuator size 0A, 1A**Connection type clamp DIN/ASME (code 80, 82, 86, 88)¹⁾, investment casting material (code 34)²⁾**

DN	NPS	ød1				ød3				L				LB			
		Connection type				Connection type				Connection type				Connection type			
		80	82	86	88	80	82	86	88	80	82	86	88	80	82	86	88
15	1/2"	9.40	18.1	16.0	9.40	25.0	50.5	34.0	25.0	101.6	130.0	130.0	130.0	33.5	47.5	47.5	47.5
20	3/4"	15.75	23.7	20.0	15.75	25.0	50.5	34.0	25.0	101.6	150.0	150.0	150.0	30.0	54.0	54.0	54.0
25	1"	22.10	29.7	26.0	22.10	50.5	50.5	50.5	50.5	114.3	160.0	160.0	160.0	33.0	56.0	56.0	56.0
32	1 1/4"	-	38.4	32.0	-	-	64.0	50.5	-	-	180.0	180.0	-	-	62.0	62.0	-
40	1 1/2"	34.80	44.3	38.0	34.80	50.5	64.0	50.5	50.5	139.7	200.0	200.0	200.0	37.0	67.0	67.0	67.0
50	2"	47.50	56.3	50.0	47.50	64.0	77.5	64.0	64.0	158.8	230.0	230.0	230.0	36.5	73.0	73.0	73.0

Dimensions in mm

1) Connection type

Code 80: Clamp ASME BPE, face-to-face dimension FTF ASME BPE

Code 82: Clamp DIN 32676 series B, face-to-face dimension FTF EN 558 series 1


Code 86: Clamp DIN 32676 series A, face-to-face dimension FTF EN 558 series 1

Code 88: Clamp ASME BPE, for pipe ASME BPE, face-to-face dimension FTF EN 558 series 1

2) Valve body material

Code 34: 1.4435, investment casting

9.3.10 Clamp DIN/ASME (code 82, 86, 88), actuator size 0A, 1A

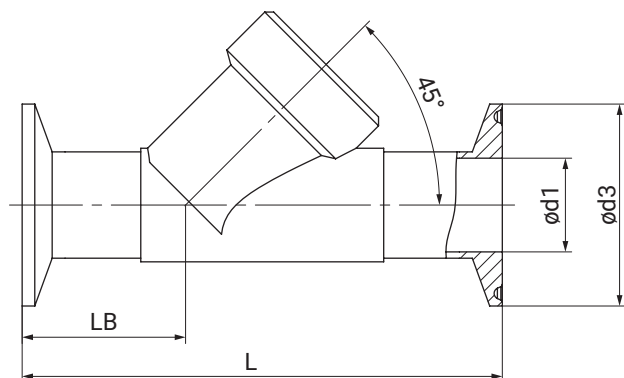

Connection type clamp DIN/ASME (code 82, 86, 88)¹⁾, investment casting material (code C2)²⁾

Connection type clamp DN/AOLE (code 82, 86, 88) , investment casting material (code 82)									
DN	NPS	ød1			ød3			L	LB
		Connection type			Connection type				
		82	86	88	82	86	88		
8	1/4"	10.3	-	-	25.0	-	-	130.0	47.5
10	3/8"	14.0	10.0	-	25.0	34.0	-	130.0	47.5
15	1/2"	18.1	16.0	9.40	50.5	34.0	25.0	130.0	47.5
20	3/4"	23.7	20.0	15.75	50.5	34.0	25.0	150.0	54.0
25	1"	29.7	26.0	22.10	50.5	50.5	50.5	160.0	56.0
32	1¼"	38.4	32.0	-	64.0	50.5	-	180.0	62.0
40	1½"	44.3	38.0	34.80	64.0	50.5	50.5	200.0	67.0
50	2"	56.3	50.0	47.50	77.5	64.0	64.0	230.0	73.0

Dimensions in mm

1) Connection type

Code 82: Clamp DIN 32676 series B, face-to-face dimension FTF EN 558 series 1

Code 86: Clamp DIN 32676 series A, face-to-face dimension FTF EN 558 series 1

Code 88: Clamp ASME BPE, for pipe ASME BPE, face-to-face dimension FTF EN 558 series 1

2) Valve body material

Code C2: 1.4435, investment casting

10 Manufacturer's information

10.1 Delivery

- Check that all parts are present and check for any damage immediately upon receipt.

The product's performance is tested at the factory. The scope of delivery is apparent from the dispatch documents and the design from the order number.

10.2 Packaging

The product is packaged in a cardboard box which can be recycled as paper.

10.3 Transport

1. Only transport the product by suitable means. Do not drop. Handle carefully.
2. After the installation dispose of transport packaging material according to relevant local or national disposal regulations / environmental protection laws.

10.4 Storage

1. Store the product free from dust and moisture in its original packaging.
2. Avoid UV rays and direct sunlight.
3. Do not exceed the maximum storage temperature (see chapter "Technical data").
4. Do not store solvents, chemicals, acids, fuels or similar fluids in the same room as GEMÜ products and their spare parts.
5. Close the compressed air connections with protection caps or sealing plugs.

11 Installation in piping

11.1 Preparing for installation

⚠ WARNING	
	The equipment is subject to pressure! ▶ Risk of severe injury or death ● Depressurize the plant or plant component. ● Completely drain the plant or plant component.
⚠ WARNING	
	Corrosive chemicals! ▶ Risk of caustic burns ● Wear appropriate protective gear. ● Completely drain the plant.

⚠ CAUTION	
	Hot plant components! ▶ Burns ● Only work on plant that has cooled down. ● Wear protective gear.
⚠ CAUTION	
	Maximum permissible pressure exceeded! ▶ Damage to the product! ● Provide for precautionary measures against exceeding the maximum permissible pressure that may be caused by pressure surges (water hammer).
⚠ CAUTION	
Use as step! ▶ Damage to the product ▶ Risk of slipping-off ● Choose the installation location so that the product cannot be used as a foothold. ● Do not use the product as a step or a foothold.	
NOTICE	
Suitability of the product! ▶ The product must be appropriate for the piping system operating conditions (medium, medium concentration, temperature and pressure) and the prevailing ambient conditions.	

NOTICE

Tools!

- The tools required for installation and assembly are not included in the scope of delivery.
- Use appropriate, functional and safe tools.

1. Ensure that the product is suitable for the respective application.
2. Check the technical data of the product and the materials.
3. Keep appropriate tools ready.
4. Wear appropriate protective gear in accordance with the plant operator's guidelines.
5. Observe appropriate regulations for connections.
6. Have installation work carried out by trained personnel.
7. Shut off the plant or plant component.
8. Secure the plant or plant component against recommissioning.
9. Depressurize the plant or plant component.
10. Completely drain the plant or plant component and allow it to cool down until the temperature is below the media vaporization temperature and cannot cause scalding.
11. Correctly decontaminate, rinse and ventilate the plant or plant component.
12. Lay piping so that the product is protected against transverse and bending forces, and also vibrations and tension.
13. Only mount the product between matching aligned pipes (see following chapters).
14. Please note the flow direction.
15. Pay attention to the installation position (see the "Installation position" chapter).

11.2 Installation position

GEMÜ recommend installing the actuator vertically upright or vertically down to optimise the service life.

11.3 Installation with butt weld spigots

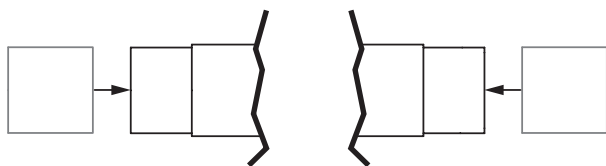


Fig. 1: Butt weld spigots

1. Carry out preparations for installation (see chapter "Preparing for installation").
2. Adhere to good welding practices!
3. Disassemble the actuator with the diaphragm before welding in the valve body (see "Removing the actuator" chapter).
4. Weld the body of the product in the piping.
5. Allow butt weld spigots to cool down.
6. Reassemble the valve body and the actuator with diaphragm (see "Mounting the actuator" chapter).
7. Re-attach or reactivate all safety and protective devices.
8. Flush the system.

11.4 Installation with threaded sockets

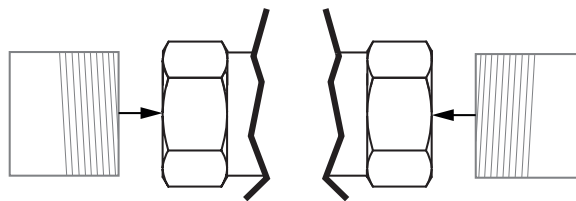


Fig. 2: Threaded socket

NOTICE

Sealing material!

- The sealing material is not included in the scope of delivery.
- Only use appropriate sealing material.

1. Keep thread sealant ready.
2. Carry out preparations for installation (see chapter "Preparing for installation").
3. Screw the threaded connections into the pipe in accordance with valid standards.
4. Screw the body of the product onto the piping using appropriate thread sealant.
5. Re-attach or reactivate all safety and protective devices.

11.5 Installation with threaded spigots

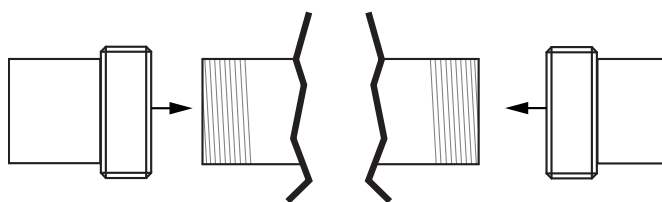


Fig. 3: Threaded spigots

NOTICE

Thread sealant!

- The thread sealant is not included in the scope of delivery.
- Only use appropriate thread sealant.

1. Keep thread sealant ready.
2. Carry out preparations for installation (see chapter "Preparing for installation").
3. Screw the pipe into the threaded connection of the valve body in accordance with valid standards.
⇒ Use appropriate thread sealant.
4. Re-attach or reactivate all safety and protective devices.

11.6 Installation with flanged connection

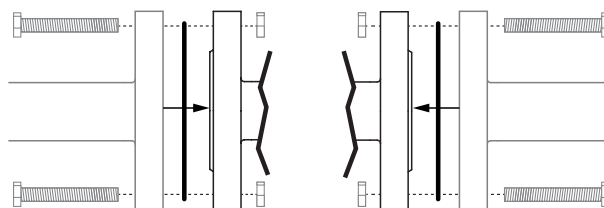


Fig. 4: Flanged connection

NOTICE

Sealing material!


- The sealing material is not included in the scope of delivery.
- Only use appropriate sealing material.

NOTICE

Connector elements!

- The connector elements are not included in the scope of delivery.
- Only use connector elements made of approved materials.
- Observe permissible tightening torque of the bolts.

1. Keep sealing material ready.
2. Carry out preparations for installation (see chapter "Preparing for installation").
3. Ensure clean, undamaged sealing surfaces on the connection flanges.
4. Align flanges carefully before installing them.
5. Clamp the product centrally between the piping with flanges.
6. Centre the gaskets.
7. Connect the valve flange and the piping flange using appropriate sealing materials and matching bolting.
8. Use all flange holes.
9. Tighten the bolts diagonally.



10. Re-attach or reactivate all safety and protective devices.

11.7 Installation with clamp connections

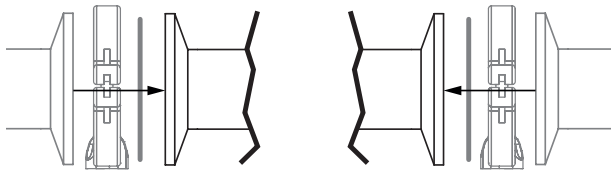


Fig. 5: Clamp connection

NOTICE

Gasket and clamp!

- The gasket and clamps for clamp connections are not included in the scope of delivery.
1. Keep ready gasket and clamp.
 2. Carry out preparation for installation (see chapter "Preparing for installation").
 3. Insert the corresponding gasket between the body of the product and the pipe connection.
 4. Connect the gasket between the body of the product and the pipe connection using clamps.
 5. Re-attach or reactivate all safety and protective devices.


12 Specific data IO-Link (pin 6)

IO-Link process data and parameters can be set via pin 6 for the motorized linear actuator eSyStep. The assignment of the connectors and the current consumption of the actuator are non-compliant with the IO-Link specification.

12.1 Operation on IO-Link

12.1.1 Operation on PLC as a 24 V device

The motorized actuator GEMÜ eSyStep can be operated directly in a PLC control unit without limitations. Technical data of the product and of PLC must be complied with.

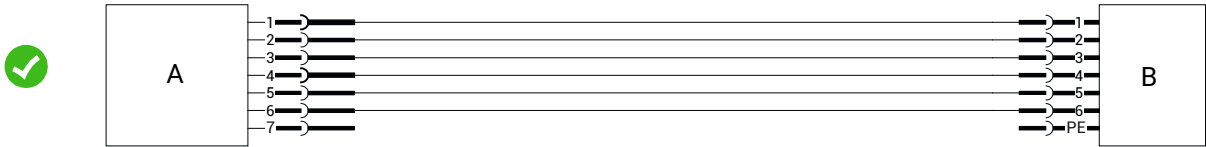

Item	Name
A	eSyStep
B	PLC with supply voltage

12.1.2 Operation on PLC and additional parameterization via USB master with galvanic isolation


Basics

When operating the product on a PLC control unit, a parameterization via a USB IO-Link master is possible at the same time. In this case, a galvanically isolated USB interface must be used. The PC/laptop can be used as usual and all peripheral devices can remain connected.

Connection

1. Connect **pin 3 (L-)** of the master with **pin 2 (GND)** of the product.
2. Connect **pin 4 (CQ)** of the master with **pin 6** of the product.

During IO-Link operation, pin 6 **cannot** be evaluated by the PLC control unit as an output signal.

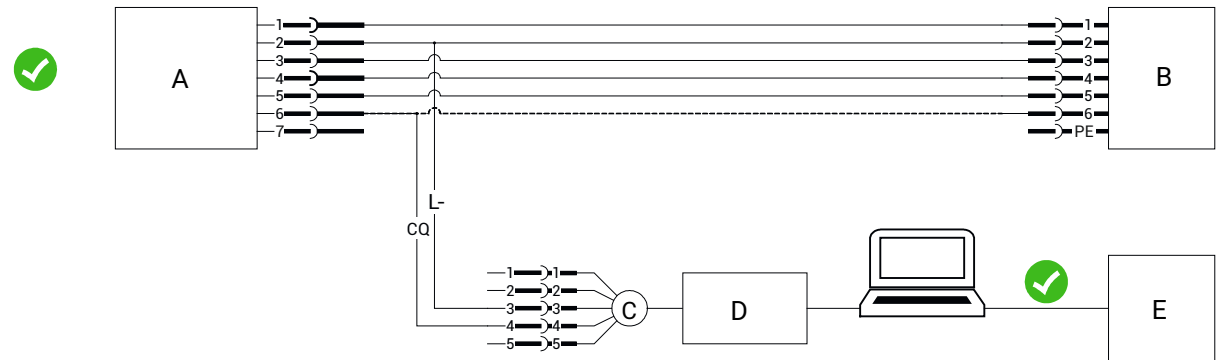

Item	Name
A	eSyStep
B	PLC with supply voltage
C	USB IO-Link Master
D	Galvanically isolated USB interface
E	Mains plug – laptop

12.1.3 Operation on PLC and additional parameterization via USB master without galvanic isolation


Basics

Only one laptop can be used if no galvanic isolation is available for the USB interface during communication via a USB IO-Link master. No other peripheral devices may be connected to the laptop. The laptop may only be operated without a power supply unit.

If further peripheral devices and the power supply unit are not disconnected, different ground potentials to the product can result in excessive compensating currents. These can damage the USB interface of the laptop, the connected peripheral devices or the USB IO-Link master.

Connection

- 1. Connect **pin 3 (L-)** of the master with **pin 2 (GND)** of the product.
 - 2. Connect **pin 4 (CQ)** of the master with **pin 6** of the product.
- During IO-Link operation, pin 6 **cannot** be evaluated by the PLC control unit as an output signal.

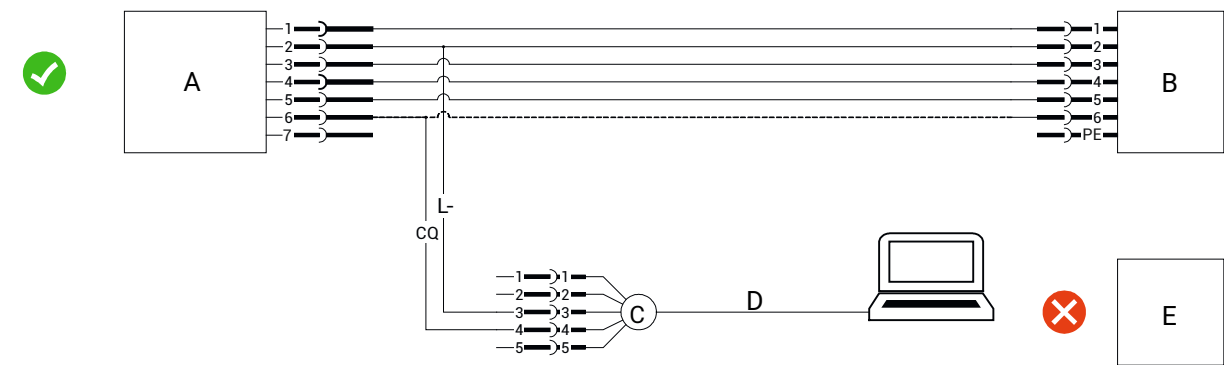

Item	Name
A	eSyStep
B	PLC with supply voltage
C	USB IO-Link Master
D	USB interface
E	Mains plug – laptop

12.1.4 Direct operation on the IO-Link master

Basics

If the product is to be operated on an IO-Link master, it must be ensured that the **GND** levels in the product and in the IO-Link master have the same potential so that there are no compensating currents which would cause damage in the system. This can be made possible using several procedures.


12.1.4.1 Identical power supply

The IO-Link master is operated from the same power supply as the product.

- Connect **pin 4 (CQ)** of the master with **pin 6** of the product.

However, **pin 3 (L-)** of the master should **not** be connected to **pin 2 (GND)** of the product under any circumstances.

This prevents a ground loop and no unexpected high currents can occur via **pin 3 (L-)** which can damage the master.

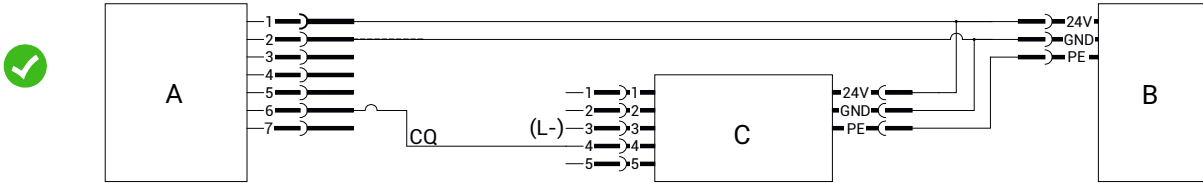


Item	Name
A	eSyStep
B	Supply voltage
C	USB IO-Link Master

12.1.4.2 Separate power supply, GND-connected

The IO-Link master and the product can also be operated with different power supply sources if the **GND** of both power supply sources is connected. In this case, the master is connected as when the power supply is identical

- Connect **pin 4 (CQ)** IO-Link master with **pin 6** of the product.

Do **not** connect (**pin 3**) L- IO-Link master.

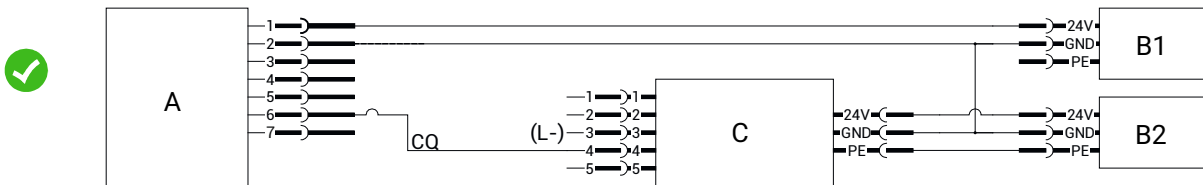

Item	Name
A	eSyStep
B1 and B2	Supply voltages
C	USB IO-Link Master

12.2 Process data

The motorized linear actuator has IO-Link process data. This data is transmitted cyclically with each IO-Link telegram.

Note: To control the valve via IO-Link process data, parameter index 0x50 – subindex 4 (Basic Settings – IO-Link process data) must be set to 1 (Enable).

Master → Device

Name	Bit	Values
Drive go Open	0	0 → Actuator does not move into position Open
		1 → Actuator moves into position Open
Drive go Close	1	0 → Actuator does not move into position Closed
		1 → Actuator moves into position Closed
Start initialization	2	0 → No initialization
		1 → Start initialization
Locate	3	0 → Off
		1 → On
Setpoint analog	8 ... 23	Setpoint in the range 0 ... 1000

Device → Master

Name	Bit	Values
Valve position Open	0	0 → Process valve not in Open position
		1 → Process valve in Open position
Valve position Close	1	0 → Process valve not in Closed position
		1 → Process valve in Closed position
Operating mode	2	0 → Normal operation
		1 → Initialization mode
Valve position analog	8 ... 23	Position of the valve in the range 0 ... 1000

12.3 Parameter overview

NOTICE

► All IO-Link parameters that contain sub-indexes can also be addressed in bundles via sub-index 0.

Index	Sub-Index	Access rights	Index name	Parameter	Function	Default settings	Setting options
0x02	0	W	System command		Transmission of commands for block parameterization and data storage		0x01 to 0x06 0x82
0x03	1	R/W	Data storage index	Data storage cmd	Saving and restoring parameter data for device identical in construction		
	2	RO		State property			
	3	RO		Data storage size			
	4	RO		Parameter checksum			
	5	RO		Index list			
0x0C	1	R/W	Device access locks	Parameter (write) access	Parameter write protection		0 → unlocked 1 → locked
	2	R/W		Data storage	Data memory		0 → unlocked 1 → locked
	3	R/W		Local parameterization	Local parameterization		0 → unlocked 1 → locked
	4	R/W		Local user interface	Local user interface		0 → unlocked 1 → locked
0x0D	0	RO	Profile characteristics		Supported Device Profile IDs, Common Application Profile IDs, Function Class IDs		0x8000 (Device Ident. Objects) 0x8002 (Process Data Mapping) 0x8003 (Diagnosis) 0x8100 (Ext. Identification)
0x0E	0	RO	Process data input descriptor		Data format of input process data		0x00 (Bit offset) 0x03 (Type Length) 0x01 (DataType -> BoolT)
0x0F	0	RO	Process data output descriptor		Data format of output process data		0x00 (Bit offset) 0x04 (Type Length) 0x01 (DataType -> BoolT)
0x10	0	RO	Vendor name		Read out manufacturer name		"GEMUE"
0x12	0	RO	Product name		Read out device name		"eSyStep Positioner"
0x13	0	RO	Product ID		Read out product ID		"eSyStep Positioner"
0x15	0	RO	Serial number		Read out serial number		"XXXXXXXX/YYYY"
0x16	0	RO	Hardware revision		Read out hardware version		"Rev. XX/XX"
0x17	0	RO	Firmware revision		Read out software version		"V X.X.X.X."

Index	Sub-Index	Access rights	Index name	Parameter	Function	Default settings	Setting options
0x18	0	R/W	Application specific tag		Text with 32 characters can be entered		*****"
0x19	0	R/W	Function tag		Text with 32 characters can be entered		*****"
0x1A	0	R/W	Location tag		Text with 32 characters can be entered		*****"
0x24	0	RO	Device status		(Simple) device status		0 → Operating properly 2 → Out of specification 4 → Failure
0x25	0	RO	Device status		Detailed device status		
0x40	0	RO	Actuator size		Read out actuator size	Depending on the actuator size used	0 → Actuator size 0 1 → Actuator size 1 2 → Actuator size 2
0x4B	1	R/W	Function digital inputs	Input 1	Configure digital input 1	4	0 → Off 1 → Open 2 → Close 3 → Safe/On 4 → Init 5 → Open Total 6 → Close Total
	2	R/W		Input 2	Configure digital input 2	0	0 → Off 1 → Open 2 → Close 3 → Safe/On 4 → Init 5 → Open Total 6 → Close Total
0x4C	1	R/W	Function digital in-/output 1	In- / output 1	Configure digital inputs/outputs	2	0 → Output open 1 → Output close 2 → Output error 3 → Output Error & warning 4 → Input init
	2	R/W		Type in- / output 1	Configure type of digital inputs/outputs	0	0 → Push-pull 1 → NPN 2 → PNP
0x4D	0	R/W	Function digital output 2		Configure digital output	1	0 → Output open 1 → Output close 2 → Output error 3 → Output error & warning
0x4E	1	R/W	Logic digital inputs / outputs	Input 1	Configure logical digital input 1	0	0 → Active high 1 → Active low
	2	R/W		Input 2	Configure logical digital input 2	0	0 → Active high 1 → Active low

Index	Sub-Index	Access rights	Index name	Parameter	Function	Default settings	Setting options
	3	R/W		Input / output 1	Configure logical digital input/output	0	0 → Active high 1 → Active low
	4	R/W		Output 2	Configure logical digital output	0	0 → Active high 1 → Active low
0x4F	1	R/W	Error action	Error action	Set safety position	2	0 → Hold 1 → Open 2 → Close
	2	R/W		Error time	Determine time from error detection to error message	1 (0.1s)	1 ... 1000 (0.1s ... 100s)
0x50	1	R/W	Basic settings	Inversion of LED colours	Activate / deactivate inversion of LEDs	0	0 → Standard 1 → Inversed
	2	R/W		On site initialization	Activate / deactivate on site initialization	0	0 → Enabled 1 → Disabled
	3	R/W		Operating mode	Operating mode change-over (positioner; ON/OFF)	0	0 → Positioner 1 → On/Off
	4	R/W		IO-Link process data	Activate/deactivate use of IO-Link process data	0	0 → Disabled 1 → Enabled
0x51	1	R/W	Actuator position feedback	Open request	Request valve position OPEN	900 (90.0%)	30 ... 970 (3.0 ... 97.0%)
	2	R/W		Close request	Request valve position CLOSED	100 (10.0%)	30 ... 970 (3.0 ... 97.0%)
	3	RO		Open real	Real valve position OPEN		0 ... 4095
	4	RO		Close real	Real valve position CLOSED		0 ... 4095
0x53	1	RO	Initialized positions	Open	Analog value valve position OPEN		0 ... 4095
	2	RO		Close	Analog value valve position CLOSED		0 ... 4095
	3	RO		Stroke	Read out the analog value for stroke (difference between OPEN and CLOSED).		0 ... 4095
0x55	1	RO	Calibrated positions	Max.	OPEN end position		0 ... 4095
	2	RO		Min.	CLOSED end position		0 ... 4095
0x60	1	RO	Analog values	Potentiometer	Analog value potentiometer		0 ... 4095
	2	RO		Supply voltage	Analog value supply voltage		0 ... 4095
	3	RO		Temperature	Analog value temperature sensor		0 ... 4095
	4	RO		Set value (W)	Analog value set value signal		0 ... 4095

Index	Sub-Index	Access rights	Index name	Parameter	Function	Default settings	Setting options
0x62	1	RO	Operating times	Open	Operating time OPEN	0	0 to 255 (0 to 25.5s)
	2	RO		Close	Operating time CLOSE	0	0 to 255 (0 to 25.5s)
0x8C	1	R/W	Operating Range	Operating Point Closed	Lower operating point	1000	0 to 1000 (0.0 to 100.0%)
	2	R/W		Operating Point Open	Upper operating point	0	0 to 1000 (0.0 to 100.0%)
0x90	2	R / W	Drive sets	Force	Force, dependent on valve used		1 ... 6
	3	R / W		Force initialization	Force during initialization, dependent on valve used		1 ... 6
	4			Force startup	Force in the starting torque		1 ... 6
0xB0	1	R/W	Control parameters	P amplification	P component – positioner	200	1 ... 200 (0.1 ... 20.0)
	2	R/W		D amplification	D component – positioner	10	1 ... 200 (0.1 ... 20.0)
	3	R/W		Derivative time	Delay constant	0	0 to 100 (0 to 100 s)
	4	R/W		Dead band	Permissible system deviation	10	1 ... 250 (0.1 ... 25.0 %)
0xB2	1	R/W	Open / close tight	Open tight	Sealing function valve position OPEN	995	800 ... 1000 (80.0 ... 100.0 %)
	2	R/W		Close tight	Sealing function valve position CLOSED	5	0 ... 200 (0 ... 20.0 %)
0xB4	1	R/W	Split range	Split start	Set set value start	0	0 to Split End – 100 (0.0 to Split End – 10.0%)
	2	R/W		Split end	Set set value end	1000	Split Start + 100 to 1000 (Split Start + 10.0% to 100.0%)
0xB6	1	R/W	Stroke limiter	Max pos	Stroke limiter valve position OPEN	1000	Min Pos to 1000 (Min Pos to 100.0%)
	2	R/W		Min pos	Stroke limiter valve position CLOSED	0	0 to Max Pos (0.0% to Max Pos)
0xB8	1	R/W	Set value (W) input	Direction	Set value direction set value input	0	0 → Rise (rising) 1 → Fall (falling)
	2	R/W		Type	Determine signal input	1	0 → 0 to 20 mA 1 → 4 to 20 mA 2 → 0 to 10 V
	3	R/W		I min	Determine minimum current input	35	0 to 40 (0 to 4.0 mA)
	4	R/W		I max	Determine maximum current input	205	200 to 220 (20.0 to 22.0 mA)
	5	R/W		U max	Determine maximum current input	103	100 to 110 (10.0 to 11.0 V)

Index	Sub-Index	Access rights	Index name	Parameter	Function	Default settings	Setting options
0xBA	1	R/W	Analog output	Direction	Set value direction set value output	0	0 → Rise (rising) 1 → Fall (falling)
	2	R/W		Type	Determine signal output	1	0 → 0 to 20 mA 1 → 4 to 20 mA 2 → 0 to 10 V
	3	R/W		Min.	Determine minimum signal output	0	0 to Max (0.0% to Max)
	4	R/W		Max	Determine maximum signal output	1000	Min to 1000 (Min to 100%)

12.4 Parameter

The motorized linear actuator eSyStep supports parameter data in the ISDU (Index Service Data Unit). Parameters can be transmitted non-cyclically with ISDU. Block parametrization and data storage are also supported.

12.4.1 System command

The commands required for block parametrization and data storage are transmitted with the **System command** parameter.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x02	0	0	W	1 byte	System command		UIntegerT	0x01 to 0x06 0x82

Description of parameter values

Index name	Parameter	Values	Description
System command		0x01 to 0x06	Access to IO-Link
		0x82	Reset product to default settings *

* Except the index 0x90 settings – Drive Sets, these are not reset.

12.4.2 Data storage index

Changes to the parameters are stored in the IO-Link master with the **Data storage index** parameter and restored with a IO-Link device identical in construction when replaced. To do so, the **Data storage** parameter must be enabled in the Device access locks (see Chapter 12.4.3, page 47) parameter. The parameters are automatically replaced via the IO-Link master.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x03	1	0	R/W	1 byte	Data storage index	Data Storage Cmd	UIntegerT8	
	2	8	RO	1 byte		State Property	UIntegerT8	
	3	16	RO	4 bytes		Data Storage Size	UIntegerT32	
	4	48	RO	4 bytes		Parameter Check-sum	UIntegerT32	
	5	80	RO	41 bytes		Index List	OctetStringT	

12.4.3 Device access locks

Access to the parameters can be controlled with the **Device access locks** parameter.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x0C	1	0	R/W	1 bit	Device access locks	Parameter (write) access	BooleanT	0
								1
	2	1	R/W	1 bit		Data storage	BooleanT	0
								1
	3	2	R/W	1 bit		Local parameterization	BooleanT	0
								1
	4	3	R/W	1 bit		Local user interface	BooleanT	0
								1

Description of parameter values

Index name	Parameter	Values	Description
Device access locks	Local user interface	0	Enable write access
		1	Block write access
	Data storage	0	Enable storage of parameter data in the IO-Link master
		1	Block storage of parameter data in the IO-Link master
	Local parameterization	0	Enable local parameterization
		1	Block local parameterization
	Local user interface	0	Enable local user interface
		1	Block local user interface

12.4.4 Profile Characteristics

The **Profile Characteristics** parameter specifies which DeviceProfileIDs, CommonApplicationProfileIDs and FunctionClassIDs are supported.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x0D	0	0	RO	8 bytes	Profile Characteristics		ArrayT	0x8000
								0x8002
								0x8003
								0x8100

Description of parameter values

Index name	Parameter	Values	Description
Profile Characteristics		0x8000	Device identification objects
		0x8002	Process data mapping
		0x8003	Diagnostics
		0x8100	External identification

12.4.5 ProcessData Input Descriptor

The **ProcessData Input Descriptor** parameter describes the data format of the process data. Thus the master receives information about the process data without IODD.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x0E	0	0	RO	3 byte	ProcessData Input Descriptor		ArrayT	0x00 0x03 0x01

Description of parameter values

Index name	Parameter	Values	Description
ProcessData Input Descriptor		0x00	Bit offset
		0x03	Type length
		0x01	Data type -> BoolT

12.4.6 ProcessData Output Descriptor

The **ProcessData Output Descriptor** parameter describes the data format of the process data. Thus the master receives information about the process data without IODD.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x0F	0	0	RO	3 byte	ProcessData Output Descriptor		ArrayT	0x00 0x04 0x01

Description of parameter values

Index name	Parameter	Values	Description
ProcessData Output Descriptor		0x00	Bit offset
		0x04	Type length
		0x01	Data type -> BoolT

12.4.7 Vendor name

The manufacturer name can be read out in ASCII format with the **Vendor name** parameter.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x10	0	0	RO	5 bytes	Vendor name		StringT	"GEMUE"

12.4.8 Product name

The device name can be read out in ASCII format with the **Product name** parameter.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x12	0	0	RO	18 byte	Product name		StringT	"eSyStep Positioner"

12.4.9 Product ID

The product ID can be read out in ASCII format with the **Product ID** parameter.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x13	0	0	RO	18 byte	Product ID		StringT	"eSyStep Positioner"

12.4.10 Serial number

The serial number of the device can be read out with the **Serial number** parameter.

The serial number consists of an 8-digit traceability number, a forward slash and a 4-digit index.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x15	0	0	RO	13 bytes	Serial number		StringT	"XXXXXXXX/YYY"

12.4.11 Hardware revision

The circuit boards' version can be read out with the **Hardware revision** parameter.

The hardware version is displayed with the 2-digit version number of the basic assembly and the 2-digit version number of the OPEN/CLOSED or positioner assembly.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x16	0	0	RO	10 bytes	Hardware revision		StringT	"Rev. XX/XX"

12.4.12 Firmware revision

The software version can be read out with the **Firmware revision** parameter.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x17	0	0	RO	21 byte	Firmware revision		StringT	"V X.X.X.X"

12.4.13 Application specific tag

A text with 32 characters can be stored in the device with the **Application specific tag** parameter.

For example, installation location, function, installation date, etc.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x18	0	0	R/W	32 bytes	Application specific tag		StringT	"*****"

12.4.14 Function tag

A text with 32 characters can be stored in the device with the **Function tag** parameter.

For example, installation location, function, installation date, etc.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x19	0	0	R/W	32 bytes	Function tag		StringT	„***** “

12.4.15 Location tag

A text with 32 characters can be stored in the device with the **Location tag** parameter.

For example, installation location, function, installation date, etc.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x1A	0	0	R/W	32 bytes	Location tag		StringT	„***** “

12.4.16 Device Status

The simple device status can be read out with the **Device Status** parameter.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x24	0	0	RO	1 byte	Device Status		uint: 8	0
								2
								4

Description of parameter values

Index name	Parameter	Values	Description
Device Status		0	The valve is operating properly
		2	The valve is operated outside the specification
		4	The valve is in fault status

12.4.17 Detailed Device Status

The detailed device status can be read out with the **Detailed Device Status** parameter. The values of the array correspond to the IO-Link events (see chapter 12.5 Events).

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Values
0x25	0	0	RO	39 byte	Detailed Device Status		ArrayT	See chapter 12.5 Events

Description of parameter values

Index name	Parameter	Values	Description
Detailed Device Status			See chapter 12.5 Events

12.4.18 Actuator size

The actuator size can be read out in numbers with the **Actuator size** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x40	0	0	RO	2 bits	Actuator size		uint: 8	Depending on the actuator size used	0 → size 0 1 → size 1 2 → size 2

12.4.19 Function digital inputs

The functions of the digital inputs can be configured with the **Function digital inputs** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x4B	1	0	R/W	3 bits	Function digital inputs	Input 1	uint:8	4	0
									1
									2
									3
									4
									5
									6
	2	8	R/W	3 bits		Input 2	uint:8	0	0
									1
									2
									3
									4
									5
									6

Description of parameter values

Index name	Parameter	Values	Description
Function digital inputs	Input 1	0	(Off) Input not working.
		1	(Open) In case of the corresponding signal, the actuator moves in the OPEN direction. If the other input (Digital Input 2) is configured as "Close", the actuator stops when the inputs are not actuated. If the other input is not configured as "Close", the actuator moves independently in the CLOSED direction when the "Open" input is not actuated.
		2	(Close) In case of the corresponding signal, the actuator moves in the CLOSED direction. If the other input (Digital Input 2) is configured as "Open", the actuator stops when the inputs are not actuated. If the other input is not configured as "Open", the actuator moves independently in the OPEN direction when the "Close" input is not actuated.
		3	(Safe/On) Safety position of the device is triggered. The device operates normally if the signal is active. If there is no signal, the device moves into the safety position. The safety position is defined by the parameter Error Action (index 0x4F (see "Error Action").
		4	(Init) Input can be used as an initialization input.
		5	(Open Total) With the corresponding signal, the actuator moves in the OPEN direction. A limitation of the operating range (Operating Point Open function) is ignored and the actuator moves to the valve stop open position.
		6	(Close Total) With the corresponding signal, the actuator moves in the CLOSED direction. A limitation of the operating range (Operating Point Close function) is ignored and the actuator moves to the valve stop closed position.
	Input 2	0	(Off) Input not working.
		1	(Open) In case of the corresponding signal, the actuator moves in the OPEN direction. If the other input (Digital Input 1) is configured as "Close", the actuator stops when the inputs are not actuated. If the other input is not configured as "Close", the actuator moves independently in the CLOSED direction when the "Open" input is not actuated.
		2	(Close) In case of the corresponding signal, the actuator moves in the CLOSED direction. If the other input (Digital Input 1) is configured as "Open", the actuator stops when the inputs are not actuated. If the other input is not configured as "Open", the actuator moves independently in the OPEN direction when the "Close" input is not actuated.
		3	(Safe/On) Safety position of the device is triggered. The device operates normally if the signal is active. If there is no signal, the device moves into the safety position. The safety position is defined by the parameter Error Action (index 0x4F (see "Error Action").
		4	(Init) Input can be used as an initialization input.
		5	(Open Total) With the corresponding signal, the actuator moves in the OPEN direction. A limitation of the operating range (Operating Point Open function) is ignored and the actuator moves to the valve stop open position.
		6	(Close Total) With the corresponding signal, the actuator moves in the CLOSED direction. A limitation of the operating range (Operating Point Close function) is ignored and the actuator moves to the valve stop closed position.

12.4.20 Function digital in- / output 1

The function of the input/output can be set with the **Function Digital In-/Output 1** (subindex 1) parameter.

Index	Sub- In- dex	Off- set	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x4C	1	0	R/W	3 bits	Function digital in- / output 1	In- / output 1	uint:8	2	0
									1
									2
									3
									4
	2	8	R/W	3 bits		Type in- / output 1	uint:8	0	0
									1
									2

Description of parameter values

Index name	Parameter	Values	Description
Function digital in- / output 1	In- / output	0	(Output Open) Signal is output with the corresponding valve position. Detection of Open depends on the setting of the parameter Position Feedback (index 0x51 (see "Actuator position feedback", page 57)) and a correct initialization.
		1	(Output Close) Signal is output with the corresponding valve position. Detection of Close depends on the setting of the parameter Position Feedback (index 0x51 (see "Actuator position feedback", page 57)) and a correct initialization.
		2	(Output Error) Only output error detection.
		3	(Output Error & Warning) Output error and warnings.
		4	(Input Init) Configure input/output as initialization input.
	Type in- / output	0	(Push-Pull) Configure output as Push-Pull.
		1	(NPN) Configure output as NPN.
		2	(PNP) Configure output as PNP.

12.4.21 Function digital output 2

The output function can be set with the **Function digital output 2** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x4D	0	0	R/W	2 bits	Function digital output 2		uint:8	2	0 1 2 3

Description of parameter values

Index name	Parameter	Values	Description
Function digital output		0	(Output Open) Signal is output with the corresponding valve position. Detection of Open depends on the setting of the parameter Position Feedback (index 0x51 (see "Actuator position feedback", page 57)) and a correct initialization.
		1	(Output Close) Signal is output with the corresponding valve position. Detection of Close depends on the setting of the parameter Position Feedback (index 0x51 (see "Actuator position feedback", page 57)) and a correct initialization.
		2	(Output Error) Only output error detection.
		3	(Output Error & Warning) Output error and warnings.

12.4.22 Logic digital inputs / outputs

The inputs and outputs can be inversed with the **Logic digital inputs/outputs** parameters.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x4E	1	0	R/W	1 bit	Logic digital inputs / outputs	Input 1	Boolean	0	0 1
	2	1	R/W	1 bit		Input 2	Boolean	0	0 1
	3	2	R/W	1 bit		Input / output 1	Boolean	0	0 1
	4	3	R/W	1 bit		Output 2	Boolean	0	0 1

Description of parameter values

Index name	Parameter	Values	Description
Logic digital inputs / outputs	Input 1	0	(Active high) Input 1 not inversed.
		1	(Active low) Input 1 inversed.
	Input 2	0	(Active high) Input 2 not inversed.
		1	(Active low) Input 2 inversed.
	Input / output 1	0	(Active high) Input/output not inversed.
		1	(Active low) Input/output inversed.
	Output 2	0	(Active high) Output not inversed.
		1	(Active low) Output inversed.

12.4.23 Error action

The safety position can be set with the **Error action** parameter.

The safety position is approached when an error occurs, if the supply voltage is too low within the range of 17.8 V to 21.1 V or in case of the corresponding signal present at Safe/On.

NOTICE

- Except the Temperature Over-Run error device, exceeding the permissible motor temperature. If the permissible temperature is exceeded, the motor is switched off to prevent damage.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x4F	1	0	R/W	2 bits	Error action	Error action	uint:8	2	0
									1
									2
	2	0	R/W	10 bits		Error time	uint:16	1 (0.1s)	1 ... 1000 (0.1s to 100s)

Description of parameter values

Index name	Parameter	Values	Description
Error action	Error action	0	(Hold) Actuator remains in the current position in case of an error.
		1	(Open) Actuator moves to the OPEN position in case of an error.
		2	(Close) Actuator moves to the CLOSED position in case of an error.
	Error time	1 ... 1000	Determine delay time between error detection and error message.

12.4.24 Basic settings

The different settings are summarized with the **Basic settings** parameter.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x50	1	0	R/W	1 bit	Basic settings	Inversion of LED colours	Boolean	0	0
									1
	2	1	R/W	1 bit		On site initialization	Boolean	0	0
									1
	3	2	R/W	1 bit		Operating mode	Boolean	0	0
									1
	4	3	R/W	1 bit		IO-Link process data	Boolean	0	0
									1

Description of parameter values

Index name	Parameter	Values	Description
Basic settings	Inversion of LED colours	0	(Standard) LEDs Close = green and Open = yellow (not inverted).
		1	(Inversed) LEDs Close = yellow and Open = green (inverted).
	On site initialization	0	(Enabled) On-site initialization (see "Initialization", page 66) activated.
		1	(Disabled) On-site initialization (see "Initialization", page 66) deactivated.
	Operating mode	0	Operating mode for positioner activated.
		1	Operating mode for OPEN/CLOSE control activated.
	IO-Link process data	0	(Disabled) Use of IO-Link process data (see "Process data", page 40) is deactivated.
		1	(Enabled) Use of IO-Link process data (see "Process data", page 40) is activated.

12.4.25 Actuator position feedback

The settings for the OPEN and CLOSED position feedback can be stored with the **Actuator position feedback** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x51	1	0	R/W	10 bits	Actuator position feedback	Open request	uint:16	900 (90.0%)	30 ... 970 (3.0 ... 97.0%)
	2	16	R/W	10 bits		Close request	uint:16	100 (10.0%)	30 ... 970 (3.0 ... 97.0%)
	3	32	RO	10 bits		Open real	uint:16		0 ... 4095
	4	48	RO	10 bits		Close real	uint:16		0 ... 4095

Description of parameter values

Index name	Parameter	Values	Description
Actuator position feedback	Open request	30 ... 970 (3.0 ... 97.0%)	Request valve position OPEN
	Close request	30 ... 970 (3.0 ... 97.0%)	Request valve position CLOSED
	Open real	0 ... 4095	Real valve position OPEN
	Close real	0 ... 4095	Real valve position CLOSED

12.4.26 Initialized positions

The analog values of the initialized valve positions can be read out with the **Initialized positions** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x53	1	0	RO	12 bits	Initialized positions	Open	uint:16	0	0 ... 4092
	2	16	RO	12 bits		Close	uint:16	4092	0 ... 4092
	3	32	RO	12 bits		Stroke	uint:16	0	0 ... 4092

Description of parameter values

Index name	Parameter	Values	Description
Initialized positions	Open	0 ... 4092	Analog value valve position OPEN
	Close	0 ... 4092	Analog value valve position CLOSED
	Stroke	0 ... 4092	Analog value stroke (difference between OPEN and CLOSED).

12.4.27 Calibration positions

The values of the factory calibration can be read out with the **Calibration positions** parameter.

The values are analog values of the potentiometer in the mechanical end positions of the actuator.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x55	1	0	RO	12 bits	Calibration positions	Max.	uint:16	0	0 ... 4092
	2	16	RO	12 bits		Min.	uint:16	4092	0 ... 4092

Description of parameter values

Index name	Parameter	Values	Description
Calibration positions	Max.	0 ... 4092	Read out analog value of the potentiometer for the mechanical end position OPEN.
	Min.	0 ... 4092	Read out analog value of the potentiometer for the mechanical end position CLOSED.

12.4.28 Analog values

Different analog values can be read out with the **Analog values** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Values
0x60	1	0	RO	12 bits	Analog values	Potentiometer	uint:16	0 ... 4095
	2	16	RO	12 bits		Supply voltage	uint:16	0 ... 4095
	3	32	RO	12 bits		Temperature	uint:16	0 ... 4095
	4	48	RO	12 bits		Set value (W)	uint:16	0 ... 4095

Description of parameter values

Index name	Parameter	Values	Description
Analog values	Potentiometer	0 ... 4095	Read out current analog value of the potentiometer.
	Supply voltage	0 ... 4095	Read out current analog value of the supply voltage.
	Temperature	0 ... 4095	Read out current analog value of the temperature sensor.
	Set value (W)	0 ... 4095	Read out current analog value of the set value.

12.4.29 Operating times

The current valve travel times can be read out with the **Operating times** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x62	1	0	RO	8 bits	Operating times	Open	uint:8	0	0 to 255, 0 to 25.5 s
	2	8	RO	8 bits		Close	uint:8	0	0 to 255, 0 to 25.5 s

Description of parameter values

Index name	Parameter	Values	Description
Operating times	Open	0 to 255 0 to 25.5 s	Read out operating time (in tenths of seconds) from end position CLOSED to end position OPEN.
	Close	0 to 255 0 to 25.5 s	Read out operating time (in tenths of seconds) from end position OPEN to end position CLOSED.

12.4.30 Operating Range

The **Operating Range** parameter is used to reduce the effective operating range of a valve compared to the maximum valve stroke in order to improve controllability in the operating range.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x8C	1	0	R/W	16 bit	Operating Range	Operating Point Closed	uint:16	1000	0 to 1000 (0.0 to 100.0%)
	2	16	R/W	16 bit		Operating Point Open	uint:16	0	0 to 1000 (0.0 to 100.0%)

Description of parameter values

Index name	Parameter	Values	Description
Operating Range	Operating Point Closed	0 to 1000 (0.0 to 100.0%)	Setting the lower operating point.
	Operating Point Open	0 to 1000 (0.0 to 100.0%)	Setting the upper operating point.

12.4.31 Drive sets

The force of the actuator can be influenced with the **Drive sets** parameter when the valve is initialized and during initialization.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0x90	2	8	R/W	3 bits	Drive sets	Force	uint:16	-	1 to 6
	3	16	R/W	3 bits		Force initialization	uint:16	-	1 to 6
	4	24	R/W	3 bits		Force startup	uint:16	-	1 to 6

Description of parameter values

Index name	Parameter	Values	Description
Drive sets	Force	1 to 6	Set the force of the valve. Preset at the factory depending on the valve type.
	Force initialization	1 to 6	Set the force during initialization. Preset at the factory depending on the valve type.
	Force startup	1 to 6	Force of the valve in the starting torque. Preset at the factory depending on the valve type.

Force settings

Actuator size	Setting parameter	Force
AG0 and AG1	1	Minimum force
	6	Maximum force

12.4.32 Control parameters

The properties can be set with the **Control parameters** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0xB0	1	0	R/W	16 bits	Control parameters	P amplification	uint: 16	200	1 ... 200 (0.1 ... 20.0)
	2	16	R/W	16 bits		D amplification	uint: 16	10	1 ... 200 (0.1 ... 20.0)
	3	32	R/W	16 bits		Derivative time	uint: 16	0	0 to 100 (0 to 100 s)
	4	48	R/W	16 bits		Dead band	uint: 16	10	1 ... 250 (0.1 ... 25.0 %)

Description of parameter values

Index name	Parameter	Values	Description
Control parameters	P amplification	1 ... 200 (0.1 ... 20.0)	Set the P component of the positioner.
	D amplification	1 ... 200 (0.1 ... 20.0)	Set the D component of the positioner.
	Derivative time	0 to 100 (0 to 100 s)	Set the delay constant of the positioner.
	Dead band	1 ... 250 (0.1 ... 25.0 %)	Set the permissible system deviation of the positioner.

12.4.33 Open / close tight

The sealing function can be set for the **Open / close tight** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0xB2	1	0	R/W	16 bits	Open / close tight	Open tight	uint:16	995	800 ... 1000 (80.0 ... 100.0 %)
	2	16	R/W	16 bits		Close tight	uint:16	5	0 ... 200 (0.0 ... 20.0 %)

Description of parameter values

Index name	Parameter	Values	Description
Open / close tight	Open tight	800 ... 1000 (80.0 ... 100.0 %)	Set the sealing function valve position OPEN.
	Close tight	0 ... 200 (0 ... 20.0 %)	Set the sealing function valve position CLOSED.

12.4.34 Split range

The start and end of the set value range can be set for **Split range** parameter.

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Default	Values
0xB4	1	0	R/W	16 bits	Split range	Split start	uint: 16	0	0 to Split End – 100 (0.0 to Split End – 10.0%)
	2	16	R/W	16 bits		Split end	uint: 16	1000	Split Start + 100 to 1000 (Split Start + 10.0% to 100.0%)

Description of parameter values

Index name	Parameter	Values	Description
Split range	Split start	0 to Split End – 100 (0.0 to Split End – 10.0%)	Set the start of the set value range.
	Split end	Split Start + 100 to 1000 (Split Start + 10.0% to 100.0%)	Set the end of the set value range.

12.4.35 Stroke limiter

The upper and lower valve position of the control range can be set as stroke limiter with the **Stroke limiter** parameter.

NOTICE

To use the stroke limiter, the close tight function (open/close tight) must be deactivated. To do this, Open tight must be set to the value 1000 (100.0%) and Close tight to the value 0 (0.0%).

Index	Sub-Index	Off-set	Access Rights	Length	Index name	Parameter	Type	Default	Values
0xB6	1	0	R/W	16 bits	Stroke limiter	Max pos	uint:16	1000	Min Pos to 1000 (Min Pos to 100.0%)
	2	16	R/W	16 bits		Min pos	uint:16	0	0 to Max Pos (0.0% to Max Pos)

Description of parameter values

Index name	Parameter	Values	Description
Stroke limiter	Max pos	Min Pos to 1000 (Min Pos to 100.0%)	Set the stroke limiter of the control range in valve position OPEN.
	Min pos	0 to Max Pos (0.0% to Max Pos)	Set the stroke limiter of the control range in valve position CLOSED.

12.4.36 Set value (W) input

The function of the analog input can be set with the **Set value (W) input** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0xB8	1	0	R/W	1 bit	Set value (W) input	Direction	uint:1	0	0 1
	2	8	R/W	2 bits		Type	uint:2	1	0 1 2
	3	16	R/W	8 bits		I min	uint:8	35	0 to 40 (0 to 4.0 mA)
	4	24	R/W	8 bits		I max	uint:8	205	200 to 220 (20.0 to 22.0 mA)
	5	32	R/W	8 bits		U max	uint:8	103	100 to 110 (10.0 to 11.0 V)

Description of parameter values

Index name	Parameter	Values	Description
Set value (W) input	Direction	0 1	Specify direction of the set value input. 0 = Rise (rising) 1 = Fall (falling)
	Type	0 1 2	Determine signal input. 0 = 0 to 20 mA 1 = 4 to 20 mA 2 = 0 to 10 V
	I min	0 to 40 (0 to 4.0 mA)	Determine minimum value of the current input. If the set value is not reached, the message "Set value too small" is issued.
	I max	200 to 220 (20.0 to 22.0 mA)	Determine maximum value of the current input. If the set value is exceeded, the message "Set value too high" is issued.
	U max	100 to 110 (10.0 to 11.0 V)	Determine maximum value of the voltage input. If the set value is exceeded, the message "Set value too high" is issued.

12.4.37 Analog output

The analog output function can be set with the **Analog Output** parameter.

Index	Sub-Index	Offset	Access Rights	Length	Index name	Parameter	Type	Default	Values
0xBA	1	0	R/W	1 bit	Analog output	Direction	Boolean	0	0 1
	2	8	R/W	2 bits		Type	uint:8	1	0 1 2
	3	16	R/W	16 bits		Min.	uint:16	0	0 to Max (0.0% to Max)
	4	32	R/W	16 bits		Max.	uint:16	1000	Min to 1000 (Min to 100%)

Description of parameter values

Index name	Parameter	Values	Description
Analog output	Direction	0 1	Specify direction of the set value output. 0 = Rise (rising) 1 = Fall (falling)
	Type	0 1 2	Determine signal output. 0 = 0 to 20 mA 1 = 4 to 20 mA 2 = 0 to 10 V
	Min.	0 to Max (0.0% to Max)	Determine minimum value of the output.
	Max.	Min to 1000 (Min to 100%)	Determine maximum value of the output.

12.5 Events

The following IO-Link events can be transmitted.

Event	Mode	Type	Code
Device Hardware Fault	App/Disapp	Error	0x5000
Motor Unable To Move	App/Disapp	Error	0x8CE0
Device Temperature Over-Run	App/Disapp	Warning/Error	0x4210
Emergency Power	App/Disapp	Warning	0x5100
Primary Supply Voltage Under-Run	App/Disapp	Warning/Error	0x5111
Potifail Close	App/Disapp	Warning	0x8CA5
Potifail Open	App/Disapp	Warning	0x8CA4

Description – Events

Event	Description	Possible cause	Troubleshooting
Device Hardware Fault 0x5000	The event occurs when a hardware fault is detected.	Fault in valve position detection. Parameter can no longer be read when switching the device on.	Contact GEMÜ Support
Motor Unable To Move 0x8CE0	The event occurs when the motor is blocked.	Valve is blocked (for example, solid stuck in valve). Valve corroded (rust in place).	Check valve Carry out initialization if valve is OK

Event	Description	Possible cause	Troubleshooting
		End position can no longer be reached (after replacing the diaphragm).	
Device Temperature Over-Run 0x4210	The event occurs as a warning or error if the motor temperature is too high.	Control is operated outside of the specification. The ambient temperature is too high.	Check temperature Set control correctly (check duty cycle (ED) of the actuator)
Emergency Power 0x5100	The event occurs if the Safe/On function is selected on a digital input and the enabling signal falls. For example, by triggering a fail safe function or in case of emergency power.	The connected external fail safe function triggers. Supply by an external emergency power supply module	Check the plant and search for the cause of the disconnection.
Primary Supply Voltage Under-Run 0x5111	The event occurs if the supply is too low. The event is triggered as a warning if the supply voltage U_v is below a value of 21.1 V. (If the supply voltage is below 17.4 V, the event Primary Supply Voltage Under-Run (0x5111) is triggered as an error).	Power supply unit overloaded. Cross-section of the supply line is too small. Supply line is too long.	Check supply
Potifail Close 0x8CA5	The event occurs if a valve position is read which can never be achieved in the "Close" direction.	Fault in valve position detection. Error when replacing a diaphragm (stroke of the valve in incorrect area). Actuator has been fitted on the valve incorrectly (stroke of the valve in the incorrect area).	Check valve/diaphragm
Potifail Open 0x8CA4	The event occurs if a valve position is read which can never be achieved in the "Open" direction.	Fault in valve position detection. Error when replacing a diaphragm (stroke of the valve in incorrect area). Actuator has been fitted on the valve incorrectly (stroke of the valve in the incorrect area).	Check valve/diaphragm

13 Operation

13.1 Initialization

NOTICE

- Initialisation should be carried out in a depressurised state, initialisation force = 1/2 nominal force. When initialising under operating pressure, the initialisation force (IO-Link Index 0x90 - Subindex 3 - Force initialization) must be adjusted.

Initialisation must be carried out under the following situations:


- Subsequent mounting of the position transmitter
- Disassembly or replacement of the drive
- Replacing the sealing elements

If the process valve is completely assembled at the factory, initialisation has already been carried out.

Initialisation can be carried out using the following procedures:

- Initialisation on site
- Initialisation via IO-Link
- Initialisation via configurable digital input (digital input must be set to "Init")

13.1.1 On-site initialization of the end positions

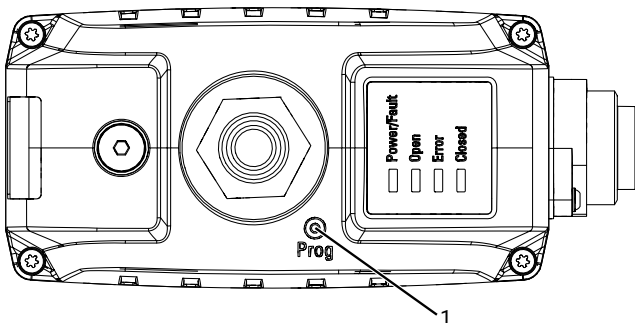


1. Connect supply voltage.
2. Hold the magnet briefly (>100 ms) at the point on the housing cover marked with PROG 1.
 - ⇒ OPEN and CLOSED LEDs flash alternately.
3. Valve automatically moves into the OPEN position.
4. Valve automatically moves into the CLOSED position.
5. Initialization mode is automatically ended.
6. The end positions are set.

13.1.2 Initialization of the end positions via IO-Link


1. Briefly activate (>100 ms) initialization mode (process data "Selection of operating mode").
 - ⇒ OPEN and CLOSED LEDs flash alternately.
2. Valve automatically moves into the OPEN position.
3. Valve automatically moves into the CLOSED position.
4. Initialization mode is automatically ended.
5. The end positions are set.

13.2 Manual override

Open, actuate and close the manual override with the hexagon socket (SW3).

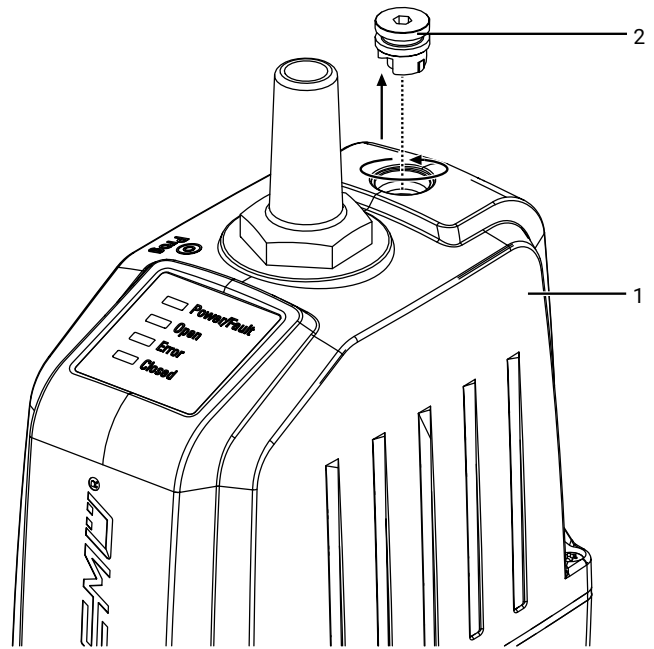

1. Unscrew sealing plug 2 anti-clockwise out of cover 1 and remove it.

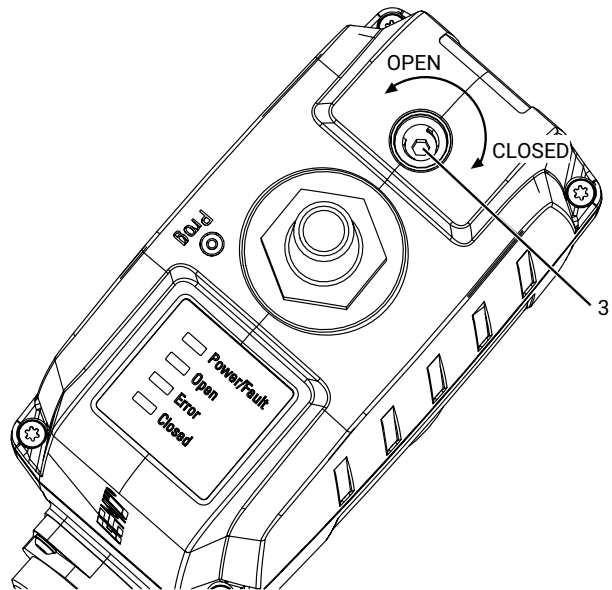

2. Operate the manual override 3 with the hexagon socket (WAF3).
 - ⇒ Turn clockwise to close the valve.
 - ⇒ Turn anticlockwise to open the valve.

14 Inspection and maintenance

⚠ WARNING



The equipment is subject to pressure!

- ▶ Risk of severe injury or death
- Depressurize the plant or plant component.
- Completely drain the plant or plant component.

NOTICE

Use of incorrect spare parts!

- ▶ Damage to the GEMÜ product
- ▶ The manufacturer liability and guarantee will be void.
- Use only genuine parts from GEMÜ.

⚠ CAUTION



Hot plant components!

- ▶ Burns
- Only work on plant that has cooled down.
- Wear protective gear.

NOTICE

Exceptional maintenance work!


- ▶ Damage to the GEMÜ product
- Any maintenance work and repairs not described in these operating instructions must not be performed without consulting the manufacturer first.

The operator must carry out regular visual examination of the GEMÜ products dependent on the operating conditions and the potential danger in order to prevent leakage and damage.

The product also must be disassembled and checked for wear in the corresponding intervals.

1. Have servicing and maintenance work performed by trained personnel.
2. Wear appropriate protective gear as specified in plant operator's guidelines.
3. Shut off plant or plant component.
4. Secure the plant or plant component against recommissioning.
5. Depressurize the plant or plant component.
6. Actuate GEMÜ products which are always in the same position four times a year.
7. If necessary, the end position counter **User** can be reset after maintenance or other changes under parameter Cycle Counter.

14.1 Spare parts

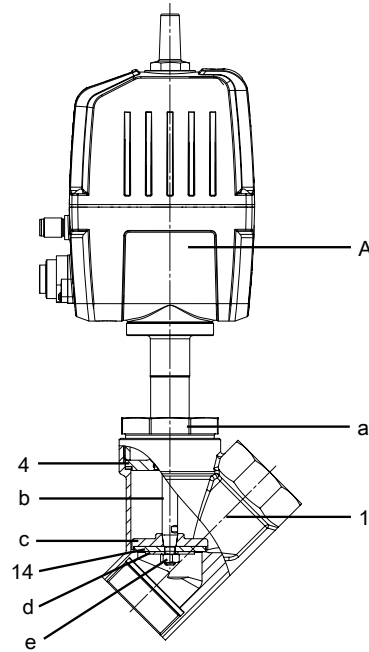

Item	Name	Order description
1	Valve body	K550... (DN6 – DN15) K514... (DN15 – DN50)
4	Sealing washer	543...SVS...
14	Shut-off seal	
A	Actuator	9543...
a	Union nut	-
b	Spindle	-
c	Valve plug	-
d	Retaining washer	-
e	Nut	-

14.2 Removing the actuator

1. Move the actuator **A** to the open position.
2. Undo union nut **a**.
3. Lift actuator **A** off valve body **1**.
4. Clean all parts of contamination (do not damage parts during cleaning).
5. Check parts for potential damage, replace if necessary (only use genuine parts from GEMÜ).

14.3 Replacing the seals

1. Remove the actuator (see "Removing the actuator", page 67).
 2. Remove sealing washer **4** from the valve body.
 3. Loosen nut **e** on spindle **b** (hold spindle **b** with appropriate tool that will not damage the spindle surfaces).
 4. Clean all parts of contamination (do not damage parts during cleaning).
 5. Insert new seat seal **14**.
 6. Insert retaining washer **d**.
 7. Apply appropriate thread locking compound on the thread of spindle **b**.
 8. Fix spindle **b** in place with nut **e** (hold spindle **b** in place with appropriate tools which do not damage the spindle surfaces).
 9. Insert new sealing washer **4** in valve body **1**.
- Mount the actuator (see "Mounting the actuator", page 68).

14.4 Mounting the actuator

NOTICE


- Clean all parts of contamination (do not damage the parts during cleaning) following removal. Check parts for potential damage, replace if necessary (only use genuine parts from GEMÜ).

CAUTION



Incorrect combination of actuator and valve body!

- Risk of damage to the actuator and valve body
- For control valves with a reduced valve seat, make sure that the combination of actuator and valve body is correct.
- Compare the product label of the actuator with the valve body marking.

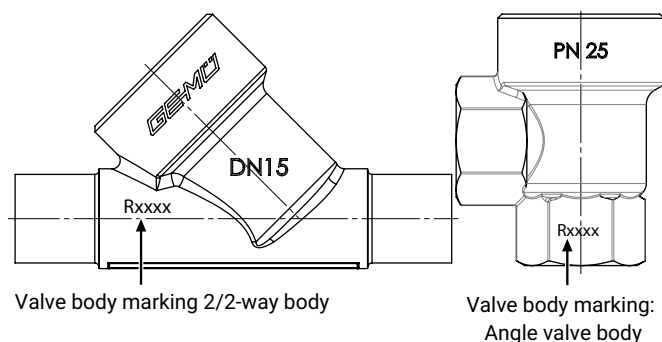

Actuator product label	Valve body marking
RAxxx	R002
RBxxx	R004
RCxxx	R006
RDxxx	R008
RExxx	R010
RFxxx	R012

Actuator product label	Valve body marking
RGxxx	R015
RHxxx	R020
RJxxx	R025
RKxxx	R032
RMxxx	R040

1. Move the actuator **A** to the open position.
2. Lubricate the thread of the union nut **a** using a suitable lubricant.
3. Place actuator **A** on valve body **1** approx. 90° in front of the end position (orientation of the connections) and screw hand tight with union nut **a**.
4. Tighten union nut **a** with an open-end wrench (for torques, see table).
 - ⇒ This rotates the actuator clockwise approx. 90° to the desired position.

Actuator size 0A

Nominal size	Torque
DN 10	90 Nm
DN 15	90 Nm
DN 20	100 Nm
DN 25	120 Nm

Actuator size 1A

Nominal size	Torque
DN 15	90 Nm
DN 20	100 Nm
DN 25	120 Nm
DN 32	120 Nm
DN 40	150 Nm
DN 50	200 Nm

5. Move the actuator **A** to the closed position.
6. With the valve fully assembled, check the function and tightness.
7. Carry out initialisation.

15 Troubleshooting

15.1 LED error message

Function	Power/fault	Open	Error	Closed
Supply voltage too low				
	red			
Software Update				
Internal error				
Product not calibrated				
Motor does not move				
Product not initialized				
		Open and Closed flash alternately		
Temperature error				
Emergency power operation, OPEN position				
	red			
Emergency power operation, CLOSED position				
	red			
Emergency power operation, position unknown				
	red			
Set value too small				
Set value too high				
Abort IO-Link communication				
Maintenance required, OPEN position				
Maintenance required, CLOSED position				
Maintenance required, position unknown				

15.2 Troubleshooting

Error	Possible cause	Troubleshooting
The product is leaking downstream (does not close or does not close fully)	Operating pressure too high	Operate the product with operating pressure specified in datasheet
	Valve body leaking or damaged	Carry out initialisation, check valve body for damage, replace valve body if necessary.
The product does not open or does not open fully	Actuator defective	Replace the actuator
	Operating pressure too high	Operate the product with operating pressure specified in datasheet
	Foreign matter in the product	Remove and clean the product
	The actuator design is not suitable for the operating conditions	Use an actuator that is designed for the operating conditions
	Voltage is not connected	Connect voltage
	Cable ends incorrectly wired	Wire cable ends correctly
The product does not close or does not close fully	The actuator design is not suitable for the operating conditions	Use an actuator that is designed for the operating conditions
	Foreign matter in the product	Remove and clean the product
	Voltage is not connected	Connect voltage
The product does not close or does not close completely	Valve does not close completely	Perform initialisation
The product is leaking between actuator and valve body	Bolting between valve body and actuator loose	Tighten bolting between valve body and actuator
	Actuator/valve body damaged	Replace actuator/valve body
The product is leaking between actuator flange and valve body	Mounting parts loose	Retighten mounting parts
	Valve body / actuator damaged	Replace valve body/actuator
Valve body of the GEMÜ product is leaking	Valve body of the GEMÜ product is faulty or corroded	Check valve body of the GEMÜ product for potential damage, replace valve body if necessary
Body of the GEMÜ product is leaking	Incorrect installation	Check installation of valve body in piping
Valve body connection to piping leaking	Incorrect installation	Check installation of valve body in piping

16 Removal from piping

 WARNING	
	Corrosive chemicals! ▶ Risk of caustic burns ● Wear appropriate protective gear. ● Completely drain the plant.

1. Remove in reverse order to installation.
2. Unscrew the electrical wiring.
3. Disassemble the product. Observe warning notes and safety information.

17 Disposal

1. Pay attention to adhered residual material and gas diffusion from penetrated media.
2. Dispose of all parts in accordance with the disposal regulations/environmental protection laws.

18 Returns

Legal regulations for the protection of the environment and personnel require that the completed and signed return delivery note is included with the dispatch documents. Returned goods can be processed only when this note is completed. If no return delivery note is included with the product, GEMÜ cannot process credits or repair work but will dispose of the goods at the operator's expense.

1. Clean the product.
2. Request a return delivery note from GEMÜ.
3. Complete the return delivery note.
4. Send the product with a completed return delivery note to GEMÜ.

19 EU Declaration of Incorporation according to the EC Machinery Directive 2006/42/EC, Annex II B



EU Declaration of Incorporation

according to the EC Machinery Directive 2006/42/EC, Annex II B

We, the company GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG
Fritz-Müller-Strasse 6-8
74653 Ingelfingen-Criesbach, Germany

hereby declare under our sole responsibility that the below-mentioned product complies with the relevant essential health and safety requirements in accordance with Annex I of the above-mentioned Directive.

Product: GEMÜ 543
Product name: Motorized angle seat globe valve
The following essential health and safety requirements of the EC Machinery Directive 2006/42/EC, Annex I have been applied or adhered to: 1.1.2.; 1.1.3.; 1.1.5.; 1.3.2.; 1.3.4.; 1.3.7.; 1.3.8.; 1.5.1.; 1.5.13.; 1.5.2.; 1.5.4.; 1.5.6.; 1.5.7.; 1.5.8.; 1.6.1.; 1.6.3.; 1.6.5.; 1.7.1.; 1.7.1.1.; 1.7.2.; 1.7.3.; 1.7.4.; 1.7.4.1.; 1.7.4.2.; 1.7.4.3.
The following harmonized standards (or parts thereof) have been applied: EN ISO 12100:2010

We also declare that the specific technical documents have been created in accordance with part B of Annex VII.

The manufacturer undertakes to transmit relevant technical documents on the partly completed machinery to the national authorities in response to a reasoned request. This communication takes place electronically.

This does not affect the industrial property rights.

The partly completed machinery may be commissioned only if it has been determined, if necessary, that the machinery into which the partly completed machinery is to be installed meets the provisions of the Machinery Directive 2006/42/EC.

M. Barghoorn
Head of Global Technics
Ingelfingen, 27/11/2023

20 EU Declaration of Conformity in accordance with 2014/68/EU (Pressure Equipment Directive)



EU Declaration of Conformity

in accordance with 2014/68/EU (Pressure Equipment Directive)

We, the company

GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG
Fritz-Müller-Strasse 6-8
74653 Ingelfingen-Criesbach, Germany

hereby declare under our sole responsibility that the below-mentioned product complies with the regulations of the above-mentioned Directive.

Product: GEMÜ 543
Product name: Motorized angle seat globe valve
Notified body: TÜV Rheinland Industrie Service GmbH
Am Grauen Stein 1
51105 Cologne, Germany

ID number of the notified body: 0035

No. of the QA certificate: 01 202 926/Q-02 0036

Conformity assessment procedure(s) applied: ap-Module H

The following harmonized standards (or parts thereof) have been applied: EN 12516-3:2002/AC:2003

Information for products with a nominal size $\leq$ DN 25:

The products are developed and produced according to GEMÜ's in-house process instructions and standards of quality which comply with the requirements of ISO 9001 and ISO 14001. According to Article 4, Paragraph 3 of the Pressure Equipment Directive 2014/68/EU, these products must not be identified by a CE-marking.

Other applied technical standards / Remarks:

- AD 2000

M. Barghoorn
Head of Global Technics

Ingelfingen, 27/11/2023

GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG
Fritz-Müller-Straße 6-8 D-74653 Ingelfingen-Criesbach

www.gemu-group.com
info@gemue.de

21 EU Declaration of Conformity in accordance with 2014/30/EU (EMC Directive)




EU Declaration of Conformity

in accordance with 2014/30/EU (EMC Directive)

We, the company GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG
Fritz-Müller-Strasse 6-8
74653 Ingelfingen-Criesbach, Germany

hereby declare under our sole responsibility that the below-mentioned product complies with the regulations of the above-mentioned Directive.

Product: GEMÜ 543
Product name: Motorized angle seat globe valve
The following harmonized standards (or parts thereof) have been applied: EN 61000-6-4:2007/A1:2011; EN 61000-6-2:2005/AC:2005

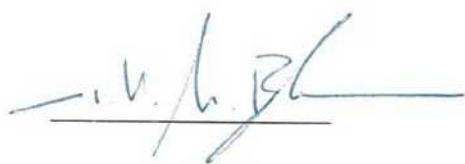

M. Barghoorn
Head of Global Technics
Ingelfingen, 27/11/2023

22 EU Declaration of Conformity in accordance with 2011/65/EU (RoHS Directive)



EU Declaration of Conformity


in accordance with 2011/65/EU (RoHS Directive)

We, the company

GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG
Fritz-Müller-Strasse 6-8
74653 Ingelfingen-Criesbach, Germany

hereby declare under our sole responsibility that the below-mentioned product complies with the regulations of the above-mentioned Directive.

Product: GEMÜ 543
Product name: Motorized angle seat globe valve
The following harmonized standards (or parts thereof) have been applied: EN IEC 63000:2018

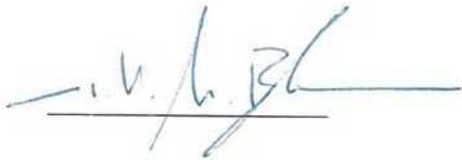

M. Barghoorn
Head of Global Technics
Ingelfingen, 27/11/2023



GEMÜ Gebr. Müller Apparatebau GmbH & Co. KG
Fritz-Müller-Straße 6-8, 74653 Ingelfingen-Criesbach, Germany
Phone +49 (0) 7940 1230 · info@gemue.de
www.gemu-group.com

Subject to alteration

11.2025 | 88668392